



Level



Pressure



Flow



Temperature



Liquid
Analysis



Registration



Systems
Components



Services



Solutions

Technical Information

Cerabar S PMC71, PMP71/72/75

Pressure transmitter

with ceramic and metal sensors

Overload-resistant and function-monitored; Communication via HART, PROFIBUS PA or FOUNDATION Fieldbus



Application

The Cerabar S pressure transmitter is used for the following measuring tasks:

- Absolute pressure and gauge pressure in gases, steams or liquids in all areas of process engineering and process measurement technology
- Level, volume or mass measurement in liquids
- High process temperature
 - without diaphragm seals up to 150°C (302°F)
 - with typical diaphragm seals up to 350°C (662°F)
- High pressure up to 700 bar
- International usage thanks to a wide range of approvals



Your benefits

- Very good reproducibility and long-term stability
- High reference accuracy: up to $\pm 0.075\%$, as PLATINUM version: $\pm 0.05\%$
- Turn down 100:1, higher on request
- Meets PED (Pressure Equipment Directive)
- Used for process pressure monitoring up to SIL 2, certified according to IEC 61508 by TÜV SÜD
- HistoROM®/M-DAT memory module
- Function-monitored from the measuring cell to the electronics
- Continuous modularity for differential pressure and pressure (Deltabar S – Cerabar S), e.g.
 - replaceable display
 - universal electronic
- Quick commissioning thanks to quick setup menu
- Easy and safe menu-guided operation on-site, via 4...20 mA with HART, via PROFIBUS PA or via FOUNDATION Fieldbus
- Extensive diagnostic functions
- Device versions in conformity with ASME-BPE



Table of contents




Function and system design	4
Device selection	4
Overview of diaphragm seal for PMP75	5
Measuring principle	7
Level measurement (level, volume and mass)	8
Communication protocol	8
Human interface	9
On-site display (optional)	9
Operating elements	10
HistoROM®/M-DAT (optional)	11
Functional Safety SIL2/IEC 61508 Declaration of conformity (optional)	11
On-site operation	11
Handheld terminals – HART	11
Handheld terminal DXR375 – FOUNDATION Fieldbus	11
ToF Tool – HART, PROFIBUS PA, FOUNDATION Fieldbus	12
FieldCare – HART, PROFIBUS PA	12
Remote operation – FOUNDATION Fieldbus	12
Service interface FXA193	12
Input	13
Measured variable	13
Measuring range	13
Explanation of terms	15
Output	16
Output signal	16
Signal range – 4...20 mA HART	16
Signal on alarm	16
Load – 4...20 mA HART	16
Resolution	17
Reading cycle	17
Cycle time (Update time)	17
Response time	17
Damping	17
Power supply	18
Electrical connection 4...20 mA HART	18
Supply voltage	20
Current consumption	20
Cable entry	20
Cable specification	20
Residual ripple	20
Influence of power supply	20
Performance characteristics – general	21
Reference operating conditions	21
Uncertainty of measurement for small absolute pressure ranges	21
Long-term stability	21
Influence of the installation position	21

Performance characteristics – ceramic diaphragm	22
Reference accuracy – PMC71	22
Total performance – PMC71	22
Warm-up period – PMC71	23
Dead time, Time constant (T63) – PMC71	23
Thermal change of the zero output and the output span – PMC71	23
Performance characteristics – metallic diaphragm	24
Reference accuracy – PMP71, PMP75	24
Total performance – PMP71	25
Warm-up period – PMP71, PMP75	25
Dead time, Time constant (T63) – PMP71, PMP75	26
Thermal change of the zero output and the output span – PMP71	26
Operating conditions (installation)	27
General installation instructions	27
Installation instructions for devices without diaphragm seal – PMC71 and PMP71	27
Heat insulation – PMC71 high temperature version and PMP75	27
Mounting with temperature isolator	28
Wall and pipe-mounting	28
Turn the housing	29
Oxygen applications	29
Ultra pure gas applications	30
Diaphragm seals for materials with hydrogen build-up (Gold-Rhodium coating)	30
Operating conditions (environment)	30
Ambient temperature limits	30
Storage temperature range	30
Degree of protection	30
Climate class	30
Vibration resistance	31
Electromagnetic compatibility	31
Overvoltage protection	31
Operating conditions (Process)	32
Process temperature limits	32
Temperature operating range, seals	32
Pressure specifications	33
Mechanical construction	34
Housing dimensions T14	34
Housing dimensions T17	34
Process connections PMC7	35
Process connections PMP71	42
PMP75 Basic unit	49
Process connections PMP75	49
Weight	61
Material	61

Planning instructions, diaphragm seal systems	62
Applications	62
Planning instructions	62
Diaphragm seal filling oils	63
Influence of the temperature on the zero point	63
Ambient temperature range	67
Installation instructions	67
 Certificates and approvals	 69
CE mark	69
Ex approvals	69
Marine certificate	69
Overspill protection	69
CRN approvals	69
Pressure Equipment Directive (PED)	69
Standards and guidelines	69
 Ordering information	 70
PMC71	70
PMP71	74
PMP75	78
 Documentation	 82
Innovation	82
Field of Activities	82
Technical Information	82
Operating Instructions	82
Manual for Functional Safety (SIL)	82
Safety Instructions	82
Installation/Control Drawings	83
Overspill protection	83

Function and system design

Device selection







Cerabar S – Product family	PMC71  P01-PMC71xxx-16-xx-xx-xx-000 With capacitive measuring cell and ceramic measuring diaphragm (Ceraphire®)	PMP71  P01-PMP71xxx-16-xx-xx-xx-000 With piezoresistive measuring cell and metallic welded diaphragm	PMP75  P01-PMP75xxx-16-xx-xx-xx-000 With diaphragm seal
Field of application	– Gauge pressure and absolute pressure – Level	– Gauge pressure and absolute pressure – Level	– Gauge pressure and absolute pressure – Level
Process connections	– Diverse thread – DN 32 – DN 80 – ANSI 1 1/2" – 4" – JIS 50 A – 100 A	– Diverse thread – DN 25 – DN 80 – ANSI 1 1/2" – 4" – JIS 25 A – 100 A – Oval flange adapter – Prepared for diaphragm seal mount	– Wide range of diaphragm seals, → see the following section "Overview of diaphragm seal for PMP 75"
Measuring ranges	from –0.1/0...100 mbar to –1/0...40 bar	from –0.1/0...100 mbar to –1/0...700 bar	from –0.1/0...400 mbar to –1/0...700 bar
OPL ¹	max. 60 bar	max. 1050 bar	max. 1050 bar
Process temperature	–20...+125°C/–20...+150°C ² (–4...+257°F/–4...+302°C)	–40...+125°C (–40...+257°F)	With diaphragm seal up to +350°C (+662°F)
Ambient temperature	–40...+85°C (–40...+185°F)	–40...+85°C (–40...+185°F) ³	–40...+85°C (–40...+185°F)
Reference accuracy	– Up to ±0.075% of the set span – PLATINUM version: up to ±0.05% of the set span		Up to ±0.075% of the set span
Supply voltage	– For non-hazardous areas: 10.5...45 V DC – EEx ia: 10.5...30 V DC		
Output	4...20 mA with superimposed HART protocol, PROFIBUS PA, FOUNDATION Fieldbus		
Options	– PMP71, PMP75: Gold-Rhodium-coated diaphragm – PMP71, PMP75: NACE-compliant materials – PMC71, PMP71, PMP75: inspection certificate 3.1		
Specialities	– Metal-free measurement with PVDF connection	– Oil volume-minimised process connections – gas-tight, elastomer-free	– Wide range of diaphragm seals – For high media temperatures – Oil volume-minimised process connections – Completely welded versions



1) OPL = Over pressure limit; dependent on the lowest-rated element, with regard to pressure, of the selected components

2) High temperature version "T" for feature 100 "Additional option 1" or for feature 110 "Additional option 2"

3) lower temperature on request


**Overview of diaphragm seal
for PMP75**

Design	Diaphr. seal	Connection	Version	Standard	Nominal diameter	Nom. press./Class
Thread	Membrane diaphragm seal (MDM)	G	 P01-PMP75xxx-03-xx-xx-xx-005	ISO 228	– G 1A – G 1 1/2 A – G 2A	700 bar
		NPT	 P01-PMP75xxx-03-xx-xx-xx-006	ANSI	– 1 MNPT – 1 1/2 MNPT – 2 MNPT	700 bar
Tri-Clamp	Membrane diaphragm seal (MDM)	Clamp	 P01-FMD78xxx-03-xx-xx-xx-005	ISO 2852	– DN 25 (1") – DN 38 (1 1/2") – DN 51 (2") – DN 76.1 (3")	Dependent on the clamp used
	Pipe diaphragm seal (RDM)	Clamp	 P01-FMD78xxx-03-xx-xx-xx-009	ISO 2852	– DN 25 (1") – DN 38 (1 1/2") – DN 51 (2")	Dependent on the clamp used
Front-flush connections	Membrane diaphragm seal (MDM)	Varivent	 P01-FMD78xxx-03-xx-xx-xx-007		Type N for pipes DN 40 – DN 162	PN 40
		DRD	 P01-FMD78xxx-03-xx-xx-xx-006		d = 65 mm	25 bar
		Taper adapter with coupling nut	 P01-FMD78xxx-03-xx-xx-xx-003	DIN 11851	– DN 50 – DN 65 – DN 80	PN 25
		Threaded adapter	 P01-FMD78xxx-03-xx-xx-xx-004	DIN 11851	– DN 50 – DN 65 – DN 80	PN 25
Versions in conformity with ASME-BPE for use in biotechnical processes; wetted surfaces $R_a \leq 0.4 \mu\text{m}$ (15.75 μin ; 180 grit), electropolished	Membrane diaphragm seal (MDM)	Clamp	 P01-PMP46xxx-03-xx-xx-xx-005	ISO 2852	– DN 25 (1 1/2") – DN 51 (2")	Dependent on the clamp used
		Varivent	 P01-PMP46xxx-03-xx-xx-xx-004		– Type N for pipes DN 40 – DN 162	PN 40
Flange	Membrane diaphragm seal (MDM)	EN/DIN flange	 P01-PMP75xxx-03-xx-xx-xx-001	EN 1092-1/ DIN 2527 and DIN 2501-1	– DN 25, DN 50 – DN 32, DN 40 – DN 80 – DN 100	– up to PN 400 – PN 40 – up to PN 100 – PN 100
		ANSI flange		ANSI B 16.5	– 1", 2" – 1 1/2", 3", 4"	– 2500 lbs – 300 lbs
		JIS flange		B 2220	25A, 50A, 80A, 100A	10 K
Flange with extended diaphragm seal	Membrane diaphragm seal (MDM)	EN/DIN flange	 P01-PMP75xxx-03-xx-xx-xx-002	EN 1092-1/ DIN 2527	DN 50/DN 80 + 50/100/200 mm ext. diaphr. seal	PN 10 – PN 40
		ANSI flange		ANSI B 16.5	2"/3"/4" + 2"/4"/6"/ 8" ext. diaphr. seal	Up to 300 lbs

Design	Diaphr. seal	Connection	Version	Standard	Nominal diameter	Nom. press./Class
Threaded connection with separator	Membrane diaphragm seal (MDM)	G	 P01-PMP75xxx-03-xx-xx-xx-004	ISO 228/ EN837	– G 1/2 A – G 1/2 B	– 160 bar – 400 bar
		NPT	 P01-PMP75xxx-03-xx-xx-xx-008	ANSI	– 1/2 MNPT	– 160 bar – 400 bar
		NPT Off line thread	 P01-PMP75xxx-03-xx-xx-xx-009	ANSI	– 1/2 NPT – 1 NPT	250 bar

Measuring principle

Ceramic measuring diaphragm used for PMC71 (Ceraphire®)

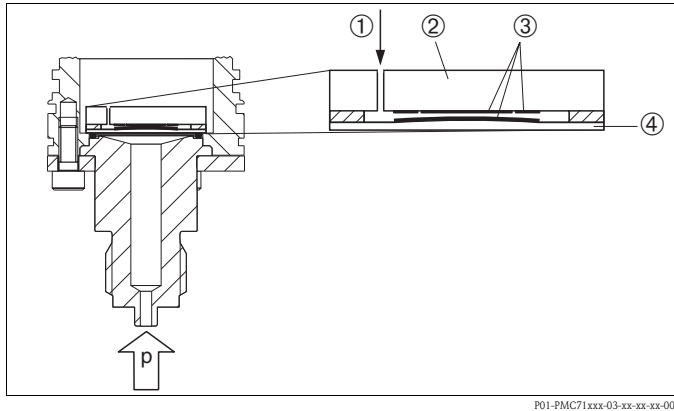


P01-PMC71xxx-03-xx-xx-xx-000

Ceramic sensor

- 1 Atmospheric vent (gauge pressure only)
- 2 Ceramic substrate
- 3 Electrodes
- 4 Ceramic diaphragm

Metallic measuring diaphragm used for PMP71 and PMP75

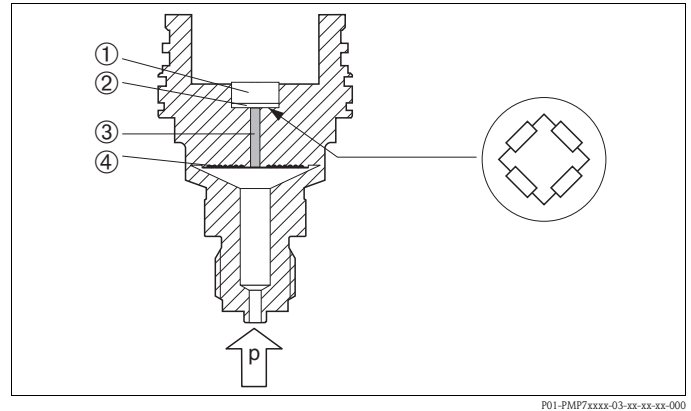

P01-PMP7xxxx-03-xx-xx-xx-000

Metal sensor

- 1 Measuring element
- 2 Measuring diaphragm with Wheatstone bridge
- 3 Channel with fill fluid
- 4 Process diaphragm, Metal separating diaphragm

Ceramic measuring diaphragm used for PMC71 (Ceraphire®)

The ceramic sensor is a dry sensor, i.e. the process pressure acts directly on the robust ceramic diaphragm and deflects it. A pressure-dependent change in capacitance is measured at the electrodes of the ceramic carrier and the diaphragm. The measuring range is determined by the thickness of the ceramic diaphragm.

Advantages:

- Guaranteed overload resistance up to 40 times the nominal pressure
- Thanks to highly-pure 99.9% ceramic (Ceraphire®)
 - extremely high resistance compared to Alloy
 - less relaxation
 - high mechanical stability
- Suitable for vacuums
- Second process barrier (Secondary Containment) for enhanced integrity
- Process temperature up to 150°C (302°F)

Metallic measuring diaphragm used for PMP71 and PMP75

PMP71

The operating pressure deflects the separating diaphragm and a fill fluid transfers the pressure to a resistance measuring bridge (semi-conductor technology). The pressure-dependent change of the bridge output voltage is measured and processed further.

Advantages:

- Can be used with process pressures up to 700 bar
- High long-term stability
- Guaranteed overload resistance up to 4 times the nominal pressure (PMP71)
- Second process barrier (Secondary Containment) for enhanced integrity
- Significantly less thermal effect compared to diaphragm seal systems

PMP75


The operating pressure acts on the diaphragm of the diaphragm seal and is transferred to the separating diaphragm of the sensor by a diaphragm seal fill fluid. The separating diaphragm is deflected and a fill fluid transfers the pressure to a resistance measuring bridge. The pressure-dependent change of the bridge output voltage is measured and processed further.

Advantages:

- Can be used with process pressures from 400 mbar to 400 bar
- High long-term stability
- Guaranteed overload resistance up to 4 times the nominal pressure
- Second process barrier (Secondary Containment) for enhanced integrity

Level measurement (level, volume and mass)

Design and operation mode

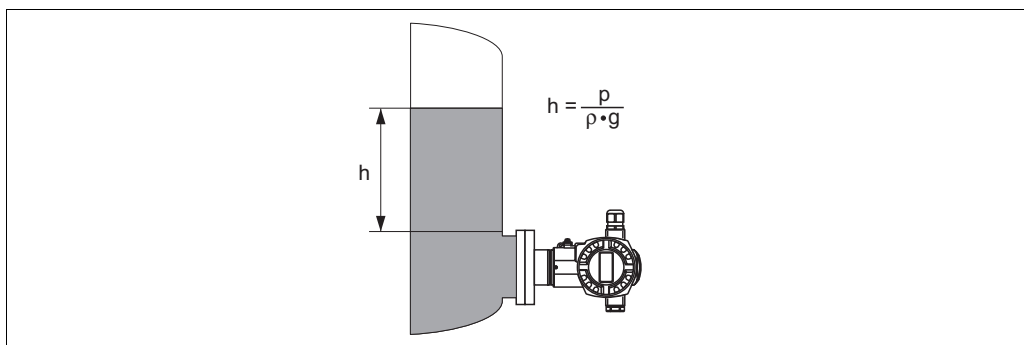

Level measurement with Cerabar S

h	Height (level)
p	Pressure
ρ	Density of the medium
g	Gravitation constant

Your benefits

- Choice of three level operating modes
- Volume and mass measurements in any tank shapes by means of a freely programmable characteristic curve
- Choice of diverse level units with automatic unit conversion
- A customised unit can be specified
- Has a wide range of uses, e.g.
 - in the event of foam formation
 - in tanks with agitators or screen fittings
 - in the event of liquid gases
 - for standard level measurement

Communication protocol

- 4...20 mA with HART communication protocol
- PROFIBUS PA
 - The Endress+Hauser devices meet the requirements as per the FISCO model.
 - Due to the low current consumption of $11 \text{ mA} \pm 1 \text{ mA}$
 - up to 9 Cerabar S for EEx ia, CSA IS and FM IS applications
 - up to 32 Cerabar S for all other applications, e.g. in non-hazardous areas, EEx nA, etc.

Further information on PROFIBUS PA, such as requirements for bus system components, can be found in the Operating Instructions BA034S "PROFIBUS DP/PA: Guidelines for planning and commissioning" and in the PNO guideline.

- FOUNDATION Fieldbus
 - The Endress+Hauser devices meet the requirements as per the FISCO model.
 - Due to the low current consumption of $14 \text{ mA} \pm 1 \text{ mA}$
 - up to 7 Cerabar S for EEx ia, CSA IS and FM IS applications
 - up to 30 Cerabar S for all other applications, e.g. in non-hazardous areas, EEx nA, etc.

Further information on FOUNDATION Fieldbus, such as requirements for bus system components can be found in the Operating Instructions BA013S "FOUNDATION Fieldbus Overview".

Human interface


On-site display (optional)

A 4-line liquid crystal display (LCD) is used for display and operation. The on-site display shows measured values, dialog text as well as fault and notice messages in plain text, thereby supporting the user in every stage of operation.

4...20 mA HART

Functions:

- 8-digit measured value display including sign and decimal point, bargraph for current display
- Simple and complete menu guidance thanks to separation of the parameters into three levels
- Each parameter is given a 3-digit ID number for easy navigation.
- Option for configuring the display according to individual requirements and desires, such as language, alternating display, display of other measured values such as sensor temperature, contrast setting
- Comprehensive diagnostic functions (fault and warning message, peak-hold indicators, etc.)
- Rapid and safe commissioning with the Quick Setup menus

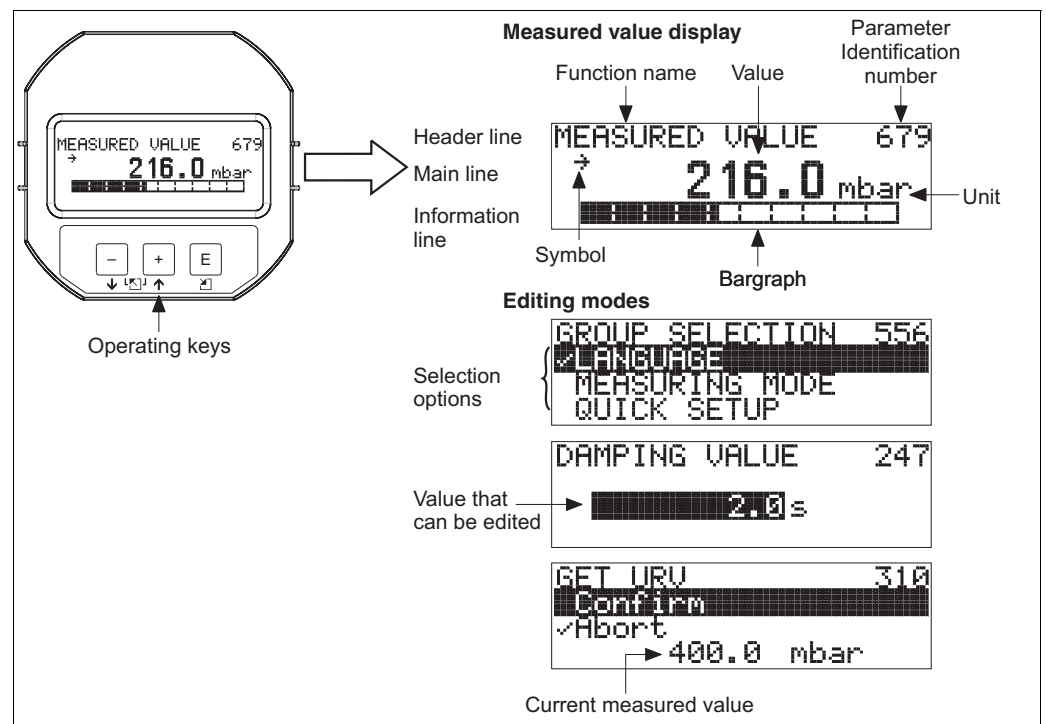


P01-xMx7xxxx-07-xx-xx-xx-001

PROFIBUS PA and FOUNDATION Fieldbus

Functions:

- 8-digit measured value display including sign and decimal point, bargraph for current display
- Option for configuring the display according to individual requirements and desires, such as language, alternating display, display of other measured values such as sensor temperature, contrast setting
- Comprehensive diagnostic functions (fault and warning message)

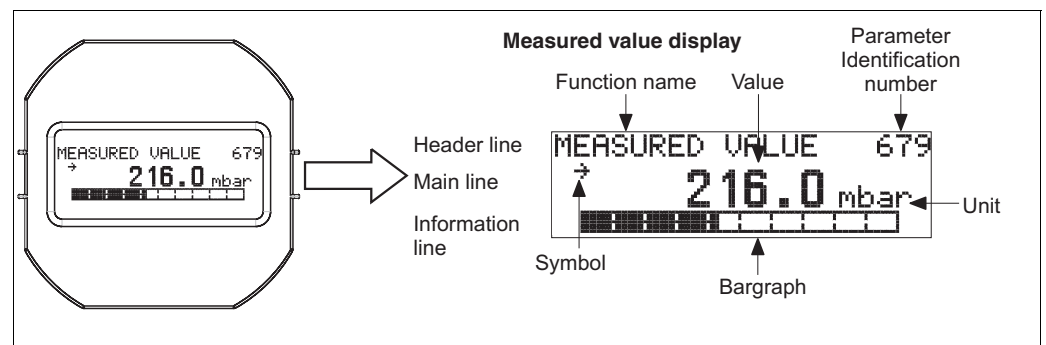


P01-xMD7xxxx-07-xx-xx-xx-001

Operating elements

With regard to T14 housings, the operating keys are located either outside the device under the protection cap or inside on the electronic insert. In T17 housings, the operating keys are always located inside on the electronic insert.

In addition, devices with an on-site display and a 4 to 20 mA HART electronic insert have operating keys on the on-site display.

Operating keys on the exterior of the device

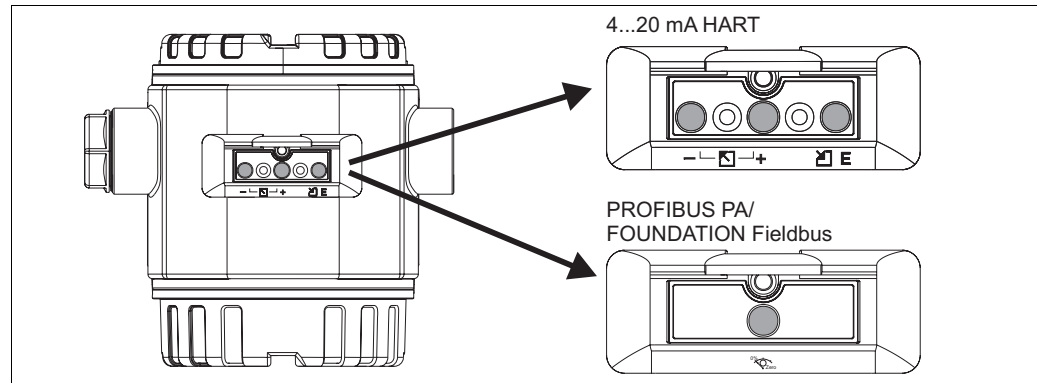


P01-PMx7xxxx-19-xx-xx-xx-038

The operating keys located externally on the device work on the Hall sensor principle. As a result, no additional openings are required in the device. This guarantees:

- Complete protection against environmental influences such as moisture and contamination
- Simple operation without any tools
- No wear.


Operating keys and elements located internally on the electronic insert

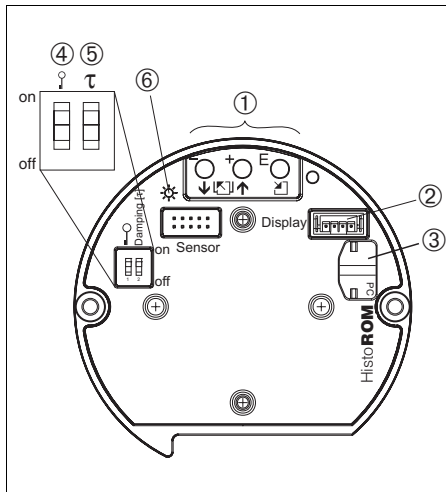

P01-xxxxxxx-19-xx-xx-xx-104

Electronic insert HART


- 1 Operating keys
- 2 Slot for optional display
- 3 Slot for optional HistoROM®/M-DAT
- 4 DIP-switch for locking/unlocking measured-value-relevant parameters
- 5 DIP-switch for damping on/off
- 6 Green LED to indicate value being accepted

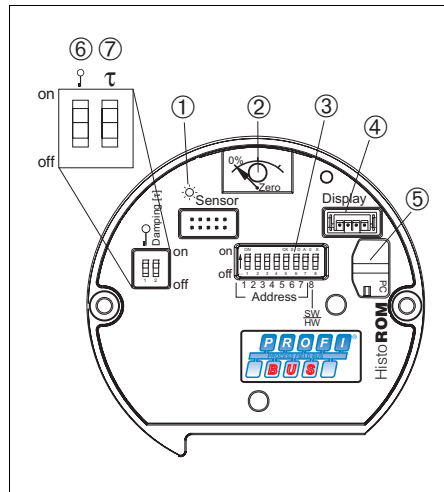

P01-xxxxxxx-19-xx-xx-xx-105

Electronic insert PROFIBUS PA

- 1 Green LED to indicate value being accepted
- 2 Key for position calibration
- 3 DIP-switch for bus address
- 4 Slot for optional display
- 5 Slot for optional HistoROM®/M-DAT
- 6 DIP-switch for locking/unlocking measured-value-relevant parameters
- 7 DIP-switch for damping on/off

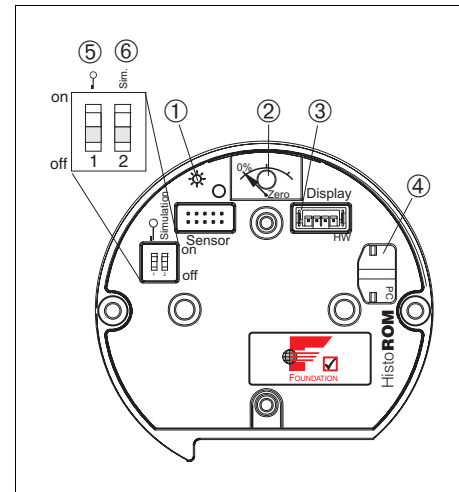

P01-xxxxxxx-19-xx-xx-xx-106

Electronic insert FOUNDATION Fieldbus

- 1 Green LED to indicate value being accepted
- 2 Key for position calibration
- 3 Slot for optional display
- 4 Slot for optional HistoROM®/M-DAT
- 5 DIP-switch for locking/unlocking measured-value-relevant parameters
- 6 DIP-switch for simulation mode on/off

**HistoROM®/M-DAT
(optional)**

HistoROM®/M-DAT is a memory module, which is attached to the electronic insert. The HistoROM®/M-DAT can be retrofitted at any stage (Order number: 52027785).

Your benefits

- Quick and safe commissioning of the same measuring points by copying the configuration data of one transmitter to another transmitter
- Reliable process monitoring thanks to cyclical recording of pressure and sensor temperature measured values
- Simple diagnosis by recording diverse events such as alarms, configuration changes, counters for measuring range undershoot and overshoot for pressure and temperature as well as user limit overshoot and undershoot for pressure and temperature etc.
- Analysis and graphic evaluation of the events and process parameters via ToF Tool (contained in scope of supply)

HistoROM®/M-DAT can be ordered via feature 100 "Additional options 1" or feature 110 "Additional options 2" or as spare parts. → See also page 70 ff. A CD with the Endress+Hauser ToF Tool operating program is also included in the scope of delivery.

You can copy data from one transmitter to another transmitter when operating a FOUNDATION Fieldbus device via an FF configuration program. You need the Endress+Hauser ToF Tool operating program and the FXA193 service interface to be able to access the data and events saved in the HistoROM®/M-DAT.

**Functional Safety SIL2/
IEC 61508 Declaration of
conformity (optional)**

The Cerabar S pressure transmitters with 4...20 mA output signal have been developed to IEC 61508 standard and have been certified by TÜV SÜD. These devices can be used for process pressure monitoring up to SIL 2. → For a detailed description of the safety functions with Cerabar S, settings and characteristic quantities for functional safety, please refer to the "Manual for Safety Manual - Cerabar S" SD190P. → For devices with SIL2/IEC 61508 declaration of conformity, see page 73 ff, Feature 100 "Additional option 1" and Feature 110 "Additional option 2", version E "SIL2/IEC 61508, Declaration of Conformity".

On-site operation**Functions 4...20 mA HART**

- With on-site display: navigate through the operating menu using three operating keys
- Without on-site display:
 - Position calibration (zero point correction)
 - Setting lower-range value and upper-range value – reference pressure present at device
 - Value acceptance indicated by green LED
- Device reset
- Locking and unlocking measured-value-relevant parameters
- Switching damping on and off

Functions PROFIBUS PA

- Position calibration (zero point correction)
- Value acceptance indicated by green LED
- Locking and unlocking measured-value-relevant parameters
- Setting bus address
- Switching damping on and off

Functions FOUNDATION Fieldbus

- Position calibration (zero point correction)
- Value acceptance indicated by green LED
- Locking and unlocking measured-value-relevant parameters
- Switching simulation mode on and off

Handheld terminals – HART

With a handheld terminal, all the parameters can be configured anywhere along the 4...20 mA line via menu operation.

**Handheld terminal DXR375 –
FOUNDATION Fieldbus**

With a handheld terminal DXR375, all the parameters can be configured via menu operation.

**ToF Tool –
HART, PROFIBUS PA,
FOUNDATION Fieldbus**

The ToF Tool is a graphic and menu-guided operating program for measuring devices from Endress+Hauser. It is used for the commissioning, data storage, signal analysis and documentation of the devices. The following operating systems are supported: WinNT4.0, Win2000 and Windows XP. You can set all parameters via the ToF Tool.

The ToF Tool supports the following functions:

- Configuration of transmitters in online operation
- Loading and saving device data (upload/download)
- HistoROM®/M-DAT analysis
- Calculation of tank characteristics for the level measuring mode
- Documentation of the measuring point

Connection options:

- HART via Commubox FXA191 and the serial interface RS 232 C of a computer
- HART via Commubox FXA195 and the USB interface of a computer
- PROFIBUS PA via segment coupler and PROFIBUS interface card
- FOUNDATION Fieldbus, PROFIBUS PA and HART: Service interface with adapter FXA193



Note!

You can use the ToF Tool to configure the Endress+Hauser parameters for devices with "FOUNDATION Fieldbus signal". You need an FF configuration program to be able to configure all the FF-specific parameters and to integrate the device into an FF network.

**FieldCare –
HART, PROFIBUS PA**

FieldCare is an Endress+Hauser asset management tool based on FDT technology. With FieldCare, you can configure all Endress+Hauser devices as well as devices from other manufacturers that support the FDT standard. The following operating systems are supported: WinNT4.0, Win2000 and Windows XP.

FieldCare supports the following functions:

- Configuration of transmitters in online operation
- Loading and saving device data (upload/download)
- HistoROM®/M-DAT analysis
- Documentation of the measuring point

Connection options:

- HART via Commubox FXA195 and the USB interface of a computer
 - PROFIBUS PA via segment coupler and PROFIBUS interface card
-

**Remote operation –
FOUNDATION Fieldbus**

An FF configuration program is required to integrate a device with "FOUNDATION Fieldbus signal" into an FF network or to set the FF-specific parameters. Please contact your local Endress+Hauser Sales Center for more information.

Service interface FXA193

The FXA193 service interface connects Cerabar S, Deltabar S, ToF and PROline measuring devices (level and flow measuring devices) with the RS 232 C serial interface of a PC and thus makes it possible to operate the measuring devices with the Endress+Hauser ToF Tool operating program. The FXA193 service interface is connected to the interface for the local display on the electronic insert. → See also graphics on page 10.

Input

Measured variable Absolute pressure and gauge pressure, from which level (level, volume or mass) is derived

Measuring range PMC71 – with ceramic measuring diaphragm (Ceraphire®) for gauge pressure

Nominal value	Measurement limit		Span		OPL ¹	MWP ²	Vacuum resistance	Versions in the order code ³
	lower (LRL)	upper (URL)	recommended min./max.	minimum ⁴				
	[bar]	[bar]	[bar]	[bar]				
100 mbar	-0.1	+0.1	0.01/0.1	0.005	4	2.7	0.7	1C
250 mbar	-0.25	+0.25	0.017/0.25	0.005	5	3.3	0.5	1E
400 mbar	-0.4	+0.4	0.027/0.4	0.005	8	5.3	0	1F
1 bar	-1	+1	0.067/1	0.01	10	6.7	0	1H
2 bar	-1	+2	0.133/2	0.02	18	12	0	1K
4 bar	-1	+4	0.267/4	0.04	25	16.7	0	1M
10 bar	-1	+10	0.67/10	0.1	40	26.7	0	1P
40 bar	-1	+40	4/40	0.4	60	40	0	1S

PMC71 – with ceramic measuring diaphragm (Ceraphire®) for absolute pressure

Nominal value	Measurement limit		Span		OPL ¹	MWP ²	Versions in the order code ³
	lower (LRL)	upper (URL)	recommended min./max.	minimum ⁴			
	[bar _{abs}]	[bar _{abs}]	[bar]	[bar]			
100 mbar	0	+0.1	0.02/0.1	0.005	4	2	2C
250 mbar	0	+0.25	0.025/0.25	0.005	5	2.7	2E
400 mbar	0	+0.4	0.027/0.4	0.005	8	5.3	2F
1 bar	0	+1	0.067/1	0.01	10	6.7	2H
2 bar	0	+2	0.133/2	0.02	18	12	2K
4 bar	0	+4	0.267/4	0.04	25	16.7	2M
10 bar	0	+10	0.67/10	0.1	40	26.7	2P
40 bar	0	+40	4/40	0.4	60	40	2S

1) OPL: Over pressure limit (= Sensor overload limit)

2) The MWP (maximum working pressure) for the measuring device depends on the weakest element of the components selected with regard to pressure, i.e. the process connection (→ see page 34 ff) has to taken into consideration in addition to the sensor (→ see Table above). Pay attention to the pressure-temperature dependence also. For the appropriate standards and further information, see page 33, "Pressure specification".

3) Versions in the order code → See also page 71 ff, feature 40 "Sensor range; Sensor overload limit (= OPL)"

4) minimum span that can be calibrated, Turn down > 100:1 on request

PMP71 and PMP75 – with metallic measuring diaphragm for gauge pressure

Nominal value	Measurement limits		Span		OPL ¹ [bar _{rel}]	MWP ² [bar _{rel}]	Vacuum resistance ³ Silicone oil/ Inert oil [bar _{abs}]	Versions in the order code ⁴
	lower (LRL) ⁵	upper (URL)	recommended min./max.	minimum ⁵				
	[bar]	[bar]	[bar]	[bar]				
100 mbar	−0.1	+0.1	0.05/0.1	0.005	4	2.7	0.01/0.04	1C
250 mbar	−0.25	+0.25	0.1/0.25	0.005	4	2.7	0.01/0.04	1E
400 mbar	−0.4	+0.4	0.2/0.4	0.005	6	4	0.01/0.04	1F
1 bar	−1	+1	0.4/1	0.01	10	6.7	0.01/0.04	1H
2 bar	−1	+2	0.4/2	0.02	20	13.3	0.01/0.04	1K
4 bar	−1	+4	0.4/4	0.04	28	18.7	0.01/0.04	1M
10 bar	−1	+10	0.67/10	0.1	40	26.7	0.01/0.04	1P
40 bar	−1	+40	2.67/40	0.4	160	106.7	0.01/0.04	1S
100 bar	−1	+100	10/100	1.0	400	100	0.01/0.04	1U
400 bar	−1	+400	80/400	4.0	600	400	0.01/0.04	1W
700 bar ⁶	−1	+700	350/700	7.0	1050	700	0.01/0.04	1X

PMP71 and PMP75 – with metallic measuring diaphragm for absolute pressure

Nominal value	Measurement limits		Span		OPL ¹ [bar _{abs}]	MWP ² [bar _{abs}]	Vacuum resistance ³ Silicone oil/ Inert oil [bar _{abs}]	Versions in the order code ⁴
	lower (LRL)	upper (URL)	recommended min./max.	minimum ⁵				
	[bar _{abs}]	[bar _{abs}]	[bar]	[bar]				
100 mbar	0	+0.1	0.05/0.1	0.005	4	2.7	0.01/0.04	2C
250 mbar	0	+0.25	0.1/0.25	0.005	4	2.7	0.01/0.04	2E
400 mbar	0	+0.4	0.2/0.4	0.005	6	4	0.01/0.04	2F
1 bar	0	+1	0.4/1	0.01	10	6.7	0.01/0.04	2H
2 bar	0	+2	0.4/2	0.02	20	13.3	0.01/0.04	2K
4 bar	0	+4	0.4/4	0.04	28	18.7	0.01/0.04	2M
10 bar	0	+10	0.67/10	0.1	40	26.7	0.01/0.04	2P
40 bar	0	+40	2.67/40	0.4	160	106.7	0.01/0.04	2S
100 bar	0	+100	10/100	1.0	400	100	0.01/0.04	2U
400 bar	0	+400	80/400	4.0	600	400	0.01/0.04	2W
700 bar ⁶	0	+700	350/700	7.0	1050	700	0.01/0.04	2X

1) OPL: Over pressure limit (= Sensor overload limit)

2) The MWP (maximum working pressure) for the measuring device depends on the weakest element of the components selected with regard to pressure, i.e. the process connection (→ see page 34 ff) has to be taken into consideration in addition to the sensor (→ see Table above). Pay attention to the pressure-temperature dependence also. Pay attention to the pressure-temperature dependence also. For the appropriate standards and further information, see Page 33, "Pressure specification".

3) The vacuum resistance applies to the measuring cell at reference conditions. The pressure and temperature application limits of the selected filling oil must also be observed for the PMP75. → See also page 63, section "Diaphragm seal filling oils".

4) Versions in the order code → See also page 70 ff, feature 40 "Sensor range; Sensor Overload limit (= OPL)"

5) minimum span that can be calibrated, Turn down > 100:1 on request

6) PMP71 only, PMP75 on request

Explanation of terms

Explanation of terms: Turn down (TD), set span and zero based span

Case 1:

- $|\text{Upper range value}| \leq |\text{Lower range value}|$

Example:


- Lower range value = 0 bar
- Upper range value = 0.5 bar
- Nominal value (URL) = 1 bar

Turn down:

- $\text{Nominal value} / |\text{Upper range value}| = 1 \text{ bar} / 0.5 \text{ bar}$
TD = 2:1

set span:

- $\text{Upper range value} - \text{Lower range value} = 0.5 \text{ bar} - 0 \text{ bar}$
set span = 0.5 bar
This span is based on the zero point.

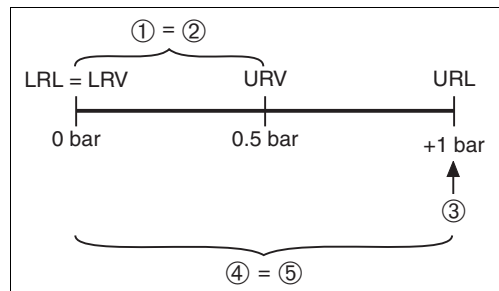

P01-PMx7xxxx-05-xx-xx-xx-012

Example: 1 bar measuring cell

Case 2:

- $|\text{Lower range value}| \leq |\text{Upper range value}|$

Example:


- Lower range value (LRV) = 0 bar
- Upper range value (URV) = -0.5 bar
- Nominal value (URL) = 1 bar

Turn down:

- $\text{Nominal value} / |\text{Lower range value (LRV)}| = 1 \text{ bar} / 0.5 \text{ bar}$
TD = 2:1

set span:

- $\text{Upper range value} - \text{Lower range value} = 0.5 \text{ bar} - 0 \text{ bar}$
set span = 0.5 bar
This span is based on the zero point.

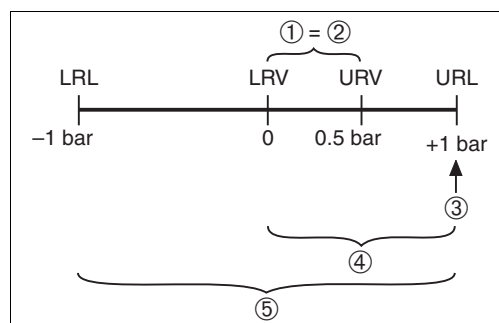

P01-PMx7xxxx-05-xx-xx-xx-007

Example: 1 bar measuring cell

Case 3:

- $|\text{Lower range value}| \geq |\text{Upper range value}|$

Example:


- Lower range value (LRV) = -0.6 bar
- Upper range value (URV) = 0 bar
- Nominal value (URL) = 1 bar

Turn down:

- $\text{Nominal value} / |\text{Lower range value (LRV)}| = 1 \text{ bar} / 0.6 \text{ bar}$
TD = 1.67:1

set span:

- $\text{Upper range value} - \text{Lower range value} = 0 \text{ bar} - (-0.6 \text{ bar})$
set span = 0.6 bar
This span is based on the zero point.

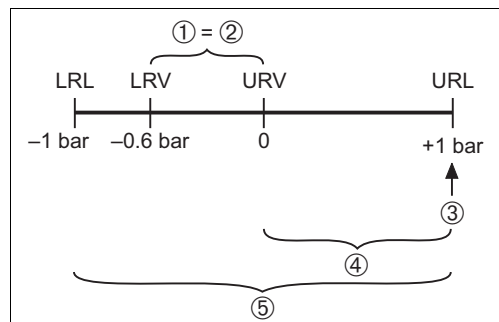

P01-PMx7xxxx-05-xx-xx-xx-008

Example: 1 bar measuring cell

- 1 Set span
 - 2 Zero based span
 - 3 Nominal value $\hat{=}$ Upper range limit (URL)
 - 4 Nominal measuring range
 - 5 Sensor measuring range
- LRL Lower range limit
URL Upper range limit
LRV Lower range value
URV Upper range value

Output

Output signal

- 4...20 mA with superimposed digital communication protocol HART 5.0, 2-wire
- Digital communication signal PROFIBUS PA (Profile 3.0)
- Digital communication signal FOUNDATION Fieldbus


Signal range – 4...20 mA HART

3.8 mA to 20.5 mA

Signal on alarm

- 4...20 mA HART
Options:
 - Max. alarm*: can be set from 21...23 mA
 - Keep measured value: last measured value is kept
 - Min. alarm: 3.6 mA
 - * Factory setting: 22 mA
- PROFIBUS PA: can be set in the Analog Input block,
options: Last Valid Out Value, Fsafe Value (factory setting), Status bad
- FOUNDATION Fieldbus: can be set,
options: Last good Value, Fail Safe Value (factory setting), Wrong Value

Load – 4...20 mA HART

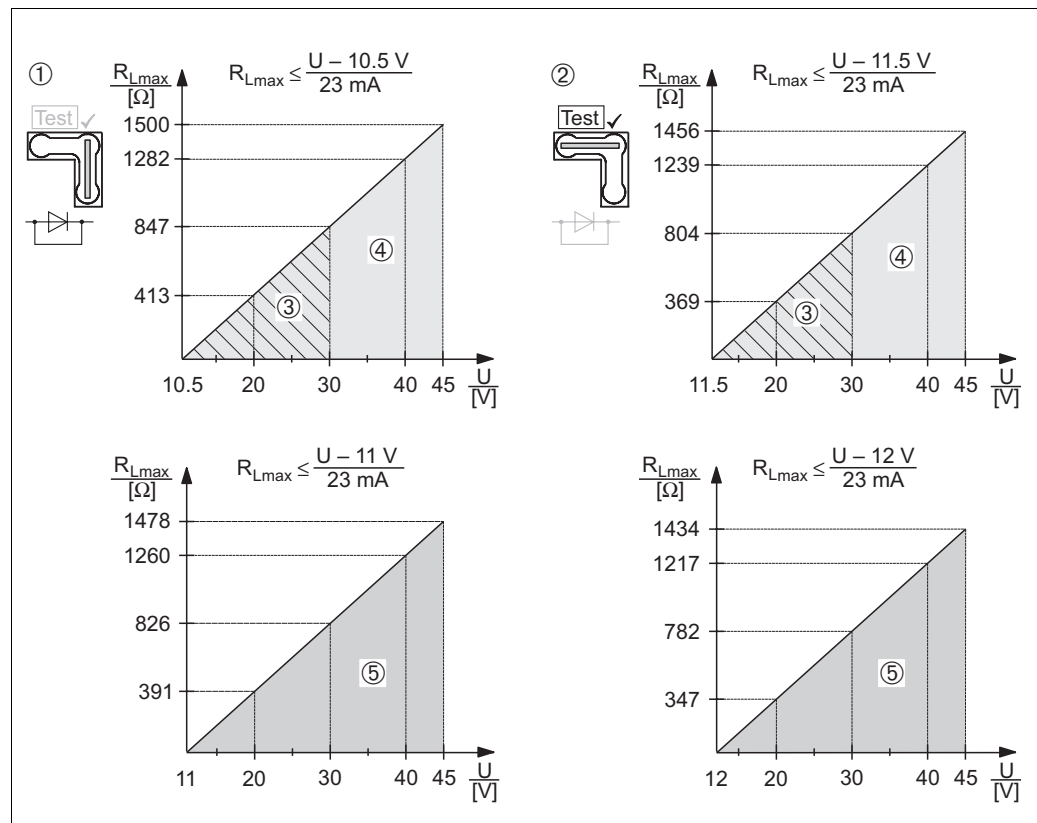

P01-PMx7xxxx-05-xx-xx-xx-003

Load diagram, observe the position of the jumper and the explosion protection. (→ See also page 20, section "Taking 4...20 mA test signal".)

- 1 Jumper for the 4...20 mA test signal inserted in "Non-test" position
 - 2 Jumper for the 4...20 mA test signal inserted in "Test" position
 - 3 Supply voltage 10.5 (11.5)...30 V DC for 1/2 G, 1 GD, 1/2 GD, FM IS, CSA IS, IECEx ia, NEPSI Ex ia and TIIS Ex ia
 - 4 Supply voltage 10.5 (11.5)...45 V DC for devices for non-hazardous areas, 1/2 D, 1/3 D, 2 G EEx d, 3 G EEx nA, FM XP, FM DIP, FM NI, CSA XP, CSA Dust-Ex, NEPSI Ex d, TIIS Ex d
 - 5 Supply voltage 11 (12)...45 V DC for PMC71, EEx d[ia], NEPSI Ex d[ia] and TIIS Ex d[ia]
- R_{Lmax} Maximum load resistance
 U Supply voltage

Note!

When operating via a handheld terminal or via PC with an operating program, a minimum communication resistance of 250 Ω must exist within the loop.


Resolution	■ Current output: 1 μA ■ Display: can be set (setting at the factory: presentation of the maximum accuracy of the transmitter)
Reading cycle	■ HART commands: on average 3 to 4 per second ■ PROFIBUS PA: – cyclic: – max.: 100/s – typical value: 20/s – acyclic: – max.: 20/s – typical value: 10/s ■ FOUNDATION Fieldbus: – cyclic: up to 5/s, dependent on the number and type of function blocks used in a closed-control loop – acyclic: 10/s
Cycle time (Update time)	PROFIBUS PA ■ The cycle time in a bus segment in cyclic data communication depends on the number of devices, on the segment coupler used and on the internal PLC cycle time. ■ The minimum cycle time is approx. 20 ms per device.
Response time	■ PROFIBUS PA: – cyclic: approx. 10 ms per request – acyclic: < 50 ms ■ FOUNDATION Fieldbus: – cyclic: < 80 ms – acyclic: < 40 ms All values are typical values.
Damping	■ Via on-site display, handheld terminal or PC with operating program, continuous from 0...999 s ■ Additionally for HART and PROFIBUS PA: via DIP-switch on the electronic insert, switch position "on" = set value and "off" ■ Factory setting: 2 s

Power supply

Electrical connection 4...20 mA HART

Note!

- When using the measuring device in hazardous areas, installation must comply with the corresponding national standards and regulations and the Safety Instructions or Installation or Control Drawings. → See also page 67 ff, sections "Safety Instructions" and "Installation/Control Drawings".
- Devices with integrated overvoltage protection must be earthed. → See also page 31.
- Protective circuits against reverse polarity, HF influences and overvoltage peaks are installed.

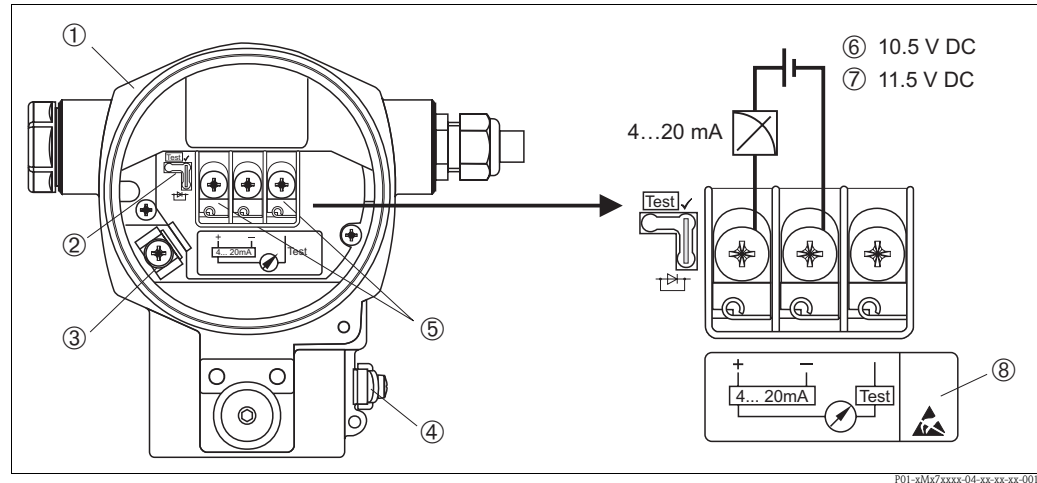

Electrical connection 4...20 mA HART

- 1 Housing
- 2 Jumper for 4...20 mA test signal
→ See also page 20, section "Taking 4...20 mA test signal".
- 3 Internal earth terminal
- 4 External earth terminal
- 5 4...20 mA test signal between plus and test terminal
- 6 Minimum supply voltage 10.5 V DC, if the jumper is inserted in accordance with the illustration.
- 7 Minimum supply voltage 11.5 V DC, if the jumper is inserted in "Test" position.
- 8 Devices with integrated overvoltage protection are labelled OVP (overvoltage protection) here (→ see also page 31).


PROFIBUS PA

The two-wire cable must be connected to the "PA+" and "PA-" terminals.

FOUNDATION Fieldbus


The two-wire cable must be connected to the "FF+" and "FF-" terminals.

Devices with Harting plug Han7D

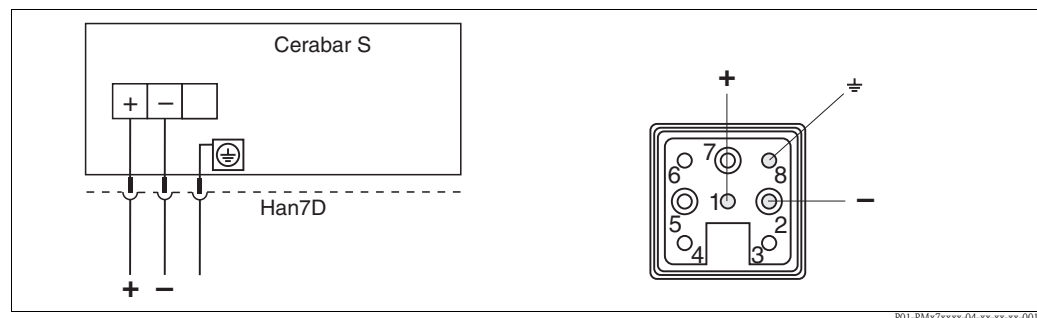

Left: electrical connection for devices with Harting plug Han7D
Right: view of the plug at the device

Devices with M12 plug

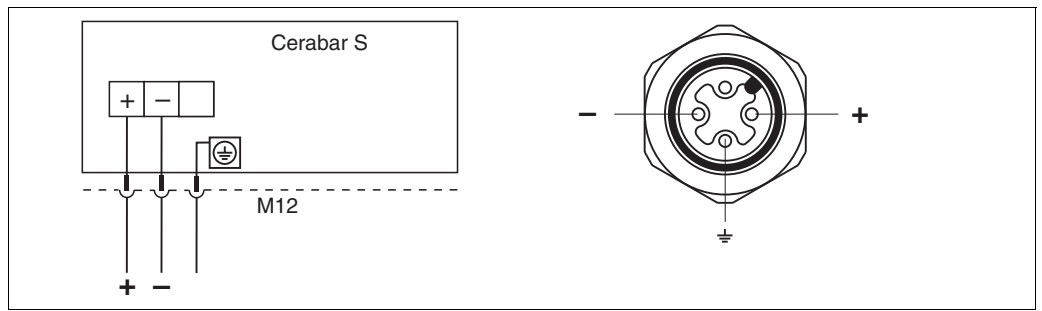

P01-PMx/xxxx-04-xx-xx-xx-000

*Left: electrical connection for devices with M12 plug
Right: view of the plug at the device*

Endress+Hauser offers for devices with M12 plug the following accessories:

Plug-in jack M 12x1, straight

- Material: Body PA; coupling nut CuZn, nickel-plated
- Degree of protection (fully locked): IP67
- Order number: 52006263


Plug-in jack M 12x1, elbowed

- Material: Body PBT/PA; coupling nut GD-Zn, nickel-plated
- Degree of protection (fully locked): IP67
- Order number: 51006327

Cable 4x0.34 mm² with M12 socket, elbowed, screw plug, 5 m length

- Material: Body PUR; coupling nut CuSn/Ni; cable PVC
- Degree of protection (fully locked): IP67
- Order number: 52010285

Devices with 7/8" plug

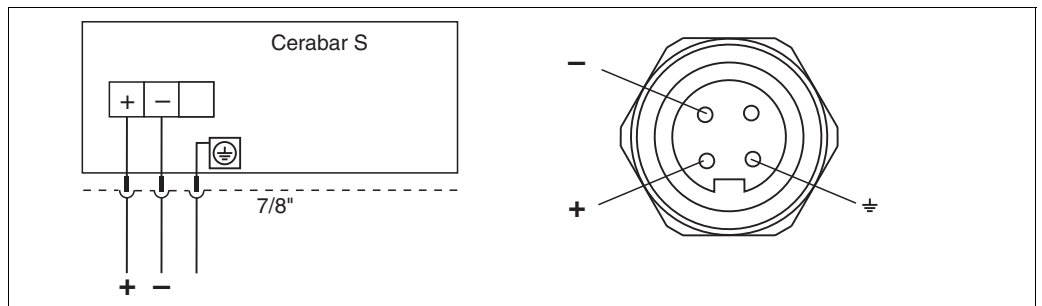

P01-PMx/xxxx-04-xx-xx-xx-003

*Left: electrical connection for devices with 7/8" plug
Right: view of the plug at the device*

Taking 4...20 mA test signal

A 4...20 mA signal may be measured via the positive and test terminal without interrupting the measurement. The minimum supply voltage of the device can be reduced by simply changing the position of the jumper. As a result, operation is also possible with lower voltage sources. Observe the position of the jumper in accordance with the following table.

Jumper position for test signal	Description
	– Taking 4...20 mA test signal via plus and test terminal: possible. (Thus, the output current can be measured without interruption via the diode.) – Delivery status – minimum supply voltage: 11.5 V DC
	– Taking 4...20 mA test signal via plus and test terminal: not possible. – minimum supply voltage: 10.5 V DC

Supply voltage

Note!

- When using the measuring device in hazardous areas, installation must comply with the corresponding national standards and regulations and the Safety Instructions or Installation or Control Drawings.
- All explosion protection data are given in separate documentation which is available upon request. The Ex documentation is supplied as standard with all devices approved for use in explosion hazardous areas. → See also page 82 ff sections "Safety Instructions" and "Installation/Control Drawings".

4...20 mA HART

- Version for non-hazardous areas, jumper for 4...20 mA test signal in "Test" position (delivery status): 11.5...45 V DC
- Version for non-hazardous areas, jumper for 4...20 mA test signal in "Non-test" position: 10.5...45 V DC

PROFIBUS PA

- Version for non-hazardous areas: 9...32 V DC

FOUNDATION Fieldbus

- Version for non-hazardous areas: 9...32 V DC

Current consumption

- PROFIBUS PA: 11 mA ± 1 mA, switch-on current corresponds to IEC 61158-2, Clause 21
- FOUNDATION Fieldbus: 14 mA ± 1 mA, switch-on current corresponds to IEC 61158-2, Clause 21

Cable entry

→ See also page 70 ff, feature 30 "Housing, Cable entry, Protection".

Cable specification

- Endress+Hauser recommends using shielded, twisted-pair two-wire cables.
- Terminals for wire cross-sections 0.5...2.5 mm²
- Cable external diameter: 5...9 mm

Residual ripple

Without influence on 4...20 mA signal up to ± 5% residual ripple within the permitted voltage range [according to HART hardware specification HCF_SPEC-54 (DIN IEC 60381-1)]

Influence of power supply

≤ 0.0006% of URL/1 V

Performance characteristics – general

Reference operating conditions	■ As per IEC 60770 ■ Ambient temperature T_U = constant, in the range of: +21...+33°C (+69.8...+91.4°F) ■ Humidity ϕ = constant, in the range of: 5...80 % r.H ■ Ambient pressure p_U = constant, in the range of: 860...1060 mbar ■ Position of the measuring cell: constant, in the range of: $\pm 1^\circ$ ■ Input of LOW SENSOR TRIM and HIGH SENSOR TRIM for lower range value and upper range value ■ Zero based span ■ Membrane material PMC71: Al_2O_3 (Aluminium oxide ceramic) ■ Membrane material PMP71 and PMP75: AISI 316L/1.4435 ■ Filling oil: silicone oil ■ Supply voltage: 24 V DC $\pm$ 3 V DC ■ Load with HART: 250 Ω
Uncertainty of measurement for small absolute pressure ranges	The smallest extended uncertainty of measurement that can be returned by our standards is: ■ 0.4% of the set span in the range of 1...30 mbar and ■ 1% of the set span in the range < 1 mbar.
Long-term stability	■ $\pm 0.05\%$ of URL/year ¹ 1) for measuring ranges ≥ 1 mbar
Influence of the installation position	■ PMC71 ¹: ≤ 0.18 mbar ■ PMP71 ^{1, 2} – Process connections thread G 1 A, G 1 1/2, G 2, 1 1/2 MNPT, 2 MNPT, M 44x1.25, EN/DIN, ANSI and JIS flanges: ≤ 10 mbar – Process connections thread: G 1/2, 1/2 MNPT, JIS G 1/2, JIS R 1/2, M20x1.5: ≤ 4 mbar 1) Device rotated 180°, process connection pointing upwards. 2) This value is doubled for devices with inert oil. Position-dependent zero shift can be corrected. → See also page 27, section "General installation instructions" and page 67 ff section "Installation instructions, Diaphragm seal systems".

Performance characteristics – ceramic diaphragm

Reference accuracy – PMC71

The reference accuracy comprises the non-linearity including hysteresis and non-reproducibility in accordance with the limit point method as per IEC 60770.

PMC71 – Gauge pressure sensors

100 mbar measuring cell:

- TD 1:1: to TD 10:1 $\pm 0.075\%$ of the set span
- TD > 10:1: $\pm 0.0075\%$ of the set span x TD

250 mbar, 400 mbar, 1 bar, 2 bar, 4 bar, 10 bar measuring cell:

- TD 1:1: to TD 15:1 $\pm 0.075\%$ of the set span
- TD > 15:1: $\pm 0.005\%$ of the set span x TD

40 bar measuring cell:

- TD 1:1 to TD 10:1: $\pm 0.075\%$ of the set span
- TD > 10:1: $\pm 0.0075\%$ of the set span x TD

Platinum version,

1 bar, 2 bar, 4 bar, 10 bar measuring cell:

- TD 1:1: $\pm 0.05\%$ of the set span

PMC71 – Absolute pressure sensors

100 mbar measuring cell:

- TD 1:1: to TD 5:1: $\pm 0.075\%$ of the set span
- TD > 5:1: $\pm 0.015\%$ of the set span x TD

250 mbar measuring cell:

- TD 1:1: to TD 10:1: $\pm 0.075\%$ of the set span
- TD > 10:1: $\pm 0.0075\%$ of the set span x TD

400 mbar, 1 bar, 2 bar, 4 bar, 10 bar measuring cell:

- TD 1:1: to TD 15:1: $\pm 0.075\%$ of the set span
- TD > 15:1: $\pm 0.005\%$ of the set span x TD

40 bar measuring cell:

- TD 1:1 to TD 10:1: $\pm 0.075\%$ of the set span
- TD > 10:1: $\pm 0.0075\%$ of the set span x TD

Platinum version,

1 bar, 2 bar, 4 bar, 10 bar measuring cell:

- TD 1:1: $\pm 0.05\%$ of the set span

Total performance – PMC71

The "Total performance" specification comprises the non-linearity including hysteresis, non-reproducibility as well as the thermal change of the zero point.

All specifications apply to the temperature range $-10...+60^{\circ}\text{C}$ ($+14...+140^{\circ}\text{F}$).

PMC71

100 mbar, 250 mbar, 400 mbar measuring cell:

- $\pm 0.2\%$ of URL

1 bar, 2 bar, 4 bar, 10 bar, 40 bar measuring cell:

- $\pm 0.15\%$ of URL

PMC71 High temperature version


all measuring cells:

- $\pm 0.46\%$ of URL

Warm-up period – PMC71

- 4...20 mA HART : < 10 s
- PROFIBUS PA: 6 s
- FOUNDATION Fieldbus: 50 s

**Dead time,
Time constant (T63) –
PMC71**

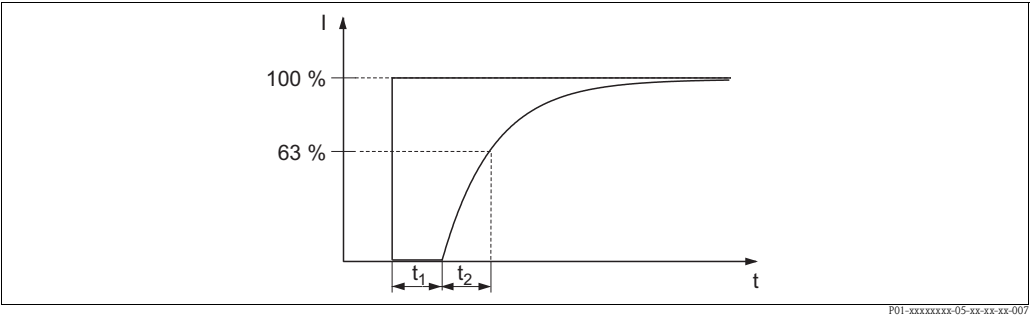

Presentation of the dead time and the time constant

Type	Dead time t_1	Time constant (T63), t_2
PMC71	90 ms	120 ms

**Thermal change of the zero
output and the output span –
PMC71**

PMC71

–10...+60°C (+14...+140 °F):

- 100 mbar, 250 mbar, 400 mbar measuring cell: $\pm(0.088 \times \text{TD} + 0.088)\%$ of the set span
- 1 bar, 2 bar, 4 bar, 10 bar, 40 bar measuring cell: $\pm(0.088 \times \text{TD} + 0.04)\%$ of the set span

–20...–10°C, +60...+125°C (–4...+14°F, +140...+257°F)

- 100 mbar, 250 mbar, 400 mbar, measuring cell: $\pm(0.138 \times \text{TD} + 0.138)\%$ of the set span
- 1 bar, 2 bar, 4 bar, 10 bar, 40 bar measuring cell: $\pm(0.175 \times \text{TD} + 0.075)\%$ of the set span

PMC71 High temperature version

–10...+60°C (+14...+140 °F):

- 100 mbar, 250 mbar, 400 mbar measuring cell: $\pm(0.088 \times \text{TD} + 0.088)\%$ of the set span
- 1 bar, 2 bar, 4 bar, 10 bar, 40 bar measuring cell: $\pm(0.088 \times \text{TD} + 0.04)\%$ of the set span

–20...–10°C, +60...+150°C (–4...+14°F, +140...+302°F):

- all measuring cells: $\pm 1.25\%$ of URL x TD

Performance characteristics – metallic diaphragm

Reference accuracy – PMP71, PMP75

The reference accuracy comprises the non-linearity including hysteresis and non-reproducibility in accordance with the limit point method as per IEC 60770.

PMP71 and PMP75

100 mbar, 400 mbar measuring cell:

- TD 1:1: to TD 2:1 $\pm 0.15\%$ of the set span

250 mbar measuring cell:

- TD 1:1: to TD 2.5:1 $\pm 0.15\%$ of the set span

400 mbar measuring cell:

- TD 1:1: $\pm 0.15\%$ of the set span
- TD > 1:1: $\pm 0.15\%$ of the set span x TD

1 bar measuring cell:

- TD 1:1 to TD 2.5:1: $\pm 0.075\%$ of the set span
- TD > 2.5:1: $\pm 0.03\%$ of the set span x TD

2 bar measuring cell:

- TD 1:1 to TD 5:1: $\pm 0.075\%$ of the set span
- TD > 5:1: $\pm 0.015\%$ of the set span x TD

4 bar measuring cell:

- TD 1:1 to TD 10:1: $\pm 0.075\%$ of the set span
- TD > 10:1: $\pm 0.0075\%$ of the set span x TD

10 bar, 40 bar measuring cell:

- TD 1:1 to TD 15:1: $\pm 0.075\%$ of the set span
- TD > 15:1: $\pm 0.005\%$ of the set span x TD

100 bar measuring cell:

- TD 1:1 to TD 10:1: $\pm 0.075\%$ of the set span
- TD > 10:1: $\pm 0.0075\%$ of the set span x TD

400 bar measuring cell:

- TD 1:1 to TD 5:1: $\pm 0.15\%$ of the set span
- TD > 5:1: $\pm 0.03\%$ of the set span x TD

700 bar measuring cell:

- TD 1:1 to TD 2:1: $\pm 0.2\%$ of the set span
- TD > 2:1: $\pm 0.1\%$ of the set span x TD

Platinum version,

2 bar, 4bar, 10 bar, 40 bar measuring cell:

- TD 1:1: $\pm 0.05\%$ of the set span

Total performance – PMP71

The "Total performance" specification comprises the non-linearity including hysteresis, non-reproducibility as well as the thermal change of the zero point.

All specifications apply to the temperature range $-10...+60^{\circ}\text{C}$ ($+14...+140^{\circ}\text{F}$).

PMP71

100 mbar measuring cell:

- $\pm 0.35\%$ of URL

250 mbar measuring cell:

- $\pm 0.3\%$ of URL

400 mbar measuring cell:

- $\pm 0.25\%$ of URL

1 bar, 2 bar, 4 bar, 10 bar, 40 bar measuring cell:

- $\pm 0.15\%$ of URL

100 bar measuring cell:

- $\pm 0.25\%$ of URL

400 bar measuring cell:

- $\pm 0.3\%$ of URL

700 bar measuring cell:

- $\pm 0.4\%$ of URL

PMP71 with Gold-Rhodium-coated membrane

400 mbar measuring cell:

- $\pm 1.25\%$ of URL

1 bar measuring cell:

- $\pm 0.75\%$ of URL

2 bar measuring cell:

- $\pm 0.45\%$ of URL

4 bar measuring cell:

- $\pm 0.3\%$ of URL

10 bar and 40 bar measuring cell:

- $\pm 0.15\%$ of URL

100 bar measuring cell:

- $\pm 0.25\%$ of URL

400 bar measuring cell:

- $\pm 0.3\%$ of URL


700 bar measuring cell:

- $\pm 0.4\%$ of URL

Warm-up period – PMP71, PMP75

- 4...20 mA HART : < 10 s
- PROFIBUS PA: 6 s
- FOUNDATION Fieldbus: 50 s

Dead time, Time constant (T63) – PMP71, PMP75

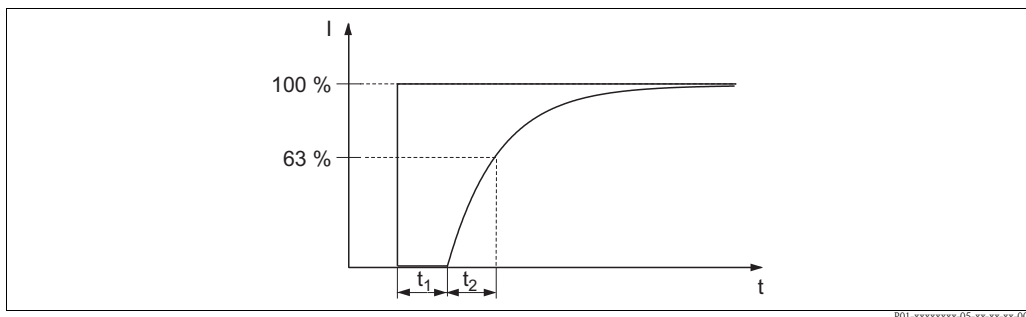

Presentation of the dead time and the time constant

Type	Dead time t_1	Time constant (T63), t_2
PMP71	45 ms	100 mbar, 250 mbar, 400 mbar measuring cell: 70 ms - measuring cells ≥ 1 bar: 35 ms
PMP75	PMP71 + influence from the diaphragm seal	

Thermal change of the zero output and the output span – PMP71

PMP71

–10...+60°C (+14...+140°F):

- 100 mbar measuring cell: $\pm(0.3 \times \text{TD} + 0.02)\%$ of the set span
- 250 mbar measuring cell: $\pm(0.25 \times \text{TD} + 0.02)\%$ of the set span
- 400 mbar measuring cell: $\pm(0.2 \times \text{TD} + 0.015)\%$ of the set span
- 1 bar, 2 bar, 4 bar, 10 bar, 40 bar measuring cell: $\pm(0.1 \times \text{TD} + 0.01)\%$ of the set span
- 100 bar measuring cell: $\pm(0.2 \times \text{TD} + 0.015)\%$ of the set span
- 400 bar measuring cell: $\pm(0.35 \times \text{TD} + 0.02)\%$ of the set span
- 700 bar measuring cell: $\pm(0.4 \times \text{TD} + 0.03)\%$ of the set span

–40...–10°C, +60...+85°C (–40...+14°F, +140...+185°F):

- 100 mbar measuring cell: $\pm(0.6 \times \text{TD} + 0.04)\%$ of the set span
- 250 mbar measuring cell: $\pm(0.5 \times \text{TD} + 0.04)\%$ of the set span
- 400 mbar measuring cell: $\pm(0.4 \times \text{TD} + 0.03)\%$ of the set span
- 1 bar, 2 bar, 4 bar, 10 bar, 40 bar measuring cell: $\pm(0.4 \times \text{TD} + 0.02)\%$ of the set span
- 100 bar measuring cell: $\pm(0.4 \times \text{TD} + 0.03)\%$ of the set span
- 400 bar measuring cell: $\pm(0.7 \times \text{TD} + 0.04)\%$ of the set span
- 700 bar measuring cell: $\pm(0.75 \times \text{TD} + 0.06)\%$ of the set span

Operating conditions (installation)

General installation instructions

- For PMP75: See page 52 ff, "Installation instructions, Diaphragm seal systems" section.
- The position-dependent zero shift can be corrected directly at the device via operating key, for devices with external operation even in hazardous areas. Diaphragm seals also shift the zero point, depending on the installation position
(→ See also page 67 ff, section "Installation instructions, Diaphragm seal systems").
- The housing of the Cerabar S can be rotated up to 380°. → See also page 29, section "Turn the housing".
- Endress+Hauser offers a mounting bracket for installing on pipes or walls. → See also page 28, section "Wall and pipe-mounting".

Installation instructions for devices without diaphragm seal – PMC71 and PMP71

Cerabar S transmitters without diaphragm seal are mounted as per the norms for a manometer (DIN EN 839-2). We recommend the use of shut-off devices and siphons. The orientation depends on the measuring application.

Pressure measurement in gases

- Mount Cerabar S with shut-off device above the tapping point so that the condensate can flow into the process.

Pressure measurement in steams

- Mount Cerabar S with siphon below the tapping point.
The siphon reduces the temperature to almost ambient temperature.
- Fill the siphon with fill fluid before commissioning.

Pressure measurement in liquids


- Mount Cerabar S with shut-off device below or at the same level as the tapping point.

Level measurement

- Mount Cerabar S below the lowest measuring point.
- Do not mount the device at the following positions:
In the fill flow, in the tank outlet or at a point in the container which could be affected by pressure pulses from the agitator.
- The calibration and functional test can be carried out more easily if you mount the device after a shut-off device.

Heat insulation – PMC71 high temperature version and PMP75

The PMC71 high temperature version and the PMP75 must only be insulated up to a certain height. The maximum permitted insulation height is labelled on the devices and applies to an insulation material with a heat conductivity $\leq 0.04 \text{ W/(m} \times \text{K)}$ and to the maximum permitted ambient and process temperature (→ see table below). The data were determined under the most critical application "quiescent air".

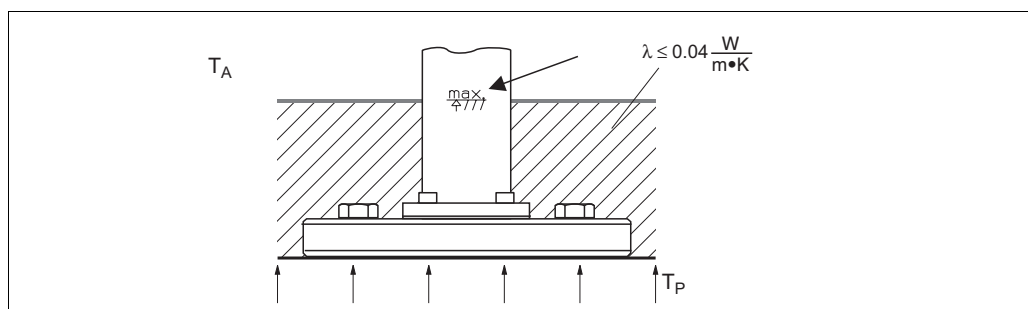

P01-PMz7xxxx-11-xx-xx-xx-010

Maximum insulation height, here e.g. PMC71 with flange

	PMC71 high temperature version	PMP75
Ambient temperature (T_A)	$\leq 70^\circ\text{C}$ (158°F)	$\leq 70^\circ\text{C}$ (158°F)
Process temperature (T_P)	$\leq 150^\circ\text{C}$ (302°F)	max. 350°C (662°F), depending on the diaphragm seal filling oil used (→ see page 63)


Mounting with temperature isolator

Endress+Hauser recommends the use of temperature isolators in the event of constant extreme fluid temperatures which lead to the maximum permissible ambient temperature of +85°C (+185°F) being exceeded.

Depending on the filling oil used, Cerabar S devices with temperature isolators can be used for maximum temperatures of up to 260°C (+500°F). → For the temperature application limits of filling oils, see page 63, "Diaphragm seal filling oil" section.

To minimise the influence of rising heat, Endress+Hauser recommends the device be mounted horizontally or with the housing pointing downwards.

The additional installation height also brings about a zero point shift of maximum 21 mbar due to the hydrostatic columns in the temperature isolator. The position-dependent zero shift can be corrected.

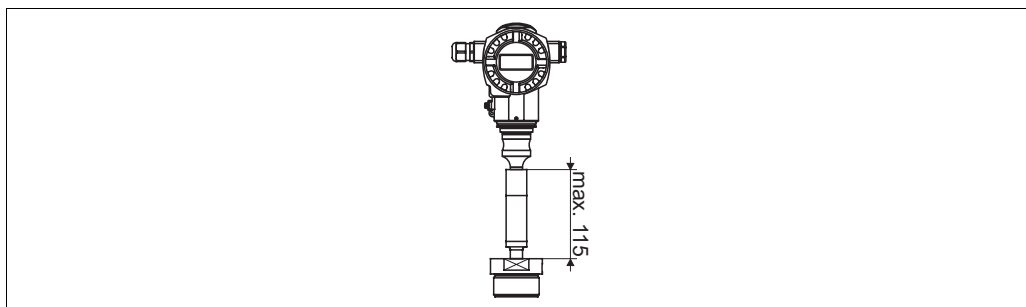


P01-PMx7xxxx-11-xx-xx-xx-005

PMP75 with temperature isolator

Wall and pipe-mounting

Endress+Hauser offers a mounting bracket for installing the device on pipes or walls. → See also page 70 ff, feature 110, "Additional options 2".

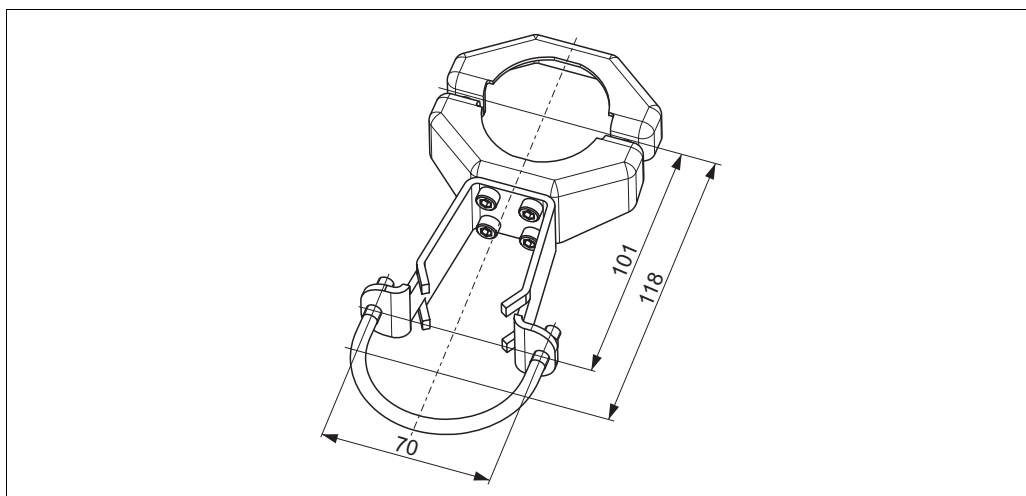


P01-PMx7xxxx-06-xx-xx-xx-001

Turn the housing

The housing can be rotated up to 380° by loosening the Allen screw.

Your benefits

- Simple mounting by optimally aligning the housing
- Good, accessible device operation
- Optimum readability of the on-site display (optional).

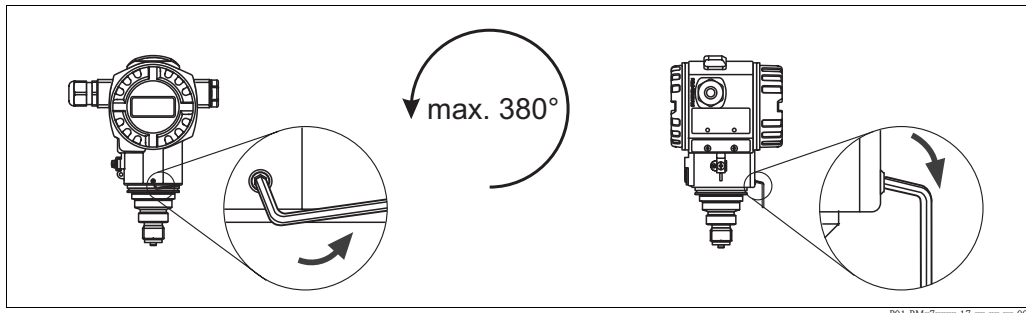

P01-PMx7xxxx-17-xx-xx-xx-000

Align the housing by loosening the Allen screw.

T14 housing: 2 mm Allen key; T17 housing: 3 mm Allen key

Oxygen applications

Oxygen and other gases can react explosively to oils, grease and plastics, such that, among other things, the following precautions must be taken:

- All components of the system, such as measuring devices, must be cleaned in accordance with the BAM (DIN 19247) requirements.
- Dependent on the materials used, a certain maximum temperature and a maximum pressure for oxygen applications must not be exceeded.

The devices suitable for gaseous oxygen applications are listed in the following table with the specification $p_{\max}$.

Order code for devices cleaned for oxygen applications	$p_{\max}$ for oxygen applications	$T_{\max}$ for oxygen applications
PMC71 – * * * * * 2 * *, Devices with sensors, nominal value < 10 bar	Overpressure limit (OPL) of sensor ^{1, 2}	60°C (140°F)
PMC71 – * * * * * 2 * *, Devices with sensors, nominal value ≥ 10 bar	30 bar	60°C (140°F)
PMP71 – * * * * * N * *	Depends on the weakest link in terms of pressure of the selected components: over pressure limit (OPL) of sensor ¹ or process connection (1.5 x PN) or filling fluid (160 bar)	85°C (185°F)
PMP75 – * * * * * N * *	Depends on the weakest link in terms of pressure of the selected components: over pressure limit (OPL) of sensor ¹ or process connection (1.5 x PN) or filling fluid (160 bar)	85°C (185°F)

1) → See page 70 ff "Ordering information", feature 40 "Sensor range; sensor overload limit (= OPL)"

2) PMC71 with PVDF thread or flange $p_{\max} = 15$ bar (225 psi)

Ultra pure gas applications	Endress+Hauser also offers the degreased device for special applications, such as ultra pure gas. No special restrictions regarding the process conditions apply to this device. → See also page 72, "Ordering information PMC71", feature 80 "Seal" or page 76, "Ordering information PMP71", feature 90 "Fill fluid".
Diaphragm seals for materials with hydrogen build-up (Gold-Rhodium coating)	With regard to materials in which hydrogen build-up takes place, hydrogen atoms can diffuse through the metal diaphragms. This can result in incorrect measurement results. Endress+Hauser offers diaphragms with Gold-Rhodium coating for this application. → See also page 75 "Ordering information PMP71" and page 79 "Ordering information PMP75", feature 60 "Membrane material" version "6".

Operating conditions (environment)

Ambient temperature limits	■ PMC71: – –20...+85°C (–4...+185°F) – High temperature version: –20...+70°C (–4...+158°F) (Version "T" for feature 100 "Additional options 1" or feature 110 "Additional options 2"), → For the maximum insulation height see page 28. ■ PMP71: –40...+85°C (–40...+185°F) devices for lower temperatures on request ■ PMP75: –40...+85°C (–40...+185°F) devices for lower temperatures on request → For the maximum insulation height see page 28. ■ On-site display: –20...+70°C (–4...+158°F) Extended temperature application range with restrictions in optical properties such as display speed and contrast: –40...+85°C (–40...+185°F) For devices for use in hazardous areas, see Safety instructions, Installation or Control Drawing. (→ See also page 82, sections "Safety Instructions" and "Installation/Control Drawings".) The device can be used in this temperature range. The values of the specification, such as thermal change, may be exceeded. → See also DIN 16086.
Storage temperature range	■ –40...+100°C (–40...+212°F) ■ On-site display: –40...+85°C (–40...+185°F)
Degree of protection	■ → See page 70 ff, feature 30 "Housing, Cable entry, Protection". ■ Degree of protection IP 68 for T17 housing: 1.83 mH₂O for 24 h
Climate class	Class 4K4H (air temperature: –20...55°C/–4...+131°F, relative humidity: 4...100%) fulfilled as per DIN EN 60721-3-4 (condensation possible) 1) With PMC71, avoid condensate in the device (avoid moisture collecting in the device).

Vibration resistance

Device/Additional option	Test standard	Vibration resistance
PMC71 ¹	GL	guaranteed for 3...25 Hz: ± 16 mm; 25...100 Hz: 4 g in all 3 planes
PMP71		
PMP75 ^{2, 3}		
with mounting bracket	IEC 61298-3	guaranteed for 10...60 Hz: ± 0.15 mm; 60...500 Hz: 2 g in all 3 planes

- 1) not for high temperature version with EEx d[ia], CSA XP or FM XP
- 2) with aluminium T14 housing only
- 3) For applications with high temperatures, either a PMP75 with a temperature isolator or a PMP75 with a capillary can be used. If vibrations also occur in the application, Endress+Hauser recommends using a PMP75 with a capillary. If a PMP75 with a temperature isolator is used, it must be mounted with a mounting bracket. (→ see also page 28).

Electromagnetic compatibility

- Interference emission as per EN 61326 electrical device B, Interference immunity as per EN 61326 appendix A (industrial use) and NAMUR EMC recommendation (NE 21).
- With increased interference immunity against electromagnetic fields as per EN 61000-4-3: 30 V/m with closed cover¹
- Maximum deviation: < 0.5% of span
- All EMC measurements were performed with a turn down (TD) = 2:1.

- 1) for devices with T14 housing

Overvoltage protection

- Overvoltage protection:
 - Nominal functioning DC voltage: 600 V
 - Nominal discharge current: 10 kA
- Surge current check $\hat{I} = 20$ kA as per DIN EN 60079-14: 8/20 μ s satisfied
- Arrester AC current check $I = 10$ A satisfied

→ See also page 73 ff, feature 100 "Additional options 1" and feature 110 "Additional options 2", version "M Overvoltage protection".

Note!

Devices with integrated overvoltage protection must be earthed.

Operating conditions (Process)

Process temperature limits

Note!

For oxygen applications, observe page 29, section "Oxygen applications".

PMC71 (with ceramic measuring diaphragm)

- $-40...+125^{\circ}\text{C}$ ($-40...+257^{\circ}\text{F}$)
- High temperature version: $-20...+150^{\circ}\text{C}$ ($-4...+302^{\circ}\text{F}$)
→ See also page 73, feature 100 "Additional options 1", Version "T".
- Observe the temperature operating range of the seal. See also the following section "Temperature operating range, seals".

Extreme jumps in temperature can result in temporary measuring errors. Temperature compensation takes effect after several minutes. Internal temperature compensation is faster the smaller the temperature jump and the longer the time interval.

PMP71 (with metallic measuring diaphragm)

Description	Temperature operating range
Process connections with internal diaphragm	$-40...+125^{\circ}\text{C}$ ($-40...+257^{\circ}\text{F}$)
Process connections with flush-mounted diaphragm, G 1 A, G 1 1/2 A, G 2 A, 1 NPT, 1 1/2 NPT, 2 NPT, M 44 x 1.25, EN/DIN, ANSI and JIS flanges	$-40...+100^{\circ}\text{C}$ ($-40...+212^{\circ}\text{F}$)
Process connections with flush-mounted diaphragm, G 1/2 A, M 20	$-20...+85^{\circ}\text{C}$ ($-4...+185^{\circ}\text{F}$)

PMP75 (with metallic measuring diaphragm)

- depending on the diaphragm seal and filling oil up to $+350^{\circ}\text{C}$ ($+662^{\circ}\text{F}$)
Observe the temperature application limits of the diaphragm seal oil. → See also page 63, section "Diaphragm seal filling oils".

Temperature operating range, seals

PMC71 (with ceramic measuring diaphragm)

Version for feature 80 in the order code	Seal	Temperature operating range
A	FKM Viton	$-20...+125^{\circ}\text{C}/150^{\circ}\text{C}^1$ ($-4...+257^{\circ}\text{F}/302^{\circ}\text{F}$)
B ²	EPDM (FDA 21CFR177.2600; 3A Class I; USP Class VI)	$-20...+125^{\circ}\text{C}$ ($-4...+257^{\circ}\text{F}$)
B	EPDM	$-20...+125^{\circ}\text{C}$ ($-4...+257^{\circ}\text{F}$)
D	Kalrez, Compound 4079	$+5...+125^{\circ}\text{C}/150^{\circ}\text{C}^1$ ($+41...+257^{\circ}\text{F}/302^{\circ}\text{F}$)
E	Chemraz, Compound 505	$-10...+125^{\circ}\text{C}/150^{\circ}\text{C}^1$ ($14...+257^{\circ}\text{F}/302^{\circ}\text{F}$)
F ^{2,3}	HNBR (FDA 21CFR177.2600; 3A Class II; KTW; AFNOR; BAM; USP Class VI)	$-20...+125^{\circ}\text{C}$ ($-4...+257^{\circ}\text{F}$)
F ³	NBR	$-20...+100^{\circ}\text{C}$ ($-4...+212^{\circ}\text{F}$)
1	FKM Viton, degreased	$-10...+125^{\circ}\text{C}$ ($+14...+257^{\circ}\text{F}$)
2	FKM Viton, cleaned for oxygen service	$-10...+60^{\circ}\text{C}$ ($+14...+140^{\circ}\text{F}$)

- 1) $+150^{\circ}\text{C}$ ($+302^{\circ}\text{F}$): for high temperature version
→ See also page 73, feature 100 "Additional options 1" and feature 110 "Additional options 2", Version "T".
- 2) These seals are used for devices with 3A-approved process connections.
- 3) For devices with NBR or HNBR seals, the values for "Toatal Performance" (→ see page 22) and "Thermal change" (→ see page 23) must be multiplied by the factor 3.

Pressure specifications

- The MWP (maximum working pressure) is specified on the nameplate. The maximum pressure for the measuring device is dependent on the lowest-rated element with regard to pressure, see the following sections for this:

- → page 13 ff, section "Measuring range"
- → chapter "Mechanical construction".


The MWP (maximum working pressure) is specified on the nameplate. This value refers to a reference temperature of 20°C (68°F) or 100°F for ANSI flanges. Observe pressure-temperature dependency.

- The pressure values permitted at higher temperatures can be found in the following standards:
 - EN 1092-1: 2001 Tab. 18 ¹
 - ASME B 16.5a – 1998 Tab. 2-2.2 F316
 - ASME B 16.5a – 1998 Tab. 2.3.8 N10276
 - JIS B2238/2210
- The test pressure corresponds to the over pressure limit (OPL) of the device = $MWP \times 1.5$ ².
- The Pressure Equipment Directive (EC Directive 97/23/EC) uses the abbreviation "PS". The abbreviation "PS" corresponds to the MWP (maximum working pressure) of the measuring device.
- In the case of sensor range and process connections where the OPL (Over pressure limit) of the pressure connection is smaller than the nominal value of the sensor, the device is set at the factory, at the very maximum, to the OPL value of the process connection. If you want to use the entire sensor range, select a process connection with a higher OPL value ($1.5 \times PN$; $PN = MWP$).
- In oxygen applications, the values for " p_{max} and T_{max} for oxygen applications" as per page 30, "Oxygen applications" may not be exceeded.

- 1) With regard to its stability property, the material 1.4435 is identical to 1.4404 which is grouped under 13EO in EN 1092-1 Tab. 18. the chemical composition of the two materials can be identical.
- 2) The equation does not apply for PMP71 and PMP75 with a 100 bar measuring cell.

Mechanical construction

Housing dimensions T14

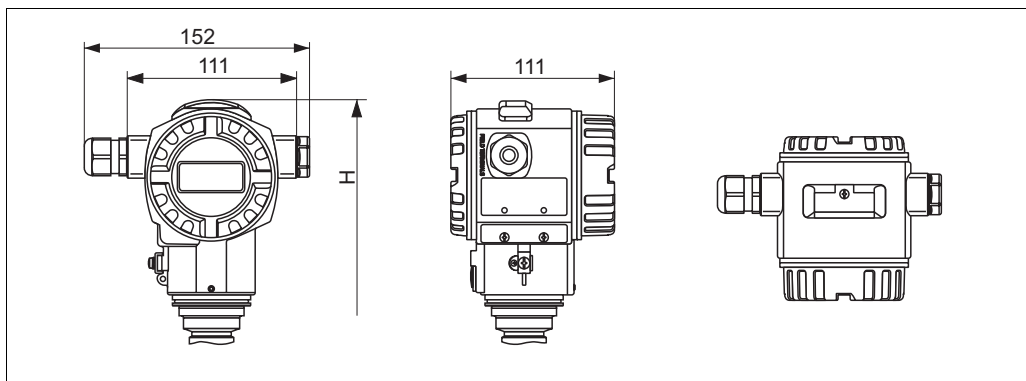


P01-PMx7xxx-06-00-xx-xx-000

Front view, left-hand side view, top view

→ See the process connection in question for installation height. Housing weight see page 61.


Housing dimensions T17

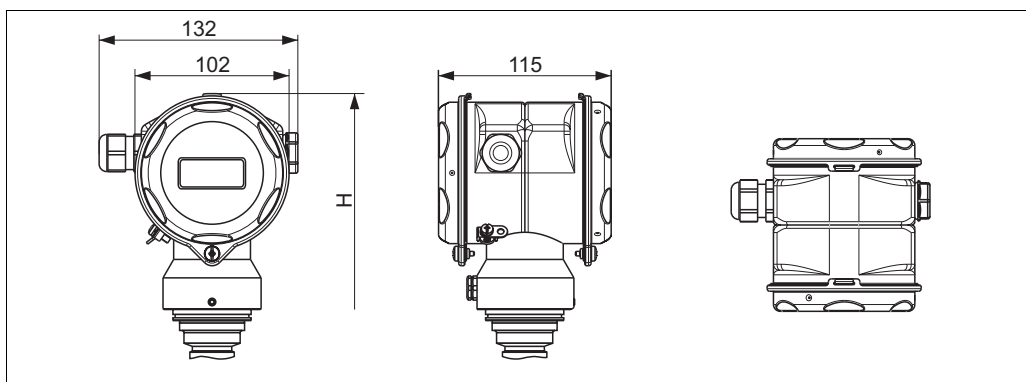

P01-PMx7xxxx-06-00-xx-xx-001

Front view, left-hand side view, top view


→ See the process connection in question for installation height. Housing weight see page 61.

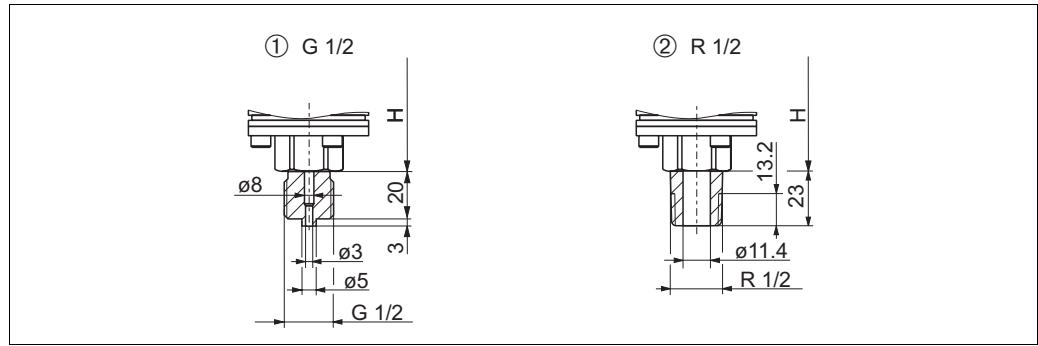

Process connections PMC71, thread JIS

→ Installation height see page 36.

- 1 Version GL: thread JIS B0202 G 1/2 (male), material: AISI 316L/1.4435
2 Version RL: thread JIS B0203 R 1/2 (male), material: AISI 316L/1.4435

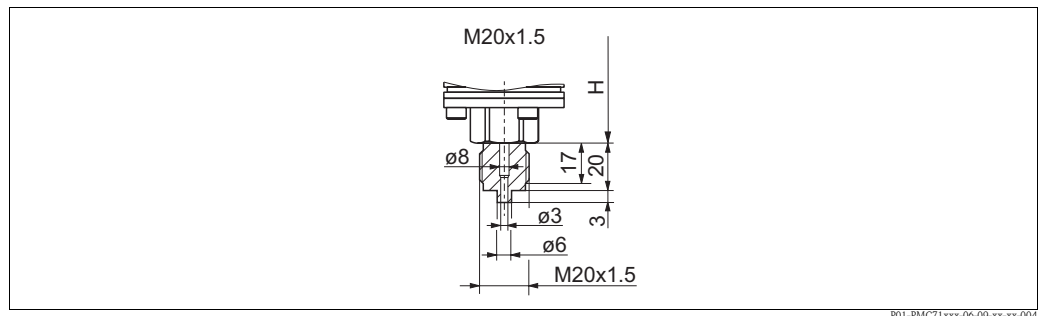

Process connections PMC71 thread DIN 13 M 20x1.5 hole 3 mm

Material version GP: AISI 316L/1.4435, version GQ: Alloy C276/2.4819


→ Installation height see page 36.

Installation height H for devices with thread connection and internal diaphragm

Description	Housing T14	Housing T17
PMC71	155 mm	171 mm
PMC71 with EEx d[ia], CSA XP or FM XP	236 mm	252 mm
PMC71 High temperature version ¹	235 mm	251 mm
PMC 71 High temperature version ¹ with EEx d[ia], CSA XP or FM XP	300 mm	316 mm

- 1) High temperature version, see also page 73, feature 100 "Additional options 1" and feature 110 "Additional options 2", versions "T"

Thread, flush-mounted diaphragm

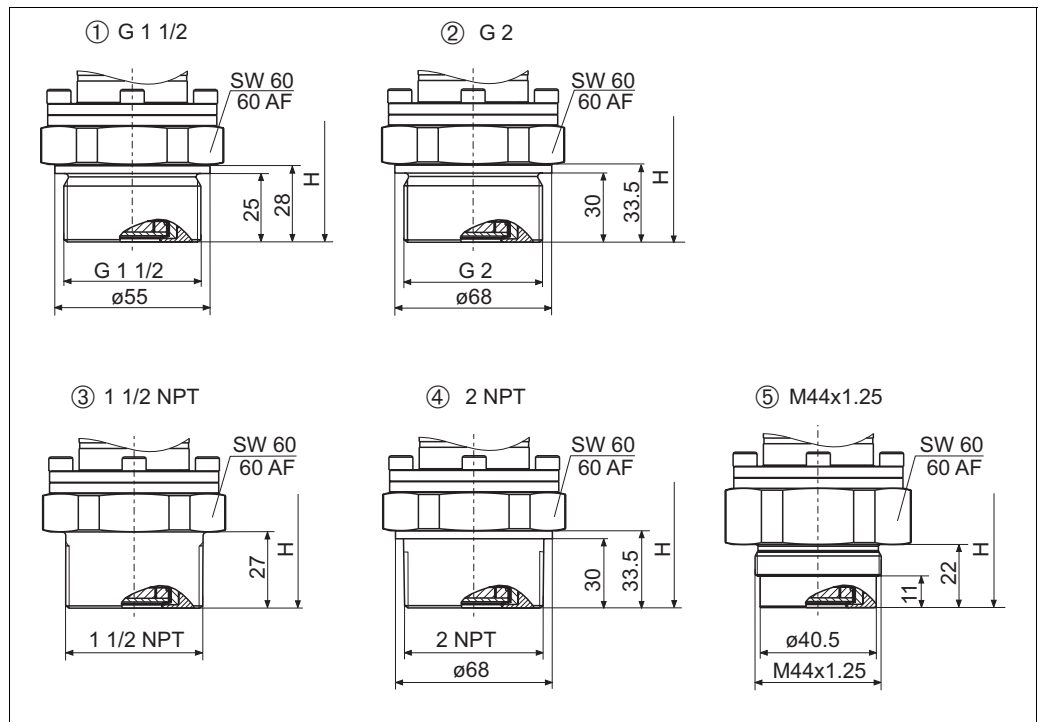

Process connections PMC71,


→ Installation height see table below.

- 1 Thread ISO 228 G 1 1/2 A;
Material version 1G: AISI 316L/1.4435, version 1H: Alloy C276/2.4819, version 1J: Monel
- 2 Thread ISO 228 G 2 A;
Material version 1K: AISI 316L/1.4435, version 1L: Alloy C276/2.4819, version 1M: Monel
- 3 Thread ANSI 1 1/2 MNPT;
Material version 2D: AISI 316L/1.4435, version 2E: Alloy C276/2.4819, version 2F: Monel
- 4 Thread ANSI 2 MNPT;
Material version 2G: AISI 316L/1.4435, version 2H: Alloy C276/2.4819, version 2J: Monel
- 5 Thread DIN 13 M 44x1.25;
Material version 1R: AISI 316L/1.4435, version 1S: Alloy C276/2.4819

Installation height H for devices with thread connection and flush-mounted diaphragm

Description	Housing T14	Housing T17
PMC71	215 mm	231 mm
PMC71 with EEx d[ia], CSA XP or FM XP	280 mm	296 mm

EN/DIN flanges, connection dimensions as per EN 1092-1/DIN 2527

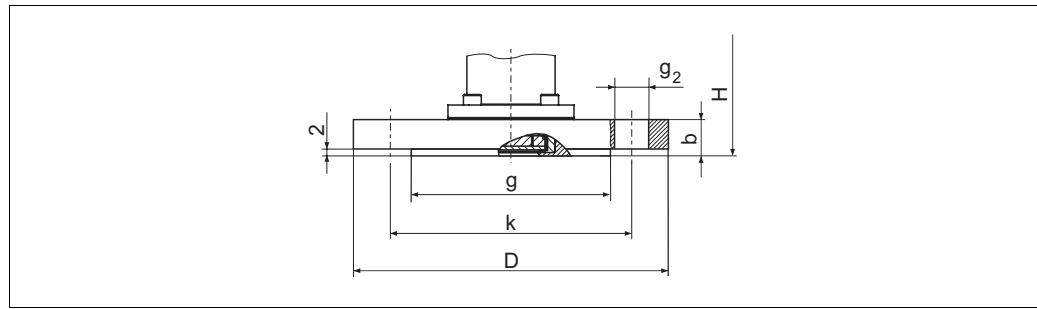


P01-PMC71xxx-06-09-xx-xx-006

Process connection PMC71, EN/DIN flange with raised face (flush-mounted diaphragm)
 → Installation height see page 40.

Version	Flange							Boltholes			
	Material	Nominal diameter	Nominal pressure	Shape ¹	Diameter	Thick-ness	Raised face	Quantity	Diameter	Hole circle	Flange weight ²
					D [mm]	b [mm]	g [mm]		g ₂ [mm]	k [mm]	[kg]
CP	AISI 316L ³	DN 32	PN 10-40	B1 (D)	140	18	77	4	18	100	1.9
CQ	AISI 316L ³	DN 40	PN 10-40	B1 (D)	150	18	87	4	18	110	2.2
BR	PVDF ⁴	DN 50	PN 10-16	B1 (D)	165	21.4	102	4	18	125	0.6
B3	AISI 316L ³	DN 50	PN 10-40	B1 (D)	165	20	102	4	18	125	3.0
C3	AISI 316L ³	DN 50	PN 63	B2 (D)	180	26	108	4	22	135	4.6
BS	PVDF ⁴	DN 80	PN 10/16	B1 (D)	200	21.4	138	8	18	160	1.0
B4	AISI 316L ³	DN 80	PN 10-40	B1 (D)	200	24	138	8	18	160	5.4

- 1) Designation in brackets as per DIN 2527
- 2) Housing weight see page 61
- 3) AISI 316L/1.4435
- 4) Max.: 15 bar (225 psi), max.: -10...+60°C (+14...+140°F)

ANSI flange, connection dimensions as per ANSI B 16.5, raised face RF

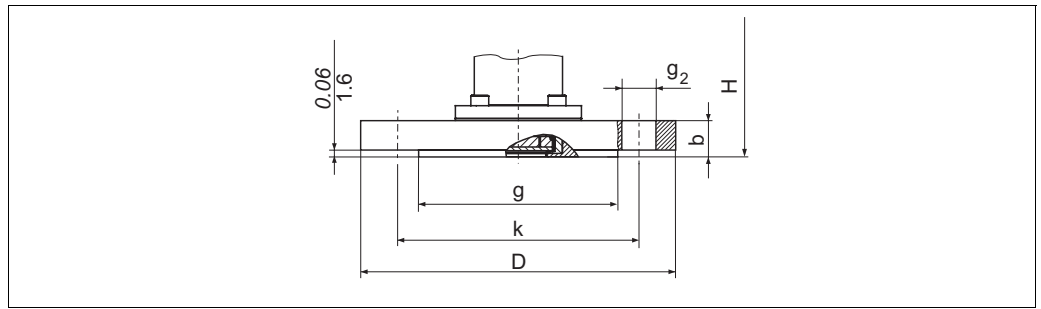


P01-PMC71.xxx-06-09-xx-xx-007

Process connection PMC71, ANSI flange with raised face (flush-mounted diaphragm)
→ Installation height see page 40.

Version	Flange						Boltholes			Flange weight ¹
	Material	Nominal diameter	Class	Diameter	Thickness	Raised face	Quantity	Diameter	Hole circle	
		[in]	[lb./sq.in]	D [in] [mm]	b [in] [mm]	g [in] [mm]		g ₂ [in] [mm]	k [in] [mm]	[kg]
AE	AISI 316/ 316L ²	1 1/2	150	5 127	0.69 17.5	2.88 73.2	4	0.62 15.7	3.88 98.6	1.0
AQ	AISI 316/ 316L ²	1 1/2	300	6.12 155.4	0.81 20.6	2.88 73.2	4	0.88 22.4	4.5 114.3	2.6
AF	AISI 316/ 316L ²	2	150	6 152.4	0.75 19.1	3.62 91.9	4	0.75 19.1	4.75 120.7	2.4
JR	ECTFE ³	2	150	6 152.4	0.75 19.1	3.62 91.9	4	0.75 19.1	4.75 120.7	2.4
A3	PVDF ⁴	2	150	6 152.4	0.75 19.1	3.62 91.9	4	0.75 19.1	4.75 120.7	0.5
AR	AISI 316/ 316L ²	2	300	6.5 165.1	0.88 22.4	3.62 91.9	8	0.75 19.1	5 127	3.2
AG	AISI 316/ 316L ²	3	150	7.5 190.5	0.94 23.9	5 127	4	0.75 19.1	6 152.4	4.9
JS	ECTFE ³	3	150	7.5 190.5	0.94 23.9	5 127	4	0.75 19.1	6 152.4	4.9
A4	PVDF ⁴	3	150	7.5 190.5	0.94 23.9	5 127	4	0.75 19.1	6 152.4	0.9
AS	AISI 316/ 316L ²	3	300	8.25 209.5	1.12 28.4	5 127	8	0.88 22.4	6.62 168.1	6.8
AH	AISI 316/ 316L ²	4	150	9 228.6	0.94 23.9	6.19 157.2	8	0.75 19.1	7.5 190.5	7.1
JT	ECTFE ³	4	150	9 228.6	0.94 23.9	6.19 157.2	8	0.75 19.1	7.5 190.5	7.1
AT	AISI 316/ 316L ²	4	300	10 254	1.25 31.8	6.19 157.2	8	0.88 22.4	7.88 200.2	11.6

- Housing weight see page 61
- Combination of AISI 316 for required pressure resistance and AISI 316L for required chemical resistance (dual rated)
- ECTFE coating on AISI 316L/1.4435
When operating in hazardous area, avoid electrostatic charge of the plastic surface.
- max.: 15 bar (225 psi), max.: -10...+60°C (+14...+140°F)

JIS flange, connection dimensions as per JIS B 2220, raised face RF

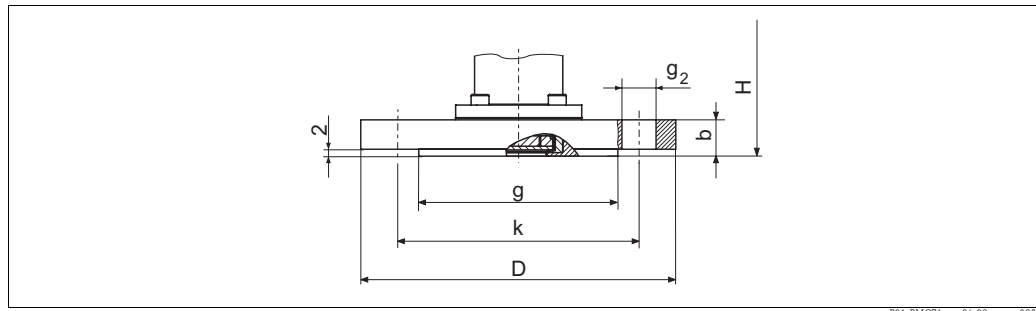

P01-PMC71xxx-06-09-xx-xx-008

Process connection PMC71, JIS flange with raised face RF (flush-mounted diaphragm), AISI 316L/1.4435
 → Installation height see table below.

	Flange					Boltholes			
Versions	Nominal dimension	Nominal pressure	Diameter	Thickness	Raised face	Quantity	Diameter	Hole circle	Flange weight ¹
			D	b	g		g ₂	k	
			[mm]	[mm]	[mm]		[mm]	[mm]	
KF	50 A	10 K	155	16	96	4	19	120	2.0
KL	80 A	10 K	185	18	127	8	19	150	3.3
KH	100 A	10 K	210	18	151	8	19	175	4.4

1) Housing weight see page 61


Installation height H for devices with flange

Description	T14 housing	T17 housing
PMC71	215 mm	231 mm
PMC71 with EEx d[ia], CSA XP or FM XP	280 mm	296 mm

Hygienic connections, flush-mounted diaphragm

Note!

Many process connections with an EPDM or HNBR seal are 3A-approved for PMC71. This means that a 3A-approved process connection with an EPDM or HNBR seal must be selected when ordering for the 3A approval for the PMC71 version to be valid. → For ordering information on EPDM or HNBR seals, see page 72 "Ordering information PMC71", feature 80 "Sensor seal", version B or F.

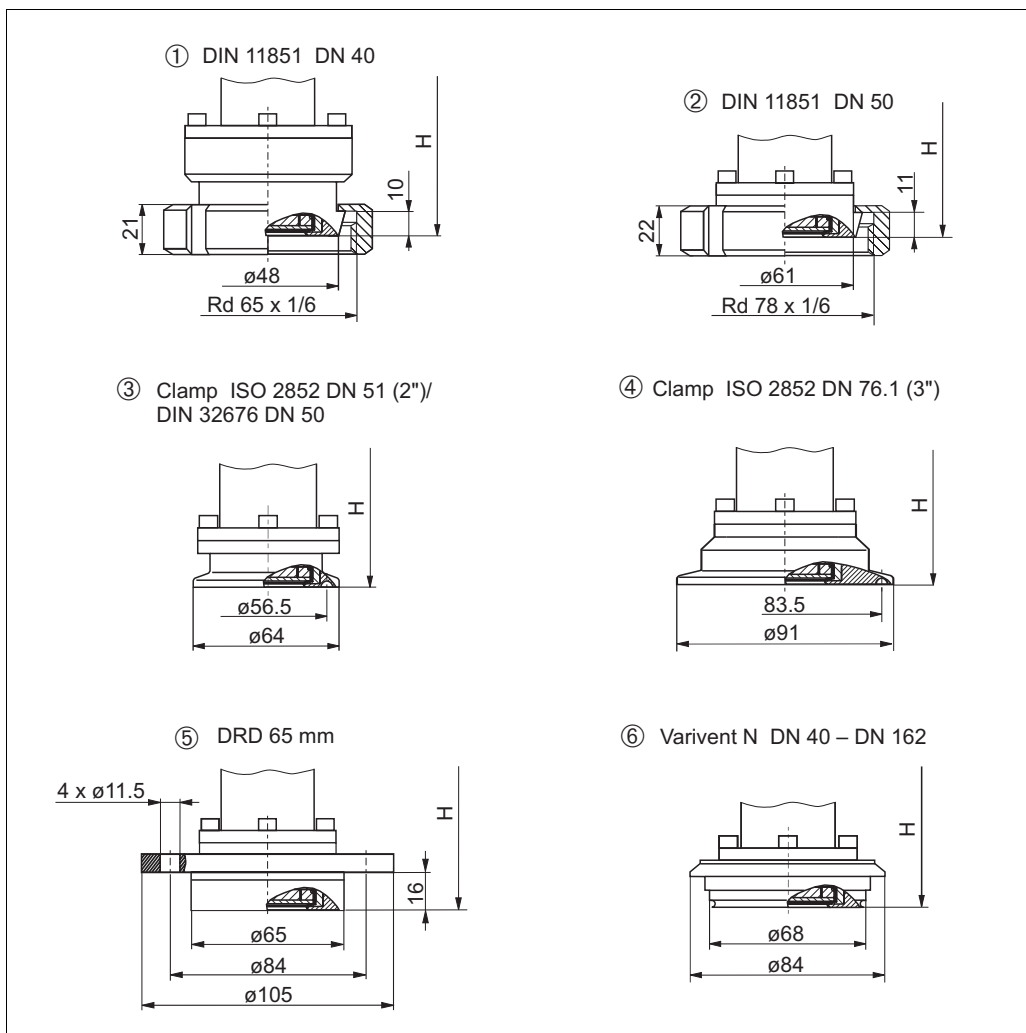

P01-PMC71xxx-06-09-xxx-xx-011

Process connections PMC71, Hygienic connections, material AISI 316L/1.4435

surface roughness of the surfaces in contact with the medium $\leq 0.8 \mu\text{m}$ as standard. Lower surface roughness on request.

- 1 Version MP: DIN 11851 DN 40 PN 25, 3A with HNBR or EPDM seal
- 2 Version MR: DIN 11851 DN 50 PN 25, 3A with HNBR or EPDM seal
- 3 Version TD: Tri-Clamp ISO 2852 (2"), DIN 32675 DN 50, 3A with HNBR or EPDM seal
- 4 Version TF: Tri-Clamp ISO 2852 (3"), 3A with HNBR or EPDM seal
- 5 Version TK: DRD 65 mm PN 25, 3A with HNBR or EPDM seal
- 6 Version TR: Varivent Type N for pipes 40 – 162, PN 40, 3A with HNBR or EPDM seal

Installation height H for devices with hygienic connection and flush-mounted diaphragm


Description	T14 housing	T17 housing
PMC71	215 mm	231 mm
PMC71 with EEx d[ia], CSA XP or FM XP	280 mm	296 mm

Process connections PMP71 (with metallic measuring diaphragm)

Note!

Some device versions have CRN approval. For a CRN-approved device, a CRN-approved process connection (→ see page 71, feature 70 "Process connection") has to be ordered with a CSA approval (→ see page 70, feature 10 "Approval"). These devices are fitted with a separate plate bearing the registration number 0F10525.5C.

Thread, internal diaphragm

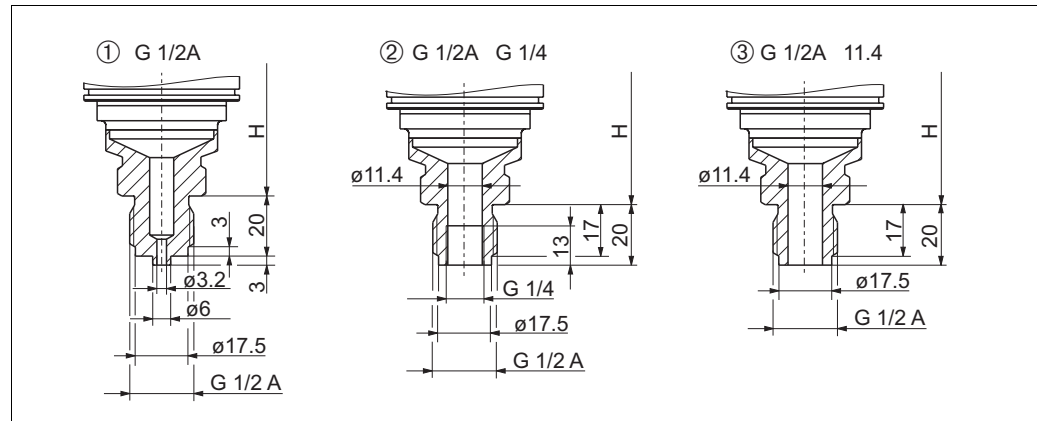


P01-PMP71xxx-06-09-xx-xx-000

Process connections PMP71, thread ISO 228

→ Installation height *H* see page 43.

- 1 Thread ISO 228 G 1/2 A EN 837;
Material version GA: AISI 316L/1.4435, version GB: Alloy C276/2.4819
- 2 Thread ISO 228 G 1/2 A G 1/4 (female);
Material version GE: AISI 316L/1.4435, version GF: Alloy C276/2.4819
- 3 Thread ISO 228 G 1/2 A hole 11.4 mm;
Material version GH: AISI 316L/1.4435, version GJ: Alloy C276/2.4819

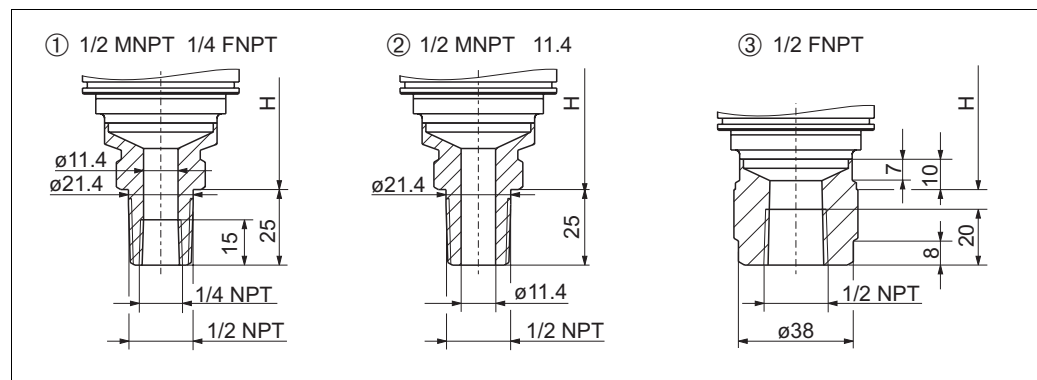


P01-PMP71xxx-06-09-xx-xx-001

Process connections PMP71, thread ANSI


→ Installation height see page 43.

- 1 Thread ANSI 1/2 MNPT 1/4 FNPT;
Material version RA: AISI 316L/1.4435, version RB: Alloy C276/2.4819
- 2 Thread ANSI 1/2 MNPT hole 11.4;
Material version RD: AISI 316L/1.4435, version RE: Alloy C276/2.4819
- 3 Thread ANSI 1/2 FNPT;
Material version RH: AISI 316L/1.4435, version RJ: Alloy C276/2.4819

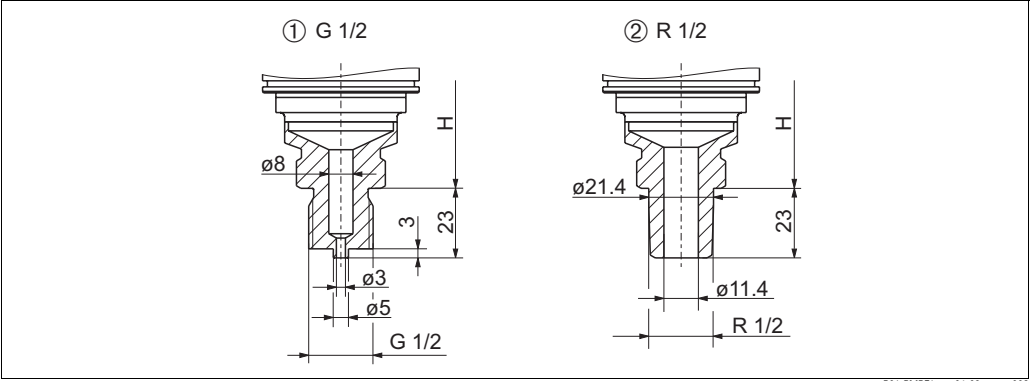

Process connections PMP71, thread JIS
→ Installation height H see table, below.


- 1 Version GL: thread JIS B0202 G 1/2 (male), material: AISI 316L/1.4435
- 2 Version RL: thread JIS B0203 R 1/2 (male), material: AISI 316L/1.4435

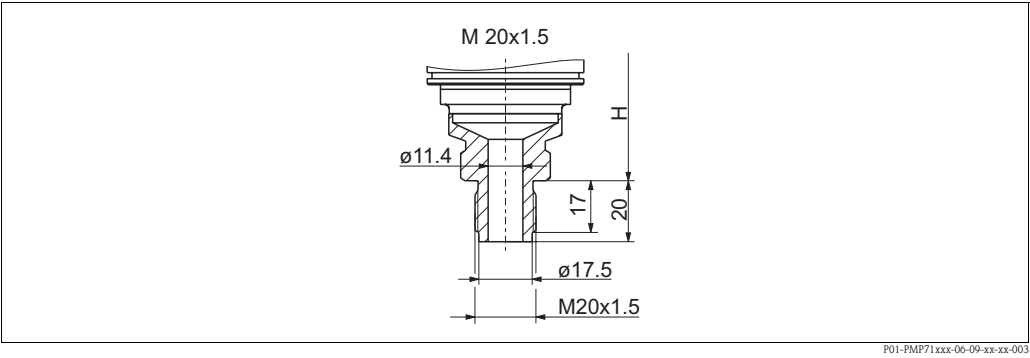

Process connections PMP71 thread DIN 13 M 20x1.5 hole 11.4 mm
Material version GP: AISI 316L/1.4435, version GQ: Alloy C276/2.4819
→ Installation height H see table, below.

	T14 housing	T17 housing
Height H	165 mm	181 mm

Thread, flush-mounted diaphragm

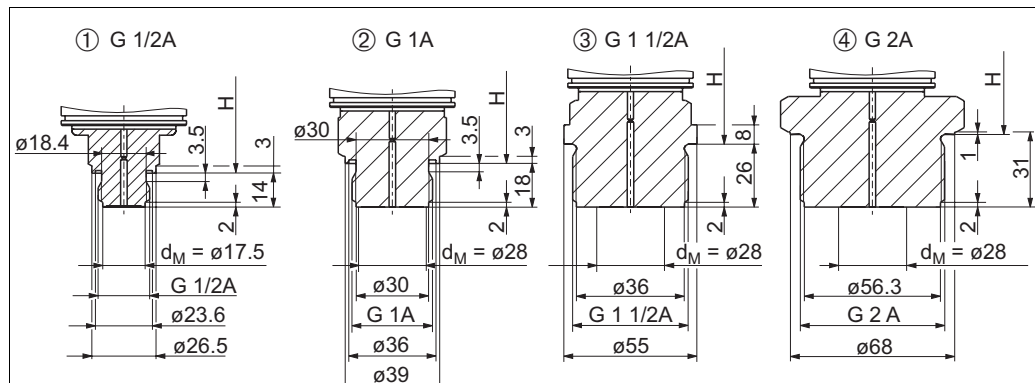


P01-PMP71xxx-06-09-xx-xx-004

Process connections PMP71, thread ISO 228

→ Installation height see page 45.

- 1 Thread ISO 228 G 1/2 A DIN 3852;
Material version 1A: AISI 316L/1.4435, version 1B: Alloy C276/2.4819
- 2 Thread ISO 228 G 1 A;
Material version 1D: AISI 316L/1.4435, version 1E: Alloy C276/2.4819
- 3 Thread ISO 228 G 1 1/2 A;
Material version 1G: AISI 316L/1.4435, version 1H: Alloy C276/2.4819
- 4 Thread ISO 228 G 2 A;
Material version 1K: AISI 316L/1.4435, version 1L: Alloy C276/2.4819

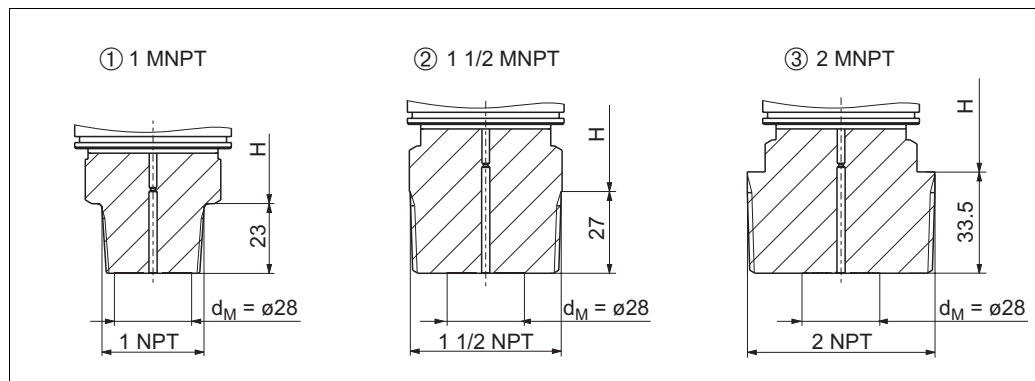


P=1-PMP71xxx-06-09-xx-xx-005

Process connections PMP71, thread ANSI

→ Installation height see page 45.

- 1 Thread ANSI 1 MNPT;
Material version 2A: AISI 316L/1.4435, version 2B: Alloy C276/2.4819
- 2 Thread ANSI 1 1/2 MNPT;
Material version 2D: AISI 316L/1.4435, version 2E: Alloy C276/2.4819
- 3 Thread ANSI 2 MNPT;
Material version 2G: AISI 316L/1.4435, version 2H: Alloy C276/2.4819

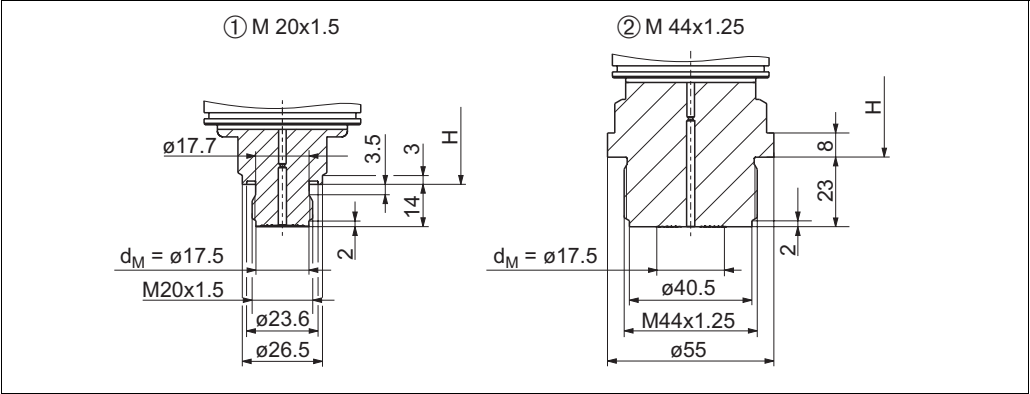

P01-PMP71xxx-06-09-xx-xx-006

Process connections PMP71, thread DIN


→ Installation height see table, below.

- 1 Thread DIN 16288 M20;
Material version 1N: AISI 316L/1.4435, version 1P: Alloy C276/2.4819
- 2 Thread DIN 13 M 44 x 1.25;
Material version 1R: AISI 316L/1.4435, version 1S: Alloy C276/2.4819

Installation height H for devices with thread connection and flush-mounted diaphragm

Description	Housing T14	Housing T17
G 1/2	163 mm	179 mm
G 1	167 mm	183 mm
G 1 1/2 A	163 mm	179 mm
G 2 A	162 mm	178 mm
1 MNPT	162 mm	178 mm
1 1/2 MNPT	165 mm	181 mm
2 MNPT	159 mm	175 mm
M 20x1.5	163 mm	179 mm
M 44x1.25	170 mm	186 mm

EN/DIN flanges, connection dimensions as per EN 1092-1/DIN 2527

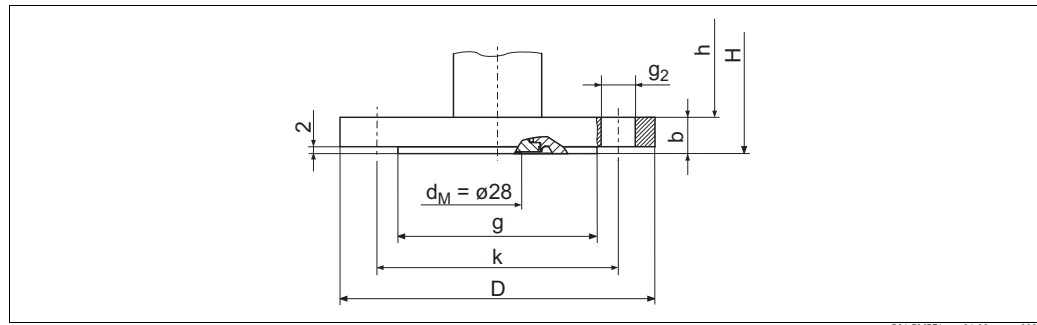

P01-PMP71xxx-06-09-xx-xx-008

Process connection PMP71, EN/DIN flange with raised face, material AISI 316L/1.4435


H: device height = height of device without flange + flange thickness b
 → Height h see page 48.

Version	Flange						Boltholes			
	Nominal diameter	Nominal pressure	Shape ¹	Diameter	Thickness	Raised face	Quantity	Diameter	Hole circle	Flange weight ²
				D [mm]	b [mm]	g [mm]		g ₂ [mm]	k [mm]	[kg]
CN	DN 25	PN 10-40	B1 (D)	115	18	66	4	14	85	1.2
CP	DN 32	PN 10-40	B1 (D)	140	18	77	4	18	100	1.9
CQ	DN 40	PN 10-40	B1 (D)	150	18	87	4	18	110	2.2
B3	DN 50	PN 10-40	B1 (D)	165	20	102	4	18	125	3.0
B4	DN 80	PN 10-40	B1 (D)	200	24	138	8	18	160	5.3

1) Designation as per DIN 2527 in brackets

2) Housing weight see page 61

ANSI flanges, connection dimensions as per ANSI B 16.5, raised face RF
JIS flanges, connection dimensions as per B 2220, Raised face RF

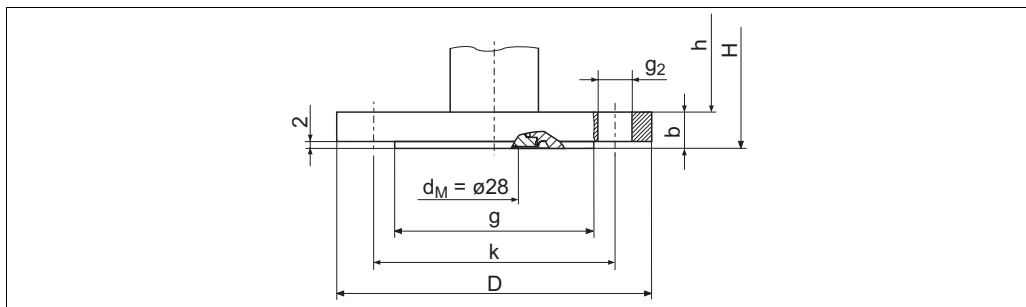

P01-PMP71xxx-06-09-xx-xx-009

Process connection PMP71, ANSI flange or JIS flange with raised face RF; material

H: device height = height of device without flange + flange thickness b

For the height h see page 48.

	Flange							Boltholes			
Version	Material	Nominal diameter	Class/ Nominal pressure	Diameter	Thickness	Diameter raised face	Height raised face	Quantity	Diameter	Hole circle	Flange weight ¹
				D [in] [mm]	b [in] [mm]	g [in] [mm]	f [in] [mm]		g ₂ [in] [mm]	k [in] [mm]	[kg]
ANSI flange											
AN	AISI 316/ 316L ²	1 in	300 lb./sq.in	4.88 124	0.69 17.5	2 50.8	0.06 1.6	4	0.75 19.1	3.5 88.9	1.3
AE	AISI 316/ 316L ²	1 1/2 in	150 lb./sq.in	5 127	0.69 17.5	2.88 73.2	0.06 1.6	4	0.62 15.7	3.88 98.6	1.5
AQ	AISI 316/ 316L ²	1 1/2 in	300 lb./sq.in	6.12 155.4	0.81 20.6	2.88 73.2	0.06 1.6	4	0.88 22.4	4.5 114.3	2.6
AF	AISI 316/ 316L ²	2 in	150 lb./sq.in	6 152.4	0.75 19.1	3.62 91.9	0.06 1.6	4	0.75 19.1	4.75 120.7	2.4
AR	AISI 316/ 316L ²	2 in	300 lb./sq.in	7.5 190.5	0.88 22.3	3.62 91.9	0.06 1.6	8	0.75 19.1	5 127	3.2
AG	AISI 316/ 316L ²	3 in	150 lb./sq.in	7.5 190.5	0.94 23.9	5 127	0.06 1.6	4	0.75 19.1	6 152.4	4.9
AS	AISI 316/ 316L ²	3 in	300 lb./sq.in	8.25 209.5	1.12 28.4	5 127	0.06 1.6	8	0.88 22.4	6.62 168.1	6.7
AH	AISI 316/ 316L ²	4 in	150 lb./sq.in	9 228.6	0.94 23.9	6.19 157.2	0.06 1.6	8	0.75 19.1	7.5 190.5	7.1
AT	AISI 316/ 316L ²	4 in	300 lb./sq.in	10 254	1.25 31.8	6.19 157.2	0.06 1.6	8	0.88 22.4	7.88 200.2	11.6
JIS flange											
KA	AISI 316L ³	25 A	20 K	125	16	67	1	4	19	90	1.5
KF	AISI 316L ³	50 A	10 K	155	16	96	2	4	19	120	2.0
KL	AISI 316L ³	80 A	10 K	185	18	127	2	8	19	150	3.3
KH	AISI 316L ³	100 A	10 K	210	18	151	2	8	19	175	4.4

1) Housing weight see page 61


2) Combination of AISI 316 for required pressure resistance and AISI 316L for required chemical resistance (dual rated)

3) AISI 316L/1.4435

Height h for devices with flange


	T14 housing	T17 housing
Height h	165 mm	181 mm

Oval flange

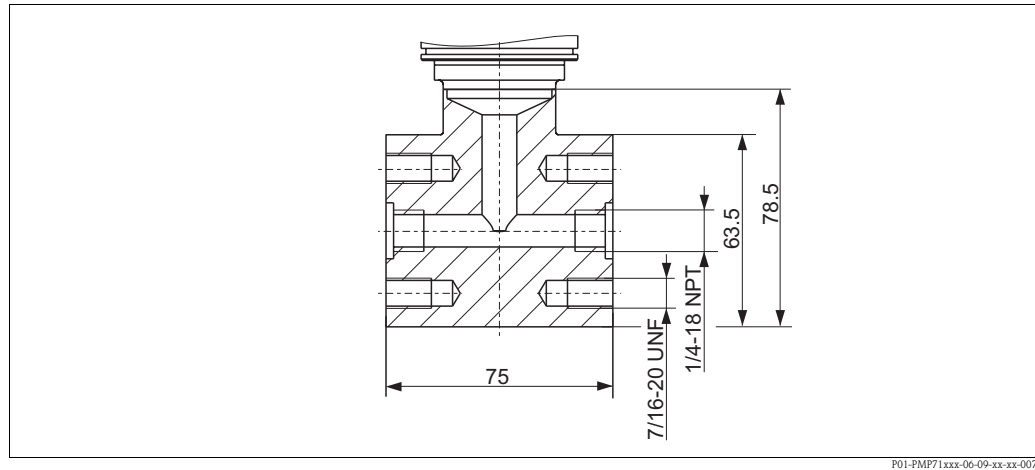

Version UR: oval flange adapter 1/4-18 NPT, mounting: 7/16-20 UNF

Prepared for diaphragm seal mount

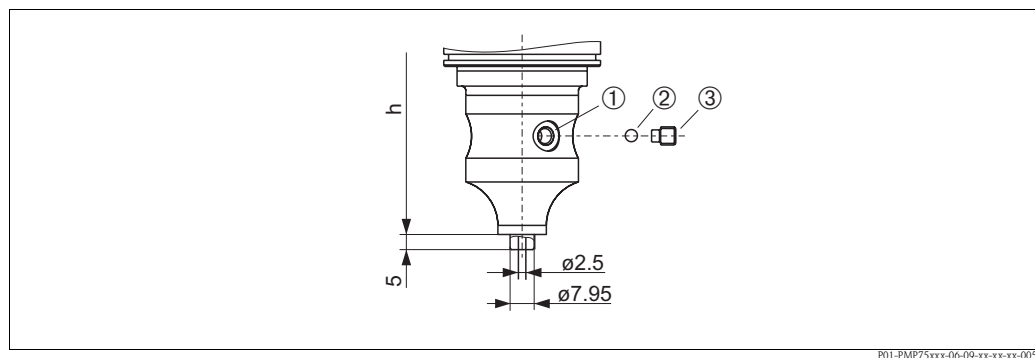


Version U1: prepared for diaphragm seal mount

- 1 Hole for filling fluid
- 2 Bearing
- 3 Threaded pin with an internal hexagon 4 mm

	T14 housing	T17 housing
Height h	190 mm	204 mm

PMP75 Basic unit

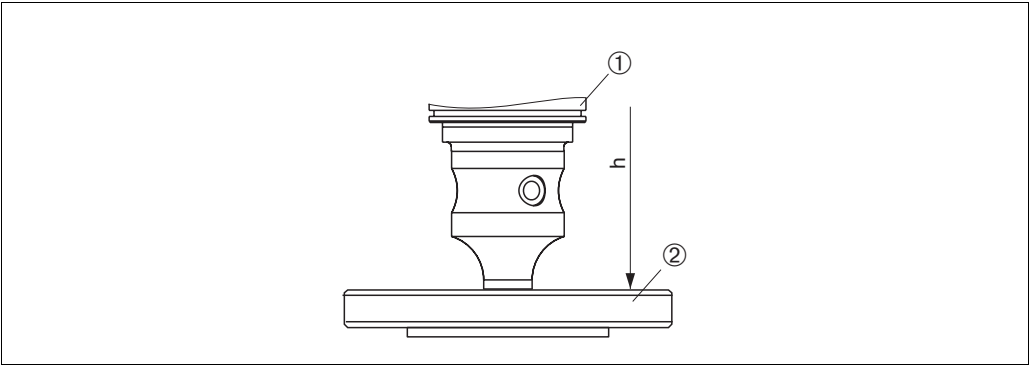

P01-PMP75xxx-06-09-xx-xx-012

PMP75 Basic unit with diaphragm seal

- 1 PMP75 Basic unit
2 Diaphragm seal, here e.g. flange diaphragm seal


	T14 housing	T17 housing
Height	190 mm	204 mm

**Process connections PMP75
(with metallic measuring
diaphragm)**

Note!

- Some device versions have CRN approval. For a CRN-approved device, a CRN-approved process connection (→ see page 79, feature 70 "Process connection") has to be ordered with a CSA approval (→ see page 78, feature 10 "Approval"). Devices with capillary are not CRN-approved. These devices are fitted with a separate plate bearing the registration number 0F10525.5C.
- Specifications for the " T_K Process" are listed in the following tables. These are typical values. The temperature coefficients apply to silicone oil and the membrane material AISI 316L/1.4435. For other filling oils, this temperature coefficient must be multiplied by the T_K correction factor of the corresponding filling oil. For the T_K correction factors, see page 63, section "Diaphragm seal filling oils".
- With regard to the temperature coefficient " T_K Ambient", devices with a temperature isolator behave like devices with the same process connection with 1 m capillary.
- In addition, the temperature coefficient " T_K Ambient" is listed in relation to the capillary length for the diaphragm seal versions which can be supplied with capillaries as standard. This information is found on page 63 ff, section "Influence of the temperature on the zero point".
- The weights of the diaphragm seals are given in the tables. See page 61 for the weight of the housing.
- The following drawings are drawings that illustrate how the system works in principle. In other words, the dimensions of a diaphragm seal supplied can deviate from the dimensions given in this document.

Thread, flush-mounted diaphragm

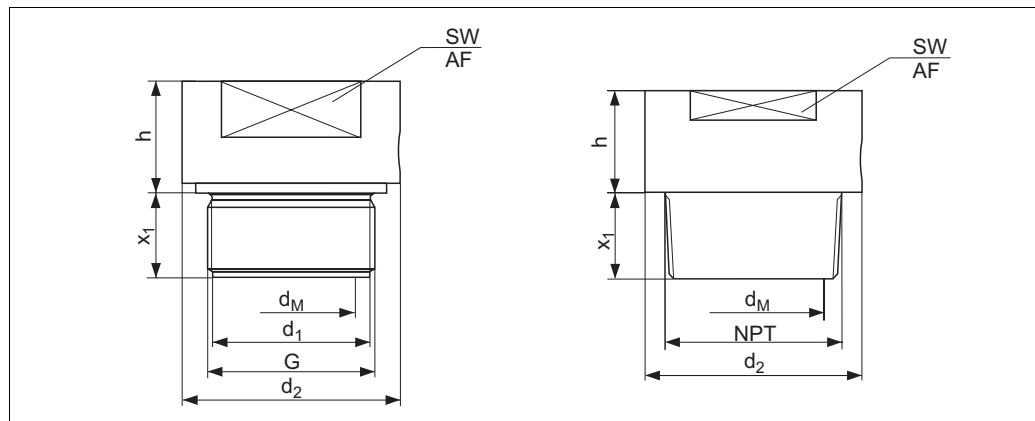


P01-PMP75xxx-06-09-xx-xx-003

Process connections PMP75, left: thread ISO 228, right: thread ANSI

Threaded connection								Diaphragm seal					
Ver- sion	Material ¹	Thread	Nomi- nal pres- sure PN	Dia- meter d ₁ [mm]	Dia- meter d ₂ [mm]	Screw-in length x ₁ [mm]	Across flats SW/AF	max. Dia- phragm diameter d _M [mm]	T _K Ambient ≤ 40 bar	T _K Ambient > 40 bar	T _K Process	Height h [mm]	Dia- phragm seal weight [kg]
1D	AISI 316L	G 1 A	400	30	39	21	32	30	+16.03	+24.33	+5.17	19	0.4
1E	Alloy C276								–	–	–		0.5
1G	AISI 316L	G 1 1/2 A	400	43	55	30	41	42	+5.4	+8.18	+1.76	20	0.9
1H	Alloy C276								–	–	–		1.0
1K	AISI 316L	G 2	400	56	68	30	60	50	+1.76	+2.68	+0.56	20	1.9
1L	Alloy C276								–	–	–		2.1
2A	AISI 316L	1 MNPT	400	–	48	28	41	24	+15.66	+24.42	+4.21	37	0.6
2B	Alloy C276								–	–	–		0.7
2D	AISI 316L	1 1/2 MNPT	400	–	50	30	41	36	+8.14	+12.39	+2.59	20	0.9
2E	Alloy C276								–	–	–		1.0
2G	AISI 316L	2 MNPT	400	–	78	30	65	38	+5.4	+8.18	+2.59	35	1.8
2H	Alloy C276								–	–	–		2,0

1) AISI 316L/1.4435; Alloy C276/2.4819

Tri-Clamp ISO 2852

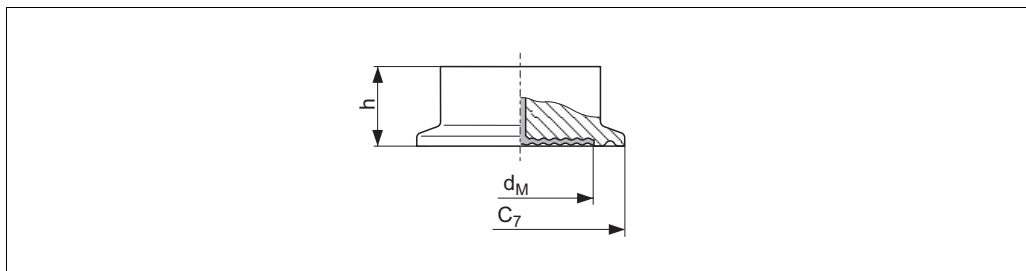


P01-FMD78xxx-06-09-xx-xx-005

Process connection PMP75, material: AISI 316L/1.4435, surface roughness of the surfaces in contact with the medium $R_a \leq 0.8 \mu\text{m}$ as standard. Lower surface roughness on request.

Version	Nominal diameter ISO 2852	Nominal diameter DIN 32676	Nominal diameter	Diameter	max. Diaphragm diameter	Height	T_K Ambient ≤ 40 bar	T_K Ambient > 40 bar	T_K Process	Diaphragm seal weight
			[in]	C_7 [mm]	d_M [mm]	h [mm]	[mbar/10 K]			[kg]
TB	DN 25	DN 25	1	50.5	24	37	+15.33	+24.0	+2.85	0.32
TC ¹⁾	DN 38	DN 40	1 1/2	50.5	34	30	+8.14	+12.39	+1.91	1.0
TD ¹⁾	DN 51	DN 50	2	64	48	30	+3.45	+4.81	+1.28	1.1
TF	DN 76.1	—	3	91	73	30	+0.3	+0.35	+0.18	1.2

- 1) Diaphragm seal versions in conformity with ASME-BPE for use in biochemical processes, wetted surfaces $R_a \leq 0.4 \mu\text{m}$ (15.75 μin ; 180 grit), electropolished; to be ordered using feature 60 "Additional option", version "P" in the order code

Tri-Clamp pipe diaphragm seal ISO 2852

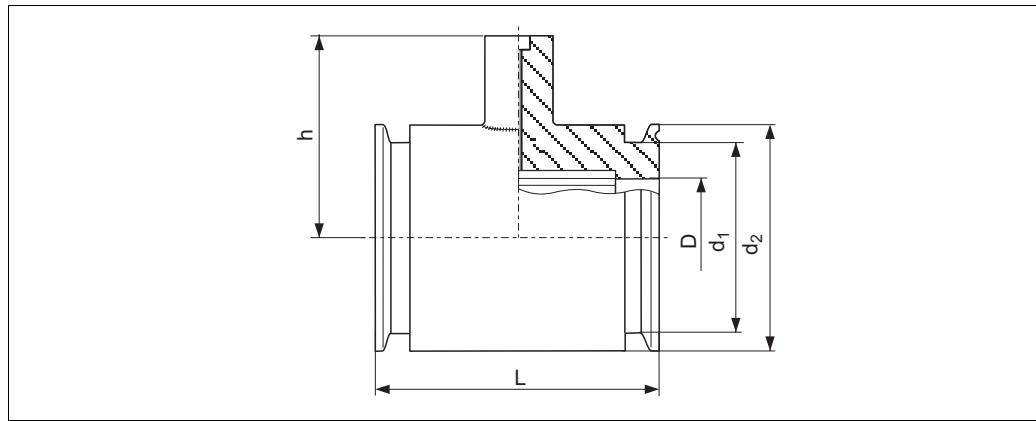


Process connection PMP75, material AISI 316L, surface roughness of the surfaces in contact with the medium $R_a \leq 0.8 \mu\text{m}$ as standard. Lower surface roughness on request.

Version	Nominal diameter ISO 2852	Nominal diameter	Diameter D [in]	Diameter d ₁ [mm]	Diameter d ₂ [mm]	Height h [mm]	Face-to-face-length L [mm]	T _K Ambient ≤ 40 bar	T _K Ambient > 40 bar	T _K Process	Diaphragm seal weight [kg]
SB	DN 25	1	22.5	43.5	50.5	67	126	+7.75	+8.69	+4.49	1.7
SC ¹	DN 38	1 1/2	35.5	43.5	50.5	67	126	+5.17	+5.69	+3.46	1.0
SD ¹	DN 51	2	48.6	56.5	64	79	100	+3.56	+3.91	+2.69	1.7

1) Including 3.1 and pressure test as per Pressure Equipment Directive, category II

Varivent N for pipes DN 40 – DN 162

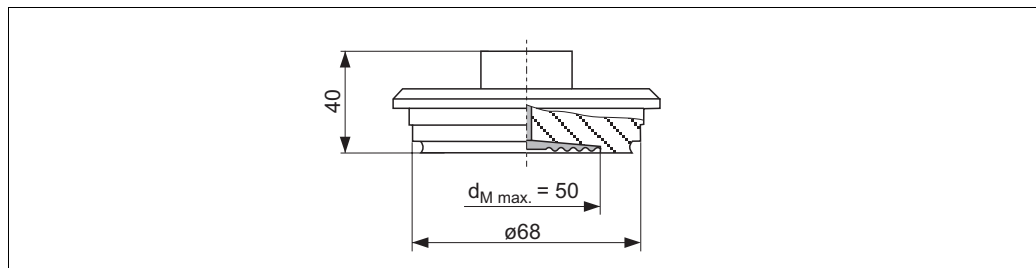


Process connection PMP75, surface roughness of the surfaces in contact with the medium $R_a \leq 0.8 \mu\text{m}$ as standard. Lower surface roughness on request.

Version	Material	Nominal pressure	T _K Ambient ≤ 40 bar	T _K Ambient > 40 bar	T _K Process	Diaphragm seal weight [kg]
TR ¹	AISI 316L/ 1.4435	PN 40	+2.26	+3.11	+0.89	1.3

1) Diaphragm seal versions in conformity with ASME-BPE for use in biochemical processes, wetted surfaces $R_a \leq 0.4 \mu\text{m}$ (15.75 μin ; 180 grit), electropolished; to be ordered using feature 60 "Additional option", version "P" in the order code


DRD 65 mm

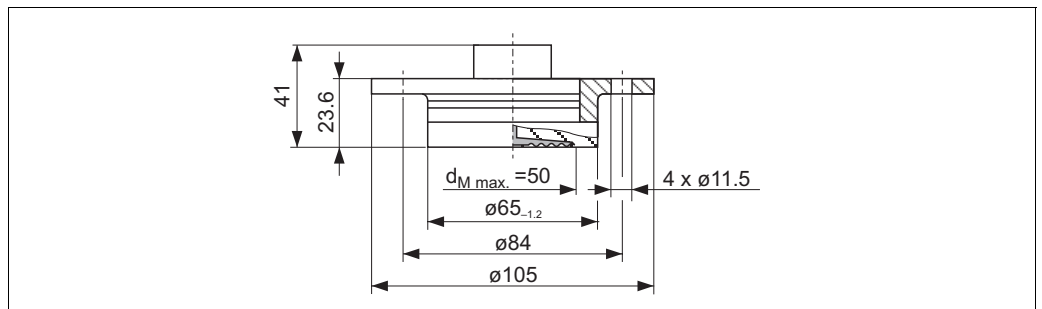

Process connection PMP75, surface roughness of the surfaces in contact with the medium $R_a \leq 0.8 \mu\text{m}$ as standard. Lower surface roughness on request.

Version	Material	Nominal pressure	T _K Ambient ≤ 40 bar	T _K Ambient > 40 bar	T _K Process	Diaphragm seal weight
			[mbar/10 K]		[kg]	
TK	AISI 316L/ 1.4435	PN 25	+2.26	+3.11	+0.89	0,75


SMS nozzles with coupling nut

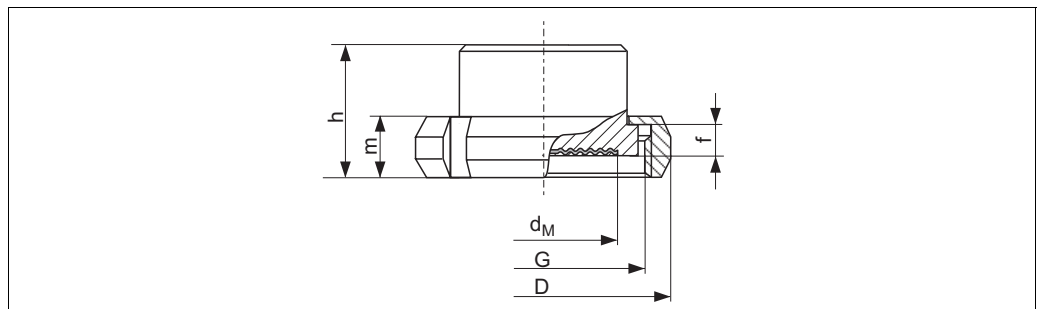

Process connection PMP75, material AISI 316L/1.4435, surface roughness of the surfaces in contact with the medium $R_a \leq 0.8 \mu\text{m}$ as standard. Lower surface roughness on request.

Version	Nominal diameter	Nominal pressure	Dia- meter	Adapter height	Thread	Height	Height	max. dia- phragm diameter	T _K Ambient ≤ 40 bar	T _K Ambient > 40 bar	T _K Process	Weight dia- phragm seal
			D	f	G	m	h	d _M	[mbar/10 K]			[kg]
	[inch]	[bar]	[mm]	[mm]		[mm]	[mm]	[mm]				
TG	1	PN 25	54	3,5	Rd 40 – 1/6	20	42.5	24	+15.66	+24.22	+4.21	0.25
TH	1 1/2	PN 25	74	4	Rd 60 – 1/6	25	57	36	+8.18	+12.39	+2.59	0.65
TI	2	PN 25	84	4	Rd 70 – 1/6	26	62	48	+5.4	+8.18	+1.76	1.05

APV-RJT nozzles with coupling nut

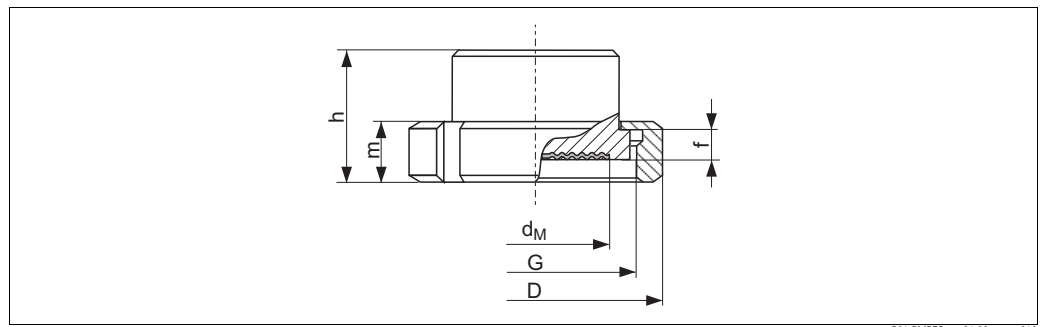


P01-PMP75xxx-06-09-xx-xx-010

Process connection PMP75, material AISI 316L/1.4435, surface roughness of the surfaces in contact with the medium $R_a \leq 0.8 \mu m$ as standard. Lower surface roughness on request.

Version	Nomi- nal dia- meter	Nomi- nal pres- sure	Dia- meter	Adap- ter height	Thread	Height	Height	max. diaphragm diameter	T _K Ambient ≤ 40 bar	T _K Ambient > 40 bar	T _K Process	Weight dia- phragm seal
	[inch]	PN [bar]	D [mm]	f [mm]	G	m [mm]	h [mm]	d _M [mm]	[mbar/10 K]			[kg]
TL	1	PN 40	77	6.5	1 13/16 – 1/8"	22	42.6	21	+15.66	+24.42	+4.21	0.45
TM	1 1/2	PN 40	72	6.4	2 5/16 – 1/8"	22	42.6	28	+8.18	+12.39	+2.59	0.75
TN	2	PN 40	86	6.4	2 7/8 – 1/8"	22	42.6	38	+5.4	+8.18	+1.76	1.2

APV-ISS nozzles with coupling nut

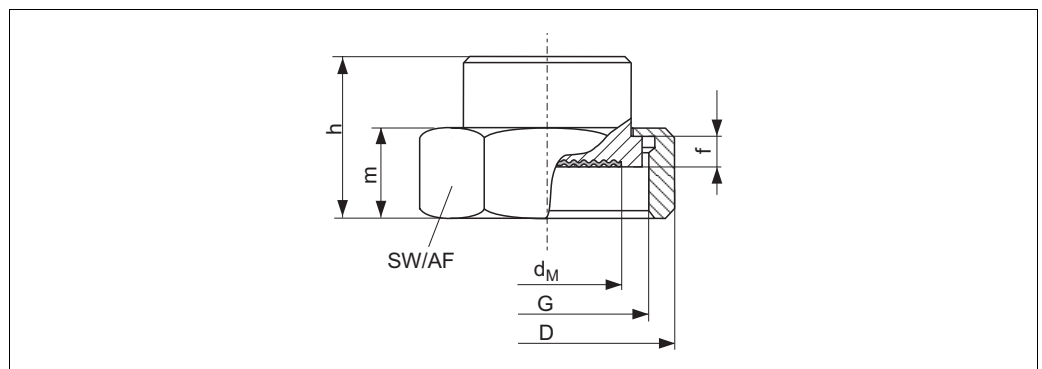


P01-PMP75xxx-06-09-xx-xx-011

Process connection PMP75, material AISI 316L/1.4435, surface roughness of the surfaces in contact with the medium $R_a \leq 0.8 \mu m$ as standard. Lower surface roughness on request.

Version	Nomi- nal dia- meter	Nomi- nal pres- sure	Dia- meter	Adap- ter height	Thread	Height	Across flat	Height	max. diaphragm seal	T _K Ambient ≤ 40 bar	T _K Ambient > 40 bar	T _K Process	Weight Dia- phragm seal
	[inch]	PN [bar]	D [mm]	f [mm]	G	m [mm]	AF	h [mm]	d _M [mm]	[mbar/10 K]			[kg]
TP	1	PN 40	54.1	4	1 1/2" – 1/8"	30	46.8	50	24	+15.66	+24.42	+4.21	0.4
TQ	1 1/2	PN 40	72	4	2" – 1/8"	30	62	50	34	+8.14	+12.39	+2.59	0.6
TS	2	PN 40	89	4	2 1/2" – 1/8"	30	77	50	45	+5.4	+8.18	+1.76	1.1

Taper adapter with coupling nut, DIN 11851

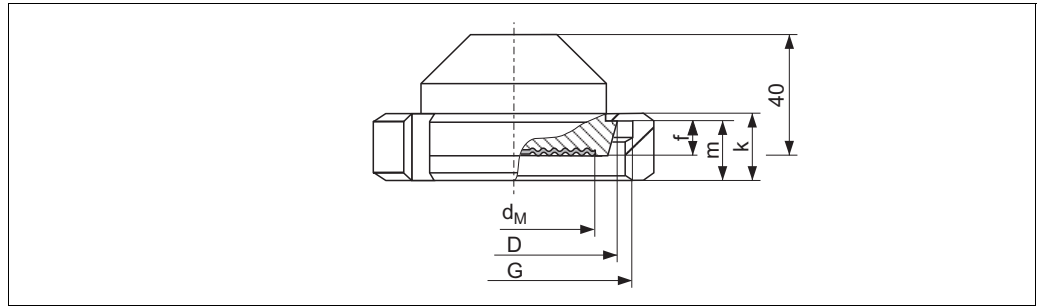


P01-FMD78xxx-06-09-xx-xx-007

Process connection PMP75, material AISI 316L/1.4435, surface roughness of the surfaces in contact with the medium $R_a \leq 0.8 \mu m$ as standard. Lower surface roughness on request.

	Taper adapter				Slotted nut			Diaphragm seal				
Version	Nominal diameter	No- minal pres- sure	Dia- meter	Adapter height	Thread	Height	Height	max. Dia- phragm diameter	T _K Ambient ≤ 40 bar	T _K Ambient > 40 bar	T _K Process	Dia- phragm seal weight
			D	f	G	k	m	d _M				
			[mm]	[mm]		[mm]	[mm]	[mm]	[mm]		[mbar/10 K]	
MR	DN 50	PN 25	68.5	11	Rd 78 x 1/6"	22	19	52	+2.21	+3.02	+0.88	1.1
MS	DN 65	PN 25	86	12	Rd 95 x 1/6"	35	21	66	+1.6	+2.1	+0.6	2.0
MT	DN 80	PN 25	100	12	Rd 110 x 1/4"	30	26	81	+0.66	+0.81	+0.4	2.55

Threaded adapter, DIN 11851

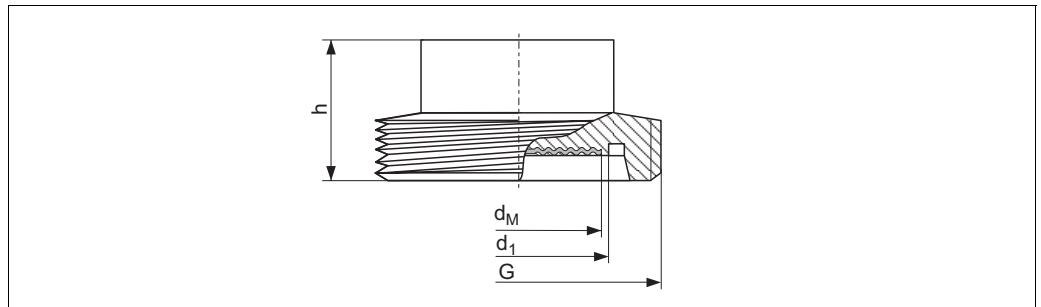


P01-FMD78xxx-06-09-xx-xx-006

Process connection PMP75, material AISI 316L/1.4435, surface roughness of the surfaces in contact with the medium $R_a \leq 0.8 \mu m$ as standard. Lower surface roughness on request.

	Threaded adapter					Diaphragm seal				
Version	Nominal diameter	Nominal pressure	Diameter	Thread	Height	max. Diaphragm diameter	T _K Ambient ≤ 40 bar	T _K Ambient > 40 bar	T _K Process	Diaphragm seal weight
			d _I	G	h	d _M	[mbar/10 K]			[kg]
			[mm]		[mm]	[mm]				
M3	DN 50	PN 25	54	Rd 78 x 1/6"	35	52	+2.21	+3.02	+0.88	0.9
M4	DN 65	PN 25	71	Rd 95 x 1/6"	40	66	+1.6	+2.1	+0.6	1.7
M5	DN 80	PN 25	85	Rd 110 x 1/4"	40	81	+0.66	+0.81	+0.4	2.0

EN/DIN flanges, connection dimensions as per EN 1092-1/DIN 2527 and DIN 2501-1

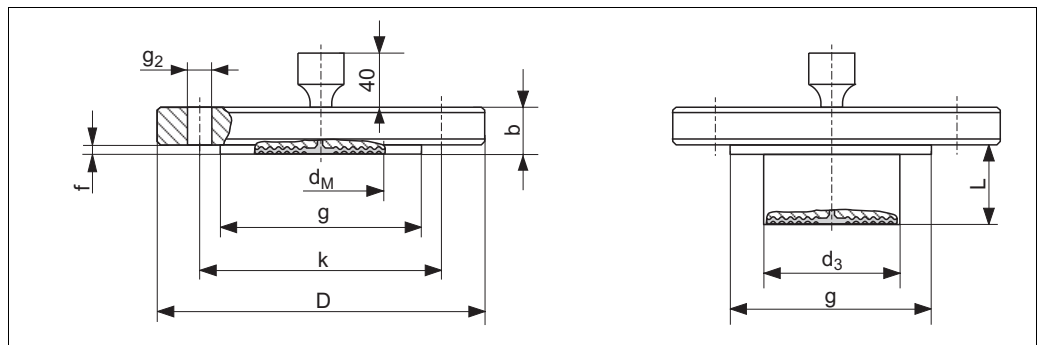

P01-PMP75xxx-06-09-xx-xx-002

Process connection PMP75, EN/DIN flange with flush-mounted diaphragm, material AISI 316L


Ver- sion	Flange							Boltholes			Diaphragm seal				
	No- minal dia- meter	Nominal pressure	Shape ¹	Dia- meter	Thick- ness	Raised face		Quan- tity	Dia- meter	Hole circle	max. Dia- phragm dia- meter	T _K Ambient		T _K Pro- cess	Dia- phragm seal weight
						g	f					≤ 40 bar	> 40 bar		
				D [mm]	b [mm]	g [mm]	f [mm]		g ₂ [mm]	k [mm]	d _M [mm]	[mbar/10 K]			[kg]
CN	DN 25	PN 10-40	B1 (D)	115	18	66	3	4	14	85	32	+16.03	+24.33	+5.17	2.1
DN	DN 25	PN 63-160	E	140	24	68	2	4	18	100	28	+16.03	+24.33	+5.17	2.5
EN	DN 25	PN 250	E	150	28	68	2	4	22	105	28	+16.03	+24.33	+5.17	3.7
E1	DN 25	PN 400	E	180	38	68	2	4	26	130	28	+16.03	+24.33	+5.17	7.0
CP	DN 32	PN 10-40	B1 (D)	140	18	77	2.6	4	18	100	34	+8.14	+12.39	+2.59	1.9
CQ	DN 40	PN 10-40	B1 (D)	150	18	87	2.6	4	18	110	48	+5.40	+8.18	+1.76	2.2
B3	DN 50	PN 10-40	B1 (D)	165	26	102	3	4	18	125	59	+2.21	+3.02	+1.15	3.0
C3	DN 50	PN 63	B2 (E)	180	26	102	3	4	22	135	59	+2.21	+3.02	+1.15	4.6
EF	DN 50	PN 100/ 160	E	195	30	102	3	4	26	145	59	+2.21	+3.02	+1.15	6.2
ER	DN 50	PN 250	E	200	38	102	3	8	26	150	59	+2.21	+3.02	+1.15	7.7
E3	DN 50	PN 400	E	235	52	102	3	8	30	180	59	+2.21	+3.02	+1.15	14.7
B4	DN 80	PN 10-40	B1 (D)	200	24	138	3.5	8	18	160	89	+0.19	+0.25	+0.11	5.3
C4	DN 80	PN 100	B2 (E)	230	32	138	4	8	24	180	89	+0.19	+0.25	+0.11	8.9
C5	DN 100	PN 100	B2 (E)	265	36	175	5	8	30	210	89	+0.19	+0.25	+0.11	13.7
D3 ²	DN 50	PN 10-40	B1 (D)	165	20	102	3	4	18	125	47	+3.45	+4.81	+1.67	²
D4 ²	DN 80	PN 10-40	B1 (D)	200	24	138	3.5	8	18	160	72	+0.19	+0.25	+0.7	²

1) Designation as per DIN 2527 in brackets

2) 50 mm, 100 mm or 200 mm extension selectable, for extension diameter and weight see the following table

Version	Nominal diameter	Nominal pressure	Extension length [mm]	Extension diameter [mm]	Diaphragm seal weight [kg]
D3	DN 50	PN 10-40	50 / 100 / 200	48.3	3.2 / 3.8 / 4.4
D4	DN 80	PN 10-40	50 / 100 / 200	76	6.2 / 6.7 / 7.8

ANSI flanges B 16.5 RF

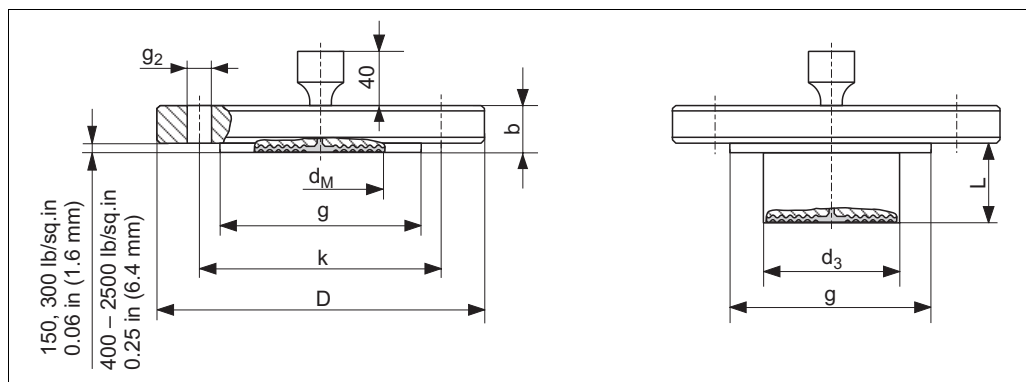

P01-PMP75xxx-06-09-xx-xx-001

Process connection PMP75, ANSI flange B 16.5 RF with and without extended diaphragm seal

Ver- sion	Flange						Boltholes			Diaphragm seal				
	Material	No- minal dia- meter	Class	Dia- meter	Thick- ness	Raised face	Quan- tity	Dia- meter	Hole circle	max. Dia- phragm dia- meter	T _K Ambient		T _K Pro- cess	Dia- phragm seal weight
											≤ 40 bar	> 40 bar		
		[in]	[lb./ sq.in]	D [in] [mm]	b [in] [mm]	g [in] [mm]		g ₂ [in] [mm]	k [in] [mm]	d _M [in] [mm]	[mbar/10 K]			[kg]
AC	AISI 316/ 316L ¹	1	150	4.25 108	0.56 14.2	2 50.8	4	0.62 15.7	3.12 79.2	1.26 32	+16.03	+24.33	+5.17	1.2
AN	AISI 316/ 316L ¹	1	300	4.88 124	0.69 17.5	2 50.8	4	0.75 19.1	3.5 88.9	1.26 32	+16.03	+24.33	+5.17	1.3
HC	AISI 316/ 316L ¹	1	400/ 600	4.88 124	0.69 17.5	2 50.8	4	0.75 19.1	3.5 88.9	1.26 32	+16.03	+24.33	+5.17	1.4
HN	AISI 316/ 316L ¹	1	900/ 1500	5.88 149.4	1.12 28.4	2 50.8	4	1 25.4	4 101.6	1.26 32	+16.03	+24.33	+5.17	3.2
HO	AISI 316/ 316L ¹	1	2500	6.25 158.8	1.38 35.1	2 50.8	4	1 25.4	4.25 108	1.26 32	+16.03	+24.33	+5.17	4.6
AE	AISI 316/ 316L ¹	1 1/2	150	5 127	0.69 17.5	2.88 73.2	4	0.62 15.7	3.88 96.6	1.89 48	+8.14	+12.39	+2.59	1.5
AQ	AISI 316/ 316L ¹	1 1/2	300	6.12 155.4	0.81 20.6	2.88 73.2	4	0.88 22.4	4.5 114.3	1.89 48	+8.14	+12.39	+2.59	2.6
AF	AISI 316/ 316L ¹	2	150	6 152.4	0.75 19.1	3.62 91.9	4	0.75 19.1	4.75 120.7	2.32 59	+2.21	+3.02	+1.15	2.2
J3 ²	AISI 316/ 316L ¹	2	150	6 152.4	0.75 19.1	3.62 91.9	4	0.75 19.1	4.75 120.7	1.85 47	+3.45	+4.81	+1.67	²
AR	AISI 316/ 316L ¹	2	300	6.5 165.1	0.88 22.4	3.62 91.9	8	0.75 19.1	5 127	2.32 59	+2.21	+3.02	+1.15	3.4
HF	AISI 316/ 316L ¹	2	400/ 600	6.5 165.1	1 25.4	3.62 91.9	8	0.75 19.1	5 127	2.32 59	+2.21	+3.02	+1.15	4.3
HR	AISI 316/ 316L ¹	2	900/ 1500	8.5 215.9	1.5 38.1	3.62 91.9	8	1 25.4	6.5 165.1	2.32 59	+2.21	+3.02	+1.15	10.3
H3	AISI 316/ 316L ¹	2	2500	9.25 235	2 50.8	3.62 91.9	8	1.12 28.4	6.75 171.5	2.32 59	+2.21	+3.02	+1.15	15.8
AG	AISI 316/ 316L ¹	3	150	7.5 190.5	0.94 23.9	5 127	4	0.75 19.1	6 152.4	3.50 89	+0.19	+0.25	+0.11	5.1
AS	AISI 316/ 316L ¹	3	300	8.25 209.5	1.12 28.4	5 127	8	0.75 19.1	6 152.4	3.5 89	+0.19	+0.25	+0.11	7.0


Version	Flange						Boltholes			Diaphragm seal				
	Material	No- minal dia- meter	Class	Dia- meter	Thick- ness	Raised face	Quan- tity	Dia- meter	Hole circle	max. Dia- phragm dia- meter	T _K Ambient		T _K Pro- cess	Dia- phragm seal weight
		[in]	[lb./ sq.in]	D [in] [mm]	b [in] [mm]	g [in] [mm]		g ₂ [in] [mm]	k [in] [mm]	d _M [in] [mm]	≤ 40 bar	> 40 bar		[kg]
J4 ³	AISI 316/ 316L ¹	3	150	7.5 190.5	0.94 23.9	5 127	4	0.75 19.1	6 152.4	2.83 72	+0.19	+0.25	+0.7	²
J7 ³	AISI 316/ 316L ¹	3	300	8.25 209.5	1.12 28.4	5 127	8	0.88 22.4	6.62 168.1	2.83 72	+0.19	+0.25	+0.7	²
AH	AISI 316/ 316L ¹	4	150	9 228.6	0.94 23.9	6.19 157.2	8	0.75 19.1	7.5 190.5	3.50 89	+0.19	+0.25	+0.11	7.2
AT	AISI 316/ 316L ¹	4	300	10 254	1.25 31.8	6.19 157.2	8	0.88 22.4	7.88 200.2	3.50 89	+0.19	+0.25	+0.11	11.7
J5 ³	AISI 316/ 316L ¹	4	150	9 228.6	0.94 23.9	6.19 157.2	8	0.75 19.1	7.5 190.5	3.50 89	+0.19	+0.25	+0.11	²
J8 ³	AISI 316/ 316L ¹	4	300	10 254	1.25 31.8	6.19 157.2	8	0.88 22.4	7.88 200.2	3.50 89	+0.19	+0.25	+0.11	²

1) Combination of AISI 316 for required pressure resistance and AISI 316L for required chemical resistance (dual rated)

2) 2", 4", 6" or 8" extension selectable, for extension diameter and weight see the following table

Version	Nominal diameter	Class	Extension length	Extension diameter	Diaphragm seal weight
	[in]	[lb./sq.in]	[in] [mm]	[in] [mm]	[kg]
J3	2	150	– 2 (50.8) – 4 (101.6) – 6 (152.4) – 8 (203.2)	1.9 (48.3)	– 3.0 – 3.4 – 3.9 – 4.4
J4	3	150	– 2 (50.8) – 4 (101.6) – 6 (152.4) – 8 (203.2)	2.99 (75.9)	– 6.0 – 6.6 – 7.1 – 7.8
J7	3	300	– 2 (50.8) – 4 (101.6) – 6 (152.4) – 8 (203.2)	2.99 (75.9)	– 7.9 – 8.5 – 9.0 – 9.6
J5	4	150	– 2 (50.8) – 4 (101.6) – 6 (152.4) – 8 (203.2)	3.7 (94)	– 8.6 – 9.9 – 11.2 – 12.4
J8	4	300	– 2 (50.8) – 4 (101.6) – 6 (152.4) – 8 (203.2)	3.7 (94)	– 13.1 – 14.4 – 15.7 – 16.9

JIS flange B 2220

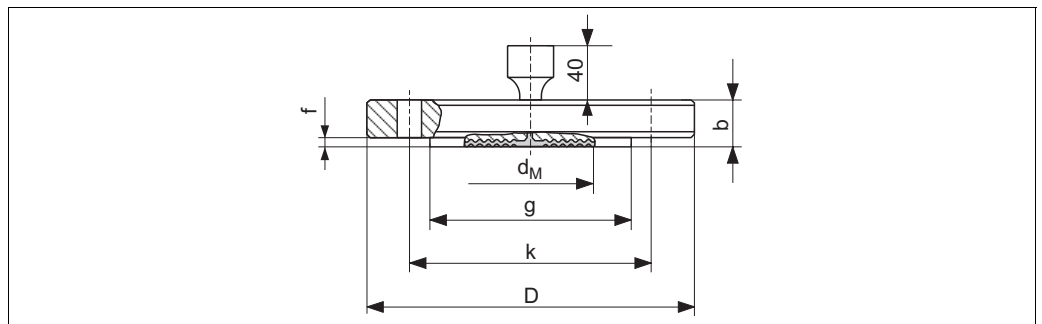


P01-PMP75xxx-06-09-xx-xx-000

Process connection PMP75, JIS flange, material AISI 316L

Ver- sion	Flange						Boltholes			Diaphragm seal				
	No- minal dia- meter	No- minal pres- sure	Dia- meter D [mm]	Thick- ness b [mm]	Dia- meter raised face g [mm]	Height raised face f [mm]	Quan- tity	Dia- meter g ₂ [mm]	Hole circle k [mm]	max. Dia- phragm dia- meter d _M [mm]	T _K Ambient		T _K Process	Dia- phragm seal weight ¹ [kg]
											≤ 40 bar	> 40 bar		
											[mbar/10 K]			
KA	25 A	10 K	125	14	67	1	4	19	90	32	+16.03	+24.33	+5.17	1.5
KF	50 A	10 K	155	16	96	2	4	19	120	59	+2.21	+3.02	+1.15	2.3
KL	80 A	10 K	185	18	127	2	8	19	150	89	+0.19	+0.25	+0.11	3.3
KH	100 A	10 K	210	18	151	2	8	19	175	89	+0.19	+0.25	+0.11	4.4


1) Housing weight see page 61

Separator ISO 228 G 1/2 A and ANSI 1/2 MNPT

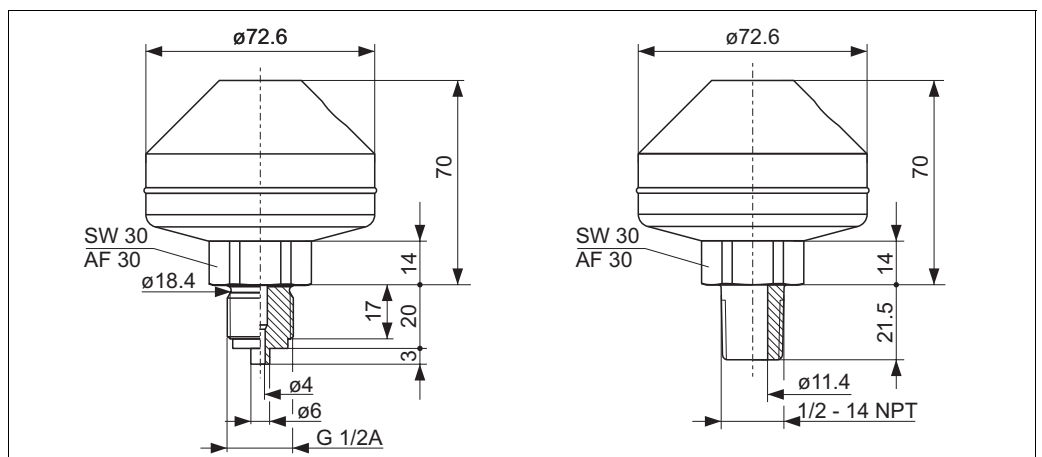

P01-PMP75xxx-06-09-xx-xx-004

Process connection PMP75, versions "UA" and "UB", welded, material AISI 316L

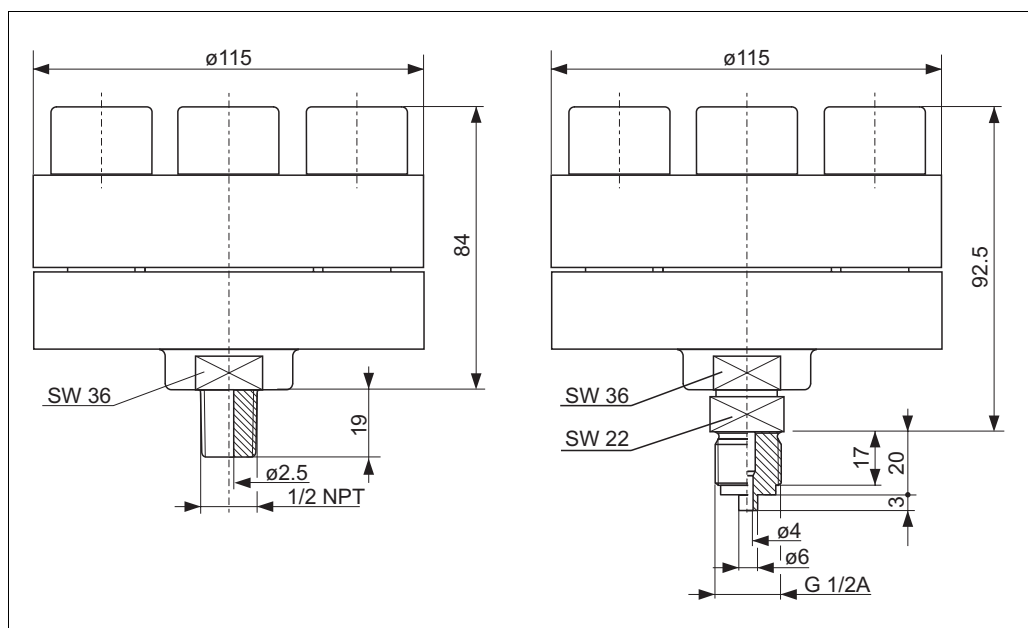


P01-PMP75xxx-06-09-xx-xx-007

Process connection PMP75, versions "UC" and "UD", screwed, material AISI 316L, with metallic seal

Version	Description	Nominal pressure	T _K Ambient [mbar/10 K]	T _K Process	Diaphragm seal weight [kg]
UA	ISO 228 G 1/2 A	PN 160	+0.9	+0.3	1.43
UB	ANSI 1/2 MNPT	PN 160	+0.9	+0.3	1.43
UC	ISO 228 G 1/2 B	PN 400	+3.45	+1.28	4.75
DU	ANSI 1/2 MNPT	PN 400	+3.45	+1.28	4.75

1/2 NPT und 1 NPT Off line thread

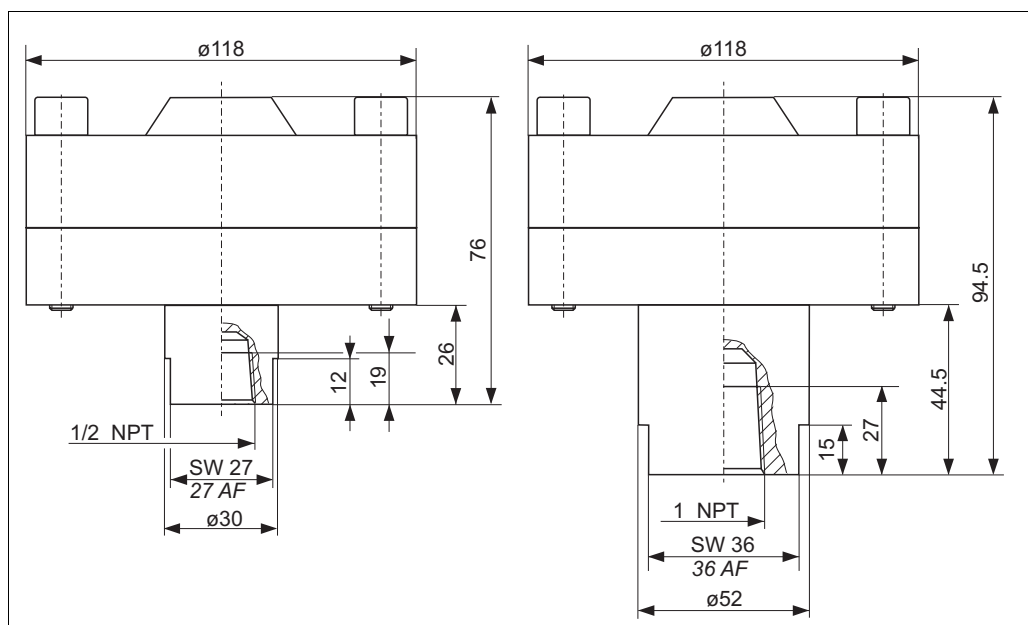

P01-PMP75xxx-06-09-xx-xx-008

Process connection PMP75, versions "UG" and "UL", screwed, material AISI 316L, seal Viton

Version	Description	Nominal pressure	T _K Ambient	T _K Process	Diaphragm seal weight
			[mbar/10 K]		[kg]
UG	1/2 NPT	PN 250	+3.45	+1.28	4.75
UH	1 NPT	PN 250	+3.45	+1.28	5.0

Weight**Housing**

	T14		T17
	Aluminium	AISI 316L/1.4435	AISI 316L/1.4404
With electronic insert and on-site display	1.2 kg	2.1 kg	1.2 kg
With electronic insert and without on-site display	1.1 kg	2.0 kg	1.1 kg

Process connections

→ See corresponding process connection, page 34 ff.

Material**T14 housing:**

- T14 housing, selectable:
 - Die-cast aluminium with protective powder-coating on polyester basis: RAL 5012 (blue), cover: RAL 7035 (grey)
 - Precision cast stainless steel AISI 316L (1.4435)
- External operation (keys and key covering): Polycarbonate PC-FR Lexan UL 940 UL94VO, RAL 7035 (grey)
- Sight glass:
 - Aluminium housing: Polycarbonat (PC), for Dust-Ex, EEx d, FM XP and CSA XP: Mineral glass
 - Stainless steel housing: Mineral glass
- Cable gland: Polyamid (PA)
- Bind plug: PBT-GF30 FR, for Dust Ex, EEx d, FM XP and CSA XP: AISI 316L (1.4435)
- Seal for cable gland and plug: Silicone (VMQ)
- O-ring for cover sealing: EPDM
- Nameplates: AISI 304 (1.4301)

T17 housing:

- Housing: Stainless steel AISI 316L (1.4404)
- Sight glass: Polycarbonat (PC) or mineral glass
- Cable gland: Polyamid PA, for Dust-Ex: CuZn nickel-plated
- Bind plug: PBT-GF30 FR, for Dust-Ex: AISI 316L (1.4435)
- Seal for cable gland and plug: Silicone (VMQ)
- Pressure compensation filter: PA6 GF10, O-Ring: Silicone (VMQ)
- O-ring for cover sealing: Silicone (VMQ)
- Nameplates: lasered

Miscellaneous:

- Process diaphragm PMC71: Al₂O₃ (Aluminium-oxide-ceramic), ultrapure 99.9%
(→ See also www.endress.com/ceraphire)
- Mounting accessories: Mounting kit with screws AISI 304 (1.4301)
- Capillary: AISI 316 Ti (1.4571)
- Protective hose for capillary: AISI 304 (1.4301)
- External earth terminal: AISI 304 (1.4301)

→ For process connections, process diaphragms, seals and filling oils see ordering information, page 70 ff.

Planning instructions, diaphragm seal systems

Applications

Diaphragm seal systems should be used if the process media and the device should be separated. Diaphragm seal systems offer clear advantages in the following instances:

- In the case of high process temperatures (→ See also page 32, section "Process temperature limits".)
- For aggressive media
- If good and rapid measuring point cleaning is necessary
- If the measuring point is exposed to vibrations
- For mounting locations that are difficult to access
- For very humid mounting locations

Planning instructions

Diaphragm seals are separating equipment between the measuring system and the process medium.

A diaphragm seal system consists of:

- A diaphragm seal in a one-sided system
- Capillary tube
- Fill fluid and
- A pressure transmitter.

The process pressure acts via the diaphragm seal membrane on the liquid-filled system, which transfers the process pressure via the capillary tube onto the sensor of the pressure transmitter.

Endress+Hauser delivers all diaphragm seal systems as welded versions. The system is hermetically sealed, which ensures the highest reliability.

Note!

The correlations between the individual diaphragm seal components are presented in the following section. For further information and comprehensive diaphragm seal system designs, please contact your local Endress+Hauser Sales Center.

Diaphragm seal

The diaphragm seal determines the application range of the system by

- the diaphragm diameter
- the diaphragms: stiffness and material
- the design (oil volume).

Diaphragm diameter

The larger the diaphragm diameter (less stiffness), the smaller the temperature effect on the measurement result.

Note: To keep the temperature effect in practice-oriented limits, you should select diaphragm seals with a nominal diameter of $\geq$ DN 80, in as far as the process connection allows for it.

Diaphragm stiffness

The stiffness is dependent on the diaphragm diameter, the material, any available coating and on the diaphragm thickness and shape. The diaphragm thickness and the shape are defined constructively. The stiffness of a diaphragm seal membrane influences the temperature operating range and the measuring error caused by temperature effects.

Capillary

Capillaries with an internal diameter of 1 mm are used as standard.

The capillary tube influences the T_K zero point, the ambient temperature operating range and the response time of a diaphragm seal system as a result of its length and internal diameter.

→ See also page 63 ff, sections "Influence of the temperature on the zero point" and "Ambient temperature range".

→ Observe the installation instructions regarding capillary tubes. See page 67 ff, section "Installation instructions".

Filling oil

When selecting the filling oil, fluid and ambient temperature as well as the operating pressure are of crucial importance. Observe the temperatures and pressures during commissioning and cleaning. A further selection criterion is the compatibility of the filling oil with the requirements of the process medium. For this reason, only filling oils that are harmless to health are used in the food industry, such as vegetable oil or silicone oil → See also the following section "Diaphragm seal filling oils" section.

The filling oil used influences the T_K zero point and the temperature operating range of a diaphragm seal system and the response time. → See also page 63 ff, section "Influence of the temperature on the zero point".

Pressure transmitter

The pressure transmitter influences the temperature operating range, the T_K zero point and the response time as a result of its volume change. The volume change is the volume that has to be shifted to pass through the complete measuring range.

Pressure transmitters from Endress+Hauser are optimised with regard to minimum volume change.

Diaphragm seal filling oils

Version ¹	Filling oil	Permissible temperature range at $0.05 \text{ bar} \leq p_{\text{abs}} \leq 1 \text{ bar}$	Permissible temperature range at $p_{\text{abs}} \geq 1 \text{ bar}$	Density [g/cm ³]	Viscosity [cSt at 25°C (77°F)]	Coefficient of thermal expansion [1/K]	T_K correction factor	Note
A, H, 1 or 2	Silicone oil	-40...+180°C (-40...+356°F)	-40...+250°C (-40...+482°F)	0.96	100	0.00096	1	suitable for foods
G, 3 or 4	High temperature oil	-10...+200°C (+14...+392°F)	-10...+350°C (+14...+662°F)	1.07	37	0.0007	0.72	high temperatures
F or N	Inert oil	-40...+80°C (-40...+176°F)	-40...+175°C (-40...+347°F)	1.87	27	0.000876	0.91	Oil for ultra pure gas and oxygen applications
D	Vegetable oil	-10...+120°C (+14...+248°F)	-10...+200°C (+14...+392°F)	0.94	9.5	0.00101	1.05	suitable for foods FDA 21 CFR 172.856

1) Version for feature 90 in the order code

Influence of the temperature on the zero point


A temperature change results in a volume change of the filling oil. The volume change is dependent on the coefficient of thermal expansion of the filling oil and on the volume of the filling oil at calibration temperature (constant in the range: +21 to +33°C (+69.8 to 91.4°F)). → See also page 48, "Filling oils, technical data" section.

For example, the filling oil expands in the event of a temperature increase. The additional volume presses against the diaphragm seal membrane. The stiffer a diaphragm is, the greater its return force, which counteracts a volume change and acts on the measuring cell together with the operating pressure, thus shifting the zero point. For the " T_K Process" and " T_K Ambient (for devices without capillary)", see page 49 ff, section "Process connections PMP75".

The following diagrams display the temperature coefficient " T_K Ambient" dependent on the capillary length. The following application is displayed: capillary temperature and transmitter temperature (ambient temperature) change, the process temperature corresponds to the calibration temperature.

The temperature coefficients obtained from the diagrams apply to silicone oil and the membrane material AISI 316L/1.4435. For other filling oils, these temperature coefficients must be multiplied by the T_K correction factor of the corresponding filling oil. For the T_K correction factors, see page 63, section "Diaphragm seal filling oils".

With regard to the temperature coefficient " T_K Ambient", devices with temperature isolator behave like devices with the same process connection with 1 m capillary.

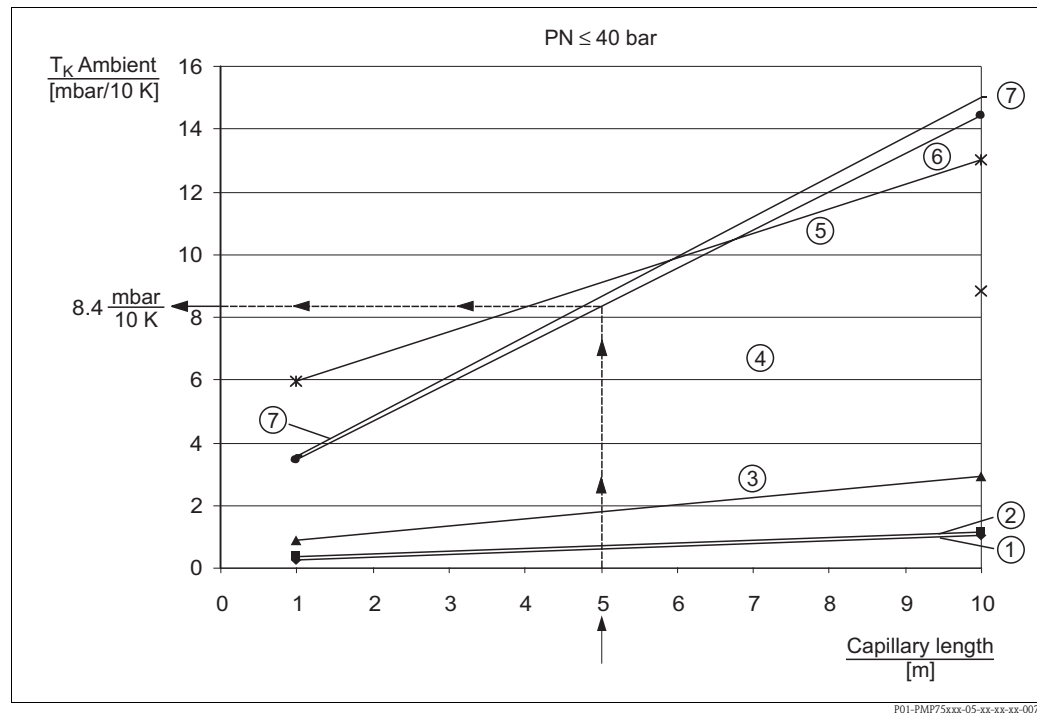**Example for:**


- Diaphragm seal versions "B3, EN/DIN flange DN 50 PN 10-40 B1, AISI 316L"
- Capillary length: 5 m
- Ambient temperature, capillary/transmitter: 45°C
- Filling oil: silicone oil

1. Select characteristic curve type for the diaphragm seal versions "B3" in accordance with the following table.
Result: characteristic curve type 6
2. Obtain value for $T_K \text{ Ambient}$ from the diagram.
Result: 8.4 mbar/10 K
3. $T_{\text{Ambient}} - T_{\text{Calibration}} = 45^\circ\text{C} - 25^\circ\text{C} = 20^\circ\text{C} \Rightarrow 8.4 \text{ mbar/10 K} \times 20 \text{ K} = 16.8 \text{ mbar}$

Result: In this application, the zero point is shifted by 16.8 mbar.

Note!

- The influence of temperature on the zero point can be corrected with position calibration.
- The temperature influence can be minimised by using a filling oil with a smaller coefficient of thermal expansion, shorter capillary, diaphragm seal with larger diaphragm diameter or by using a smaller capillary internal diameter.

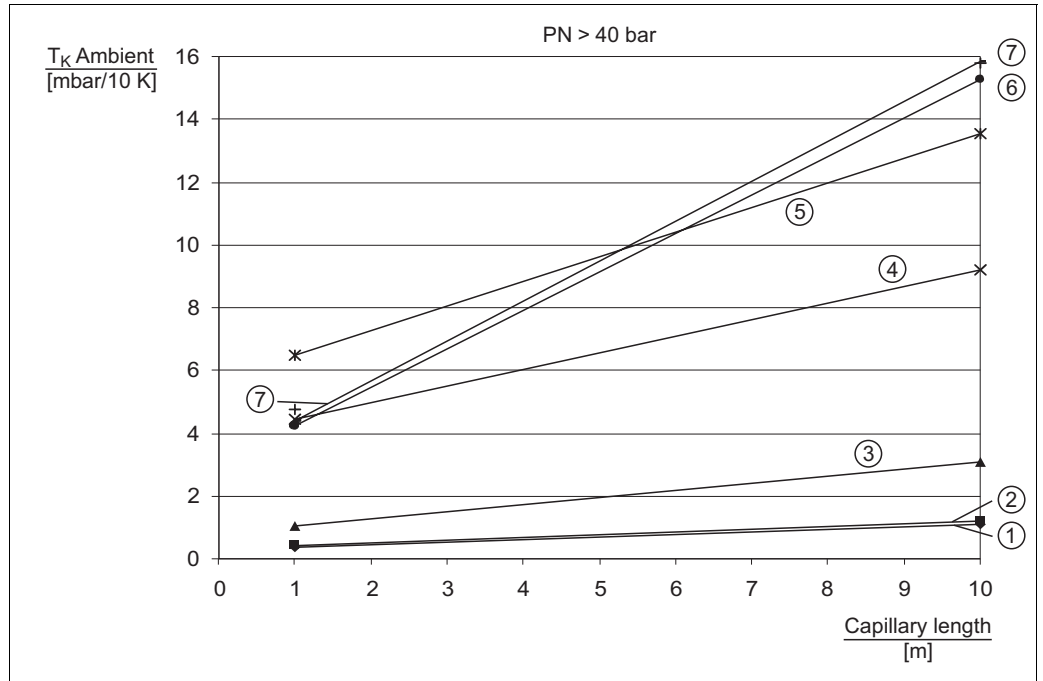

P01-PMP75xxx-05-xx-xx-xx-005

Diagram $T_K \text{ Ambient}$ dependent on the capillary length for PMP75, PN > 40 bar

Characteristic curve type	Version	Diaphragm seal
1	B4	EN/DIN flange DN 80 PN 10-40 B1, AISI 316L
	C4	EN/DIN flange DN 80 PN 100 B2, AISI 316L
	C5	EN/DIN flange DN 100 PN 100 B2, AISI 316L
	KL	JIS flange 10K 80A RF, AISI 316L
	KH	JIS flange 10K 100A RF, AISI 316L
	D4	EN/DIN flange DN 80, PN 10-40 B1, Extensions: 50 mm/100 mm/200 mm, AISI 316L
	AG	ANSI flange 3" 150 lbs RF, AISI 316/316L
	AS	ANSI flange 3" 300 lbs RF, AISI 316/316L
	AH	ANSI flange 4" 150 lbs RF, AISI 316/316L
	AT	ANSI flange 4" 300 lbs RF, AISI 316/316L
	J4	ANSI flange 3" 150 lbs RF, Extensions: 2"/4"/6"/8", AISI 316/316L
	J7	ANSI flange 3" 300 lbs RF, Extensions: 2"/4"/6"/8", AISI 316/316L
	J5	ANSI flange 4" 150 lbs RF, Extensions: 2"/4"/6"/8", AISI 316/316L
	J8	ANSI flange 4" 300 lbs RF, Extensions: 2"/4"/6"/8", AISI 316/316L
2	TF	Tri-Clamp, ISO 2852 DN 76.1 (3"), AISI 316L/1.4435
3	MT	DIN 11851 DN 80 PN 25, AISI 316L/1.4435
	M5	DIN 11851 DN 80 PN 25 socket, AISI 316L/1.4435
4	SD	Pipe diaphragm seal Tri-Clamp, ISO 2852 DN 51 (2"), AISI 316L
5	SC	Pipe diaphragm seal Tri-Clamp, ISO 2852 DN 38 (1 1/2"), AISI 316L
6	B3	EN/DIN flange DN 50 PN 1040 B1, AISI 316L
	C3	EN/DIN flange DN 50 PN 63 B2, AISI 316L
	EF	EN/DIN flange DN 50 PN 100-160 E, AISI 316L
	ER	EN/DIN flange DN 50 PN 250 E, AISI 316L
	E3	EN/DIN flange DN 50 PN 400 E, AISI 316L
	AF	ANSI flange 2" 150 lbs RF, AISI 316/316L
	AR	ANSI flange 2" 300 lbs RF, AISI 316/316L
	HF	ANSI flange 2" 400/600 lbs RF, AISI 316/316L
	HR	ANSI flange 2" 900/1500 lbs RF, AISI 316/316L
	H3	ANSI flange 2" 2500 lbs RF, AISI 316/316L
	KF	JIS 10K 50A RF, AISI 316L
	MR	DIN 11851 DN 50 PN 25, AISI 316L/1.4435
	MS	DIN 11851 DN 65 PN 25, AISI 316L/1.4435
	M3	DIN 11851 DN 50 PN 25 socket, AISI 316L/1.4435
	M4	DIN 11851 DN 65 PN 25 socket, AISI 316L/1.4435
7	TR	Varivent Type N for tubes DN 40 – DN 162, PN 40, AISI 316L/1.4435
	TK	DRD 65 mm, PN 25, AISI 316L/1.4435

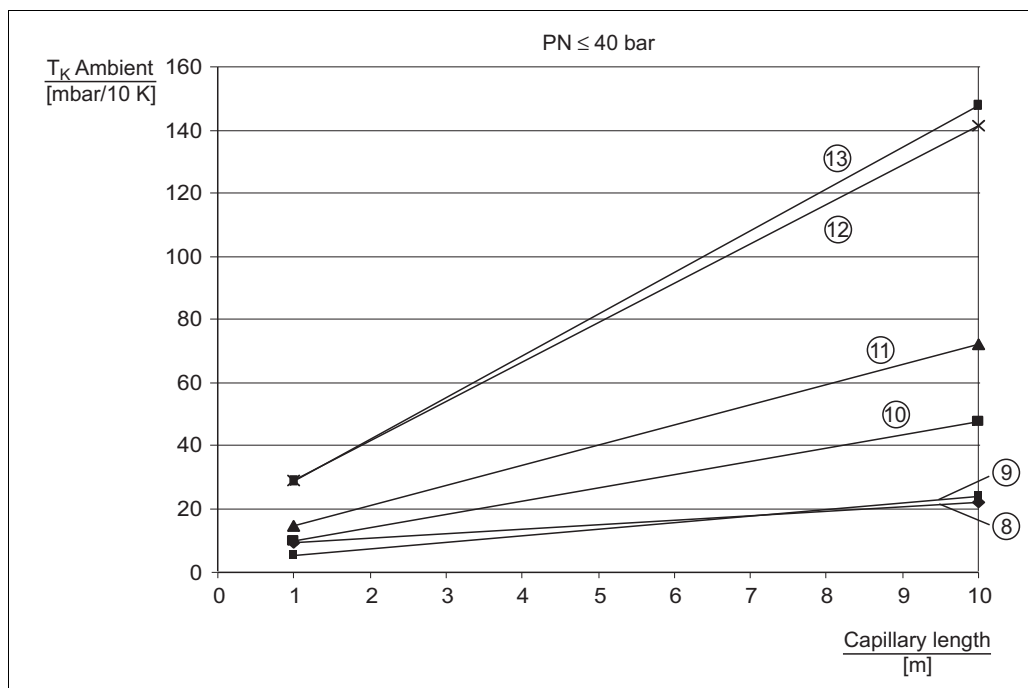


Diagram T_K Ambient dependent on the capillary length for PMP75, PN ≤ 40 bar

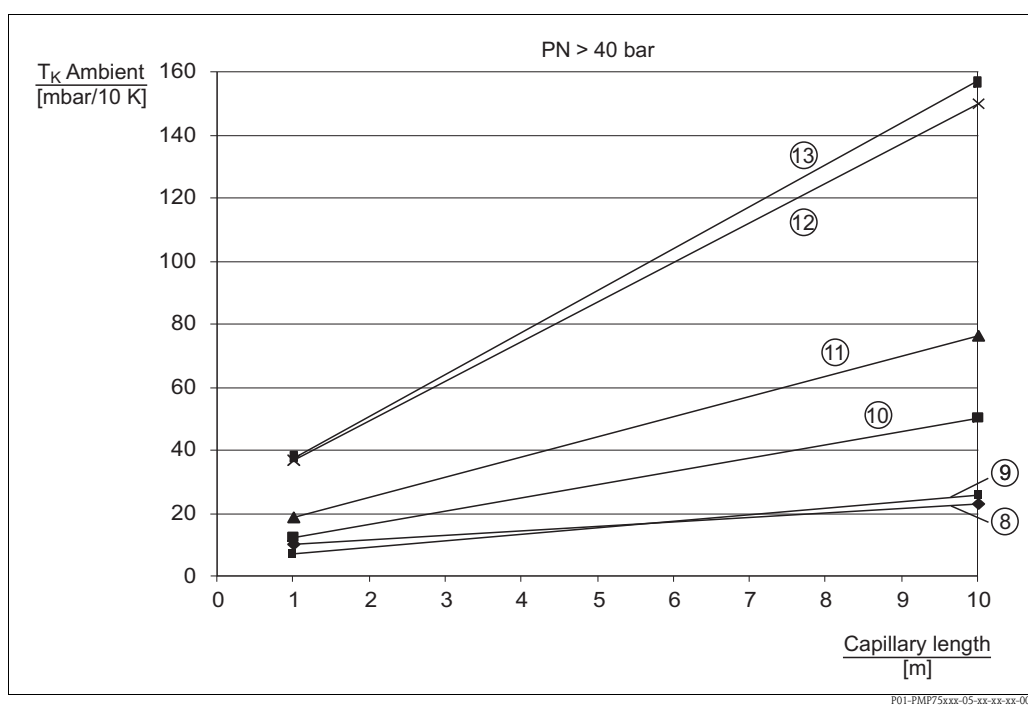


Diagram T_K Ambient dependent on the capillary length for PMP75, PN > 40 bar

Characteristic curve type	Version	Diaphragm seal
8	SB	Pipe diaphragm seal Tri-Clamp, ISO 2852 DN 25 (1"), AISI 316L
9	D3	EN/DIN flange PN10-40 B1, Extensions: 50 mm/100 mm/200 mm, AISI 316L
	J3	ANSI flange 2" 150 lbs, Extensions: 2"/4"/6"/8", AISI 316/316L
	TD	Tri-Clamp, ISO 2852 DN 51 (2"), AISI 316L/1.4435
10	CQ	EN/DIN flange DN 40 PN 10-40 B1, AISI 316L
	TI	SMS 2" PN 25, AISI 316L/1.4435
	TN	APV-RJT 2" PN 40, AISI 316L/1.4435
	TS	APV-ISS 2" PN 40, AISI 316L/1.4435
11	CP	EN/DIN flange DN32 PN 10-40 B1, AISI 316L
	AE	ANSI flange 1 1/2" 150 lbs RF, AISI 316/316L
	AQ	ANSI flange 1 1/2" 300 lbs RF, AISI 316/316L
	TC	Tri-Clamp, ISO 2852 DN 38 (1 1/2"), DIN 32676 DN 40, AISI 316L/1.4435
	TH	SMS 1 1/2" PN 25, AISI 316L/1.4435
	TM	APV-RJT 1 1/2" PN 40, AISI 316L/1.4435
	TS	APV-ISS 1 1/2" PN 40, AISI 316L/1.4435
12	CN	EN/DIN flange PN 10-40 B1, AISI 316L
	DN	EN/DIN flange PN 64-160 E, AISI 316L
	EN	EN/DIN flange PN 250 E, AISI 316L
	E1	EN/DIN flange PN 400 E, AISI 316L
	AC	ANSI flange 1" 150 lbs RF, AISI 316/316L
	AN	ANSI flange 1" 300 lbs RF, AISI 316/316L
	HC	ANSI flange 1" 400/600 lbs RF, AISI 316/316L
	HN	ANSI flange 1" 900/1500 lbs RF, AISI 316/316L
	HO	ANSI flange 1" 2500 lbs RF, AISI 316/316L
	KA	JIS flange 10K 25 A RF, AISI 316L
13	TB	Tri-Clamp, ISO 2852 DN 25 (1"), DIN 32676 DN 25, AISI 316L/1.4435

Ambient temperature range

The filling oil, capillary length, capillary internal diameter, process temperature and the oil volume of the diaphragm seal determine the ambient temperature operating range of the diaphragm seal system. The operating range can be extended by using a filling oil with a smaller coefficient of expansion and by using shorter capillaries.

Installation instructions**Instructions for diaphragm seal systems**

- The diaphragm seal together with the transmitter form a closed, calibrated system, which is filled through ports in the diaphragm seal and in the measurement system of the transmitter. These ports are sealed and must not be opened.
- In the case of devices with diaphragm seals and capillaries, the zero point shift caused by the hydrostatic pressure of the filling liquid column in the capillaries must be taken into account when selecting the measuring cell. If a measuring cell with a small measuring cell is selected, the sensor nominal range can be overdriven as a result of position adjustment. See the following diagram and the following example.
- When using a mounting bracket, sufficient strain relief must be allowed for in order to prevent the capillary bending down (bending radius ≥ 100 mm).

Installation instructions


In order to obtain more precise measurement results and to avoid a defect in the device, mount the capillaries as follows:

- vibration-free (in order to avoid additional pressure fluctuations)
- not in the vicinity of heating or cooling lines
- insulate at colder or warmer ambient temperatures
- with a bending radius of ≥ 100 mm.

Vacuum applications

For applications under vacuum, Endress+Hauser recommends mounting the pressure transmitter below the diaphragm seal. A vacuum load of the diaphragm seal caused by the presence of fill fluid in the capillary prevents is hereby prevented.

When the pressure transmitter is mounted above the diaphragm seal, the maximum height difference H_1 in accordance with the following illustration on the left must not be exceeded. The maximum height difference is dependent on the density of the filling oil and the smallest ever pressure that is permitted to occur at the diaphragm seal (empty tank), see the following illustration, on the right.



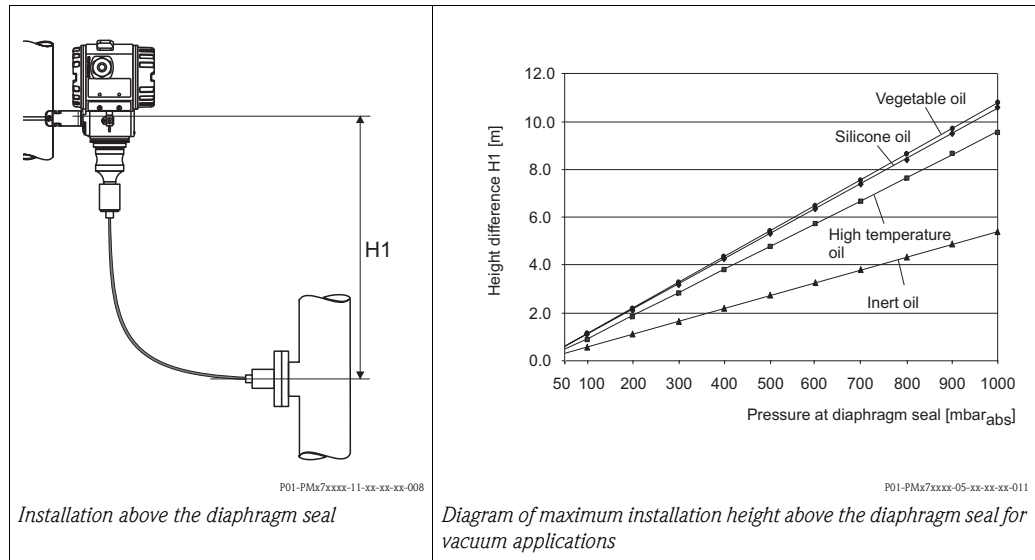


Certificates and approvals

CE mark	The device meets the legal requirements of the relevant EC directives. Endress+Hauser confirms that the device has been successfully tested by applying the CE mark.
Ex approvals	■ ATEX ■ FM ■ CSA ■ NEPSI ■ IECEX ■ TIIS ■ GOST on request All explosion protection data are given in separate documentation which is available upon request. The Ex documentation is supplied as standard with all devices approved for use in explosion hazardous areas. → See also page 82 ff, sections "Safety Instructions" and "Installation/Control Drawings".
Marine certificate	■ GL ■ ABS
Overspill protection	WHG
CRN approvals	Some device versions have CRN approval. For a CRN-approved device, a CRN-approved process connection (→ see page 71, feature 70 "Process connection") has to be ordered with a CSA approval (→ see page 70, feature 10 "Approval"). PMP75 devices with capillary are not CRN-approved. These devices are fitted with a separate plate bearing the registration number OF10525.5C.
Pressure Equipment Directive (PED)	– This measuring device corresponds to Article 3 (3) of the EC directive 97/23/EC (Pressure Equipment Directive) and has been designed and manufactured according to good engineering practice. – PMP71 with threaded connection and internal diaphragm PN > 200 as well as oval flange adapter PN > 200: Suitable for stable gases in group 1, category I – PMP75 with pipe diaphragm seal $\geq 1.5''$/PN 40: Suitable for stable gases in group 1, category II – PMP75 with separator PN > 200: Suitable for stable gases in group 1, category 1
Standards and guidelines	DIN EN 60770 (IEC 60770): Transmitters for use in industrial-process control systems Part 1: Methods for inspection and routine testing DIN 16086: Electrical pressure measuring instruments, pressure sensors, pressure transmitters, pressure measuring instruments, concepts, specifications in data sheets EN 61326: Electrical equipment for measurement, control and laboratory use – EMC requirements

Ordering information

PMC71

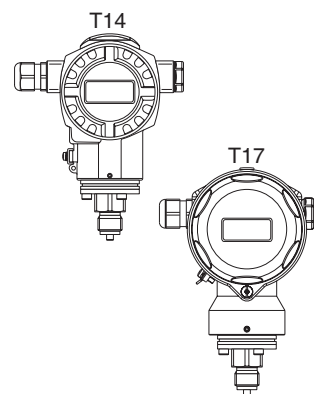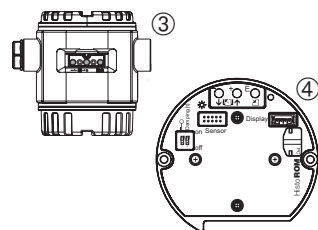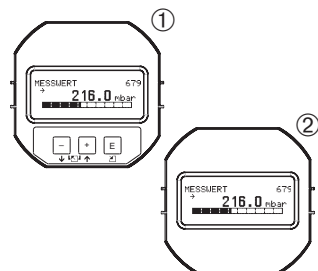

10	Approval:
A	For non-hazardous areas
1	ATEX II 1/2 G EEx ia IIC T6
6	ATEX II 1/2 G EEx ia IIC T6, overspill protection WHG
2	ATEX II 1/2 D EEx ia IIC T6
8	ATEX II 1 GD EEx ia IIC T6
3	ATEX II 1/2 GD EEx ia IIC T6
5	ATEX II 2 G EEx d[ia] IIC T6
7	ATEX II 3 G EEx nA II T6
S	FM IS, Class I, II, III Division 1, Groups A – G; NI Class I Division 2, Groups A – D; AEx ia
T	FM XP, Class I Division 1, Groups A – D; AEx d
R	FM NI, Class I, Division 2, Groups A – D
U	CSA IS, Class I, II, III Division 1, Groups A – G; Class I Division 2, Groups A – D, Ex ia
V	CSA XP, Class I Division 1, Groups B – D; Ex d
G	NEPSI Ex d[ia] IIC T4/T6
H	NEPSI Ex ia IIC T6
I	IECEX Zone 1 Ex ia IIC T6
K	TIIS Ex ia IIC T6
L	TIIS Ex d[ia] IIC T6
M	TIIS Ex d[ia] IIC T4
N	TIIS Ex ia IIC T4
20	Output; Operation:
A	4...20 mA HART, operation outside, LCD (→ see Fig. ①, ③)
B	4...20 mA HART, operation inside, LCD (→ see Fig. ①, ④)
C	4...20 mA HART, operation inside (→ see Fig. ④)
M	PROFIBUS PA, operation outside, LCD (→ see Fig. ②, ③)
N	PROFIBUS PA, operation inside, LCD (→ see Fig. ②, ④)
O	PROFIBUS PA, operation inside (→ see Fig. ④)
P	FOUNDATION Fieldbus, operation outside, LCD (→ see Fig. ②, ④)
Q	FOUNDATION Fieldbus, operation inside, LCD (→ see Fig. ②, ④)
R	FOUNDATION Fieldbus, operation inside (→ see Fig. ④)
30	Housing; Cable entry; Protection:
A	Aluminium T14 housing, optional display on the side, IP 66/67/NEMA 6P, Gland M 20x1,5
B	Aluminium T14 housing, optional display on the side, IP 66/67/NEMA 6P, Thread G 1/2
C	Aluminium T14 housing, optional display on the side, IP 66/67/NEMA 6P, Thread 1/2 NPT
D	Aluminium T14 housing, optional display on the side, IP 66/67/NEMA 6P, M 12x1 PA plug
E	Aluminium T14 housing, optional display on the side, IP 66/67/NEMA 6P, 7/8" FF plug
F	Aluminium T14 housing, optional display on the side, IP 65/NEMA 4X, Hand 7D plug 90°
1	AISI 316L T14 housing, optional display on the side, IP 66/67/NEMA 6P, Gland M 20x1,5
2	AISI 316L T14 housing, optional display on the side, IP 66/67/NEMA 6P, Thread G 1/2
3	AISI 316L T14 housing, optional display on the side, IP 66/67/NEMA 6P, Thread 1/2 NPT
4	AISI 316L T14 housing, optional display on the side, IP 66/67/NEMA 6P, M 12x1 PA plug
5	AISI 316L T14 housing, optional display on the side, IP 66/67/NEMA 6P, 7/8" FF plug
6	AISI 316L T14 housing, optional display on the side, IP 65/NEMA 4X, Hand 7D plug 90°
P	AISI 316L T17 housing, optional display on the side, IP 66/68/NEMA 6P, Gland M 20x1,5
S	AISI 316L T17 housing, optional display on the side, IP 66/68/NEMA 6P, Thread G 1/2
T	AISI 316L T17 housing, optional display on the side, IP 66/68/NEMA 6P, Thread 1/2 NPT
U	AISI 316L T17 housing, optional display on the side, IP 66/68/NEMA 6P, M 12x1 PA plug
V	AISI 316L T17 housing, optional display on the side, IP 66/68/NEMA 6P, 7/8" FF plug
PMC71	order code

→ For continuation of ordering information for PMC71, see the following page.

PMC71 (continued)

40				Sensor range; Sensor overload limit (= OPL):	
				Sensors for gauge pressure	
				Measurement limits: -100 % (-1 bar)...+100 % of sensor nominal range	
				Sensor nominal value (URL)	OPL (Over pressure limit)
				1C 100 mbar/10 kPa/1.5 psi g	4 bar/400 kPa/60 psi g
				1E 250 mbar/25 kPa/3.75 psi g	5 bar/500 kPa/75 psi g
				1F 400 mbar/40 kPa/6 psi g	8 bar/800 kPa/120 psi g
				1H 1 bar/100 kPa/15 psi g	10 bar/1 MPa/150 psi g
				1K 2 bar/200 kPa/30 psi g	18 bar/1,8 MPa/270 psi g
				1M 4 bar/400 kPa/60 psi g	25 bar/2,5 MPa/375 psi g
				1P 10 bar/1 MPa/150 psi g	40 bar/4 MPa/600 psi g
				1S 40 bar/4 MPa/600 psi g	60 bar/6 MPa/900 psi g
				Sensors for absolute pressure	
				Sensor nominal value (URL)	OPL (Over pressure limit)
				2C 100 mbar/10 kPa/1.5 psi abs	4 bar/400 kPa/60 psi abs
				2E 250 mbar/25 kPa/3.75 psi abs	5 bar/500 kPa/75 psi abs
				2F 400 mbar/40 kPa/6 psi abs	8 bar/800 kPa/120 psi abs
				2H 1 bar/100 kPa/15 psi abs	10 bar/1 MPa/150 psi abs
				2K 2 bar/200 kPa/30 psi abs	18 bar/1,8 MPa/270 psi abs
				2M 4 bar/400 kPa/60 psi abs	25 bar/2,5 MPa/375 psi abs
				2P 10 bar/1 MPa/150 psi abs	40 bar/4 MPa/600 psi abs
				2S 40 bar/4 MPa/600 psi abs	60 bar/6 MPa/900 psi abs
50				Calibration; Unit:	
				1	Sensor range; mbar/bar
				2	Sensor range; kPa/MPa
				3	Sensor range; mmH ₂ O/mH ₂ O
				4	Sensor range; inH ₂ O/ftH ₂ O
				6	Sensor range; psi
				B	Customised; see additional specification
				C	Factory certificate 5-point; see additional specification
				D	DKD certificate; see additional specification
				K	Platinum; see additional specification
				L	Platinum and factory certificate 5-point; see additional specification
				M	Platinum and DKD certificate; see additional specification
70				Process connection; Material:	
				Thread, internal diaphragm	
				GA	Thread ISO 228 G 1/2 A EN 837, AISI 316L
				GB	Thread ISO 228 G 1/2 A EN 837, Alloy C
				GC	Thread ISO 228 G 1/2 A EN 837, Monel
				GD	Thread ISO 228 G 1/2 A EN 837, PVDF (max. 15 bar/225 psi, -10...+60°C/+14...+140°F)
				GE	Thread ISO 228 G 1/2 A G 1/4 (female), AISI 316L
				GF	Thread ISO 228 G 1/2 A G 1/4 (female), Alloy C
				GG	Thread ISO 228 G 1/2 A G 1/4 (female), Monel
				GH	Thread ISO 228 G 1/2 A hole 11.4 mm, AISI 316L
				GJ	Thread ISO 228 G 1/2 A hole 11.4 mm, Alloy C
				GK	Thread ISO 228 G 1/2 A hole 11.4 mm, Monel
				RA	Thread ANSI 1/2 MNPT 1/4 FNPT, AISI 316L (CRN)
				RB	Thread ANSI 1/2 MNPT 1/4 FNPT, Alloy C (CRN)
				RC	Thread ANSI 1/2 MNPT 1/4 FNPT, Monel
				RD	Thread ANSI 1/2 MNPT, hole 11.4 mm, AISI 316L (CRN)
				RE	Thread ANSI 1/2 MNPT, hole 11.4 mm, Alloy C (CRN)
				RF	Thread ANSI 1/2 MNPT, hole 11.4 mm, Monel
				RG	Thread ANSI 1/2 MNPT hole 3 mm, PVDF (max. 15 bar/225 psi, -10...+60°C/+14...+140°F)
				RH	Thread ANSI 1/2 FNPT, AISI 316L (CRN)
				RJ	Thread ANSI 1/2 FNPT, Alloy C (CRN)
				RK	Thread ANSI 1/2 FNPT, Monel
				GL	Thread JIS B0202 G 1/2 (male), AISI 316L
				RL	Thread JIS B0203 R 1/2 (male), AISI 316L
				GP	Thread DIN 13 M 20x1.5 EN 837 hole 3 mm, AISI 316L
				GQ	Thread DIN 13 M 20x1.5 EN 837 hole 3 mm, Alloy C
				For continuation "Process connection, Material" see next page.	
PMC71					order code

→ For continuation of ordering information for PMC71, see the following page.

PMC71 (continued)




70										Process connection; Material (continued):
										Thread, flush-mounted diaphragm 1G Thread ISO 228 G 1 1/2 A, AISI 316L 1H Thread ISO 228 G 1 1/2 A, Alloy C 1J Thread ISO 228 G 1 1/2 A, Monel 1K Thread ISO 228 G 2 A, AISI 316L 1L Thread ISO 228 G 2 A, Alloy C 1M Thread ISO 228 G 2 A, Monel 2D Thread ANSI 1 1/2 MNPT, AISI 316L 2E Thread ANSI 1 1/2 MNPT, Alloy C 2F Thread ANSI 1 1/2 MNPT, Monel 2G Thread ANSI 2 MNPT, AISI 316L 2H Thread ANSI 2 MNPT, Alloy C 2J Thread ANSI 2 MNPT, Monel 1R Thread DIN 13 M 44x1.25, AISI 316L 1S Thread DIN 13 M 44x1.25, Alloy C EN/DIN flanges, flush-mounted diaphragm CP DN 32 PN 10-40 B1, AISI 316L CQ DN 40 PN 10-40 B1, AISI 316L BR DN 50 PN 10-16 A, PVDF (max. 15 bar/150 psi, -10...+60°C/+14...+140°F) B3 DN 50 PN 10-40 B1, AISI 316L C3 DN 50 PN 63 B2, AISI 316L BS DN 80 PN 10-16 A, PVDF (max. 15 bar/150 psi, -10...+60°C/+14...+140°F) B4 DN 80 PN 10-40 B1, AISI 316L ANSI flanges, flush-mounted diaphragm AE 1 1/2" 150 lbs RF, AISI 316/316L AQ 1 1/2" 300 lbs RF, AISI 316/316L AF 2" 150 lbs RF, AISI 316/316L JR 2" 150 lbs RF, AISI 316L with ECTFE-coating A3 2" 150 lbs RF, PVDF (max. 15 bar/225 psi, -10...+60°C/+14...+140°F) AR 2" 300 lbs RF, AISI 316/316L AG 3" 150 lbs RF, AISI 316/316L JS 3" 150 lbs RF, AISI 316L with ECTFE-coating A4 3" 150 lbs RF, PVDF (max. 15 bar/225 psi, -10...+60°C/+14...+140°F) AS 3" 300 lbs RF, AISI 316/316L AH 4" 150 lbs RF, AISI 316/316L JT 4" 150 lbs RF, AISI 316L with ECTFE-coating AT 4" 300 lbs RF, AISI 316/316L JIS flanges, flush-mounted diaphragm KF 10K 50A RF, AISI 316L KL 10K 80A RF, AISI 316L KH 10K 100A RF, AISI 316L Hygienic connections, flush-mounted diaphragm MP DIN 11851 DN 40 PN 25, AISI 316L, 3A with HNBR/EPDM seal MR DIN 11851 DN 50 PN 25, AISI 316L, 3A with HNBR/EPDM seal TD Tri-Clamp ISO 2852 DN 51 (2"), AISI 316L, 3A with HNBR/EPDM seal TF Tri-Clamp ISO 2852 DN 76.1 (3"), AISI 316L, 3A with HNBR/EPDM seal TK DRD 65 mm, PN 25, AISI 316L, 3A with HNBR/EPDM seal TR Varivent type N for tubes DN 40 – DN 162, PN 40, AISI 316L, 3A with HNBR/EPDM seal
80										Seal:
										A FKM Viton B EPDM D Kalrez E Chemraz F NBR/3A: HNBR (FDA) 1 FKM Viton, degreased 2 FKM Viton, cleaned for oxygen service
PMC71										order code

→ For continuation of ordering information for PMC71, see the following page.

PMC71 (continued)

100										Additional option 1:
										A not selected E SIL2/IEC 61508 Declaration of conformity T High temperature version B Material test certificate for wetted parts, inspection certificate as per EN 10204 3.1 acc. to specification 52005759 M Overvoltage protection N HistoROM/M-DAT S GL (German Lloyd)/ABS marine certificate V Mounting on shut-off valve from above 2 Test report acc. to EN 10204 2.2 3 Routine test with certificate, inspection certificate as per EN 10204 3.1 4 Overpressure test with certificate, inspection certificate as per EN 10204 3.1
110										Additional option 2:
										A not selected E SIL2/IEC 61508 Declaration of conformity T High temperature version M Overvoltage protection N HistoROM/M-DAT S GL (German Lloyd)/ABS marine certificate U Mounting bracket for wall/pipe, AISI 304 2 Test report acc. to EN 10204 2.2 3 Routine test with certificate, inspection certificate as per EN 10204 3.1 4 Overpressure test with certificate, inspection certificate as per EN 10204 3.1 5 Helium leak test EN 1518 with test certificate, inspection certificate as per EN 10204 3.1
PMC71										complete order code

PMP71

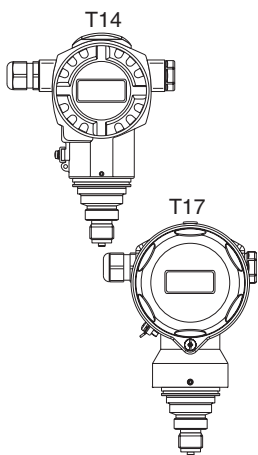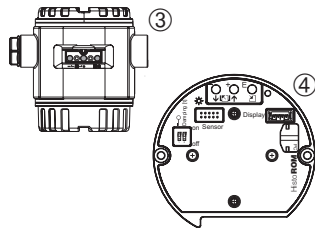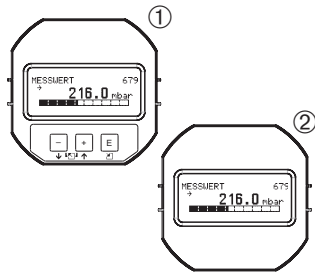

10	Approval:
A	For non-hazardous areas
1	ATEX II 1/2 G EEx ia IIC T6
6	ATEX II 1/2 G EEx ia IIC T6, overspill protection WHG
2	ATEX II 1/2 D
4	ATEX II 1/3 D
8	ATEX II 1 GD EEx ia IIC T6
3	ATEX II 1/2 GD EEx ia IIC T6
5	ATEX II 2 G EEx d IIC T6
7	ATEX II 3 G EEx nA II T6
S	FM IS, Class I, II, III Division 1, Groups A – G; NI Class I Division 2, Groups A – D; AEx ia
T	FM XP, Class I Division 1, Groups A – D; AEx d
Q	FM DIP, Class II, III Division 1, Groups E – G
R	FM NI, Class I, Division 2, Groups A – D
U	CSA IS, Class I, II, III Division 1, Groups A – G; Class I Division 2, Groups A – D, Ex ia
V	CSA XP, Class I Division 1, Groups B – D; Ex d
W	CSA Class II, III Division 1, Groups E – G (Dust Ex)
G	NEPSI Ex d IIC T6
H	NEPSI Ex ia IIC T6
I	IECEX Zone 1 Ex ia IIC T6
K	TIIS Ex ia IIC T6
L	TIIS Ex d IIC T6
B	Combined certificates: ATEX II 1/2 G EEx ia IIC T6 + II 2 G EEx d IIC T6
C	Combined certificates: FM IS and XP Class I Division 1, Groups A – D
D	Combined certificates: CSA IS and XP Class I Division 1, Groups A – D
E	Combined certificates: FM/CSA IS and XP Class I Division 1, Groups A – D
20	Output; Operation:
A	4...20 mA HART, operation outside, LCD (→ see Fig. ①, ③)
B	4...20 mA HART, operation inside, LCD (→ see Fig. ①, ④)
C	4...20 mA HART, operation inside (→ see Fig. ④)
M	PROFIBUS PA, operation outside, LCD (→ see Fig. ②, ③)
N	PROFIBUS PA, operation inside, LCD (→ see Fig. ②, ④)
O	PROFIBUS PA, operation inside (→ see Fig. ④)
P	FOUNDATION Fieldbus, operation outside, LCD (→ see Fig. ②, ④)
Q	FOUNDATION Fieldbus, operation inside, LCD (→ see Fig. ②, ④)
R	FOUNDATION Fieldbus, operation inside (→ see Fig. ④)
30	Housing; Cable entry; Protection:
A	Aluminium T14 housing, optional display on the side, IP 66/67/NEMA 6P, Gland M 20x1.5
B	Aluminium T14 housing, optional display on the side, IP 66/67/NEMA 6P, Thread G 1/2
C	Aluminium T14 housing, optional display on the side, IP 66/67/NEMA 6P, Thread 1/2 NPT
D	Aluminium T14 housing, optional display on the side, IP 66/67/NEMA 6P, M 12x1 PA plug
E	Aluminium T14 housing, optional display on the side, IP 66/67/NEMA 6P, 7/8" FF plug
F	Aluminium T14 housing, optional display on the side, IP 65/NEMA 4X, Hand 7D plug 90°
1	AISI 316L T14 housing, optional display on the side, IP 66/67/NEMA 6P, Gland M 20x1.5
2	AISI 316L T14 housing, optional display on the side, IP 66/67/NEMA 6P, Thread G 1/2
3	AISI 316L T14 housing, optional display on the side, IP 66/67/NEMA 6P, Thread 1/2 NPT
4	AISI 316L T14 housing, optional display on the side, IP 66/67/NEMA 6P, M 12x1 PA plug
5	AISI 316L T14 housing, optional display on the side, IP 66/67/NEMA 6P, 7/8" FF plug
6	AISI 316L T14 housing, optional display on the side, IP 65/NEMA 4X, Hand 7D plug 90°
R	AISI 316L T17 housing, optional display on the side, IP 66/68/NEMA 6P, Gland M 20x1.5
S	AISI 316L T17 housing, optional display on the side, IP 66/68/NEMA 6P, Thread G 1/2
T	AISI 316L T17 housing, optional display on the side, IP 66/68/NEMA 6P, Thread 1/2 NPT
U	AISI 316L T17 housing, optional display on the side, IP 66/68/NEMA 6P, M 12x1 PA plug
V	AISI 316L T17 housing, optional display on the side, IP 66/68/NEMA 6P, 7/8" FF plug
PMP71	order code

→ For continuation of ordering information for PMP71, see the following page.

PMP71 (continued)




[illegible]

→ For continuation of ordering information for PMP71, see the following page.

→ For continuation of ordering information for PMP71, see the following page.

[illegible]

PMP75

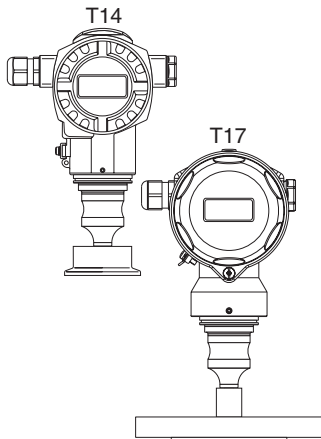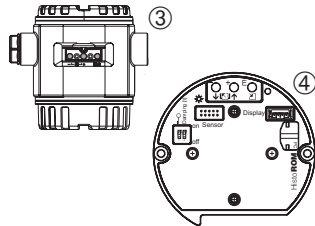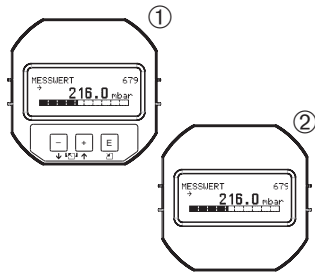

10	Approval:
A	For non-hazardous areas
1	ATEX II 1/2 G EEx ia IIC T6
6	ATEX II 1/2 G EEx ia IIC T6, overspill protection WHG
2	ATEX II 1/2 D
4	ATEX II 1/3 D
8	ATEX II 1 GD EEx ia IIC T6
3	ATEX II 1/2 GD EEx ia IIC T6
5	ATEX II 2 G EEx d IIC T6
7	ATEX II 3 G EEx nA II T6
S	FM IS, Class I, II, III Division 1, Groups A – G; NI Class I Division 2, Groups A – D; AEx ia
T	FM XP, Class I Division 1, Groups A – D; AEx d
Q	FM DIP, Class II, III Division 1, Groups E – G
R	FM NI, Class I, Division 2, Groups A – D
U	CSA IS, Class I, II, III Division 1, Groups A – G; Class I Division 2, Groups A – D, Ex ia
V	CSA XP, Class I Division 1, Groups B – D; Ex d
W	CSA Class II, III Division 1, Groups E – G (Dust Ex)
G	NEPSI Ex d IIC T6
H	NEPSI Ex ia IIC T6
I	IECEX Zone 1 Ex ia IIC T6
K	TIIS Ex ia IIC T6
L	TIIS Ex d IIC T6
B	Combined certificates: ATEX II 1/2 G EEx ia IIC T6 + II 2 G EEx d IIC T6
C	Combined certificates: FM IS and XP Class I Division 1, Groups A – D
D	Combined certificates: CSA IS and XP Class I Division 1, Groups A – D
E	Combined certificates: FM/CSA IS and XP Class I Division 1, Groups A – D
20	Output; Operation:
A	4...20 mA HART, operation outside, LCD (→ see Fig. ①, ③)
B	4...20 mA HART, operation inside, LCD (→ see Fig. ①, ④)
C	4...20 mA HART, operation inside (→ see Fig. ④)
M	PROFIBUS PA, operation outside, LCD (→ see Fig. ②, ③)
N	PROFIBUS PA, operation inside, LCD (→ see Fig. ②, ④)
O	PROFIBUS PA, operation inside (→ see Fig. ④)
P	FOUNDATION Fieldbus, operation outside, LCD (→ see Fig. ②, ④)
Q	FOUNDATION Fieldbus, operation inside, LCD (→ see Fig. ②, ④)
R	FOUNDATION Fieldbus, operation inside (→ see Fig. ④)
30	Housing; Cable entry; Protection:
A	Aluminium T14 housing, optional display on the side, IP 66/67/NEMA 6P, Gland M 20x1.5
B	Aluminium T14 housing, optional display on the side, IP 66/67/NEMA 6P, Thread G 1/2
C	Aluminium T14 housing, optional display on the side, IP 66/67/NEMA 6P, Thread 1/2 NPT
D	Aluminium T14 housing, optional display on the side, IP 66/67/NEMA 6P, M 12x1 PA plug
E	Aluminium T14 housing, optional display on the side, IP 66/67/NEMA 6P, 7/8" FF plug
F	Aluminium T14 housing, optional display on the side, IP 65/NEMA 4X, Hand 7D plug 90°
1	AISI 316L T14 housing, optional display on the side, IP 66/67/NEMA 6P, Gland M 20x1.5
2	AISI 316L T14 housing, optional display on the side, IP 66/67/NEMA 6P, Thread G 1/2
3	AISI 316L T14 housing, optional display on the side, IP 66/67/NEMA 6P, Thread 1/2 NPT
4	AISI 316L T14 housing, optional display on the side, IP 66/67/NEMA 6P, M 12x1 PA plug
5	AISI 316L T14 housing, optional display on the side, IP 66/67/NEMA 6P, 7/8" FF plug
6	AISI 316L T14 housing, optional display on the side, IP 65/NEMA 4X, Hand 7D plug 90°
R	AISI 316L T17 housing, optional display on the side, IP 66/68/NEMA 6P, Gland M 20x1.5
S	AISI 316L T17 housing, optional display on the side, IP 66/68/NEMA 6P, Thread G 1/2
T	AISI 316L T17 housing, optional display on the side, IP 66/68/NEMA 6P, Thread 1/2 NPT
U	AISI 316L T17 housing, optional display on the side, IP 66/68/NEMA 6P, M 12x1 PA plug
V	AISI 316L T17 housing, optional display on the side, IP 66/68/NEMA 6P, 7/8" FF plug
PMP75	order code

→ For continuation of ordering information for PMP75, see the following page.

PMP75 (continued)

40						Sensor range; Sensor overload (= OPL):	
						Sensors for gauge pressure Measurement limits: -100 % (-1 bar)...+100 % of sensor nominal range Sensor nominal value (URL) 1F 400 mbar/40 kPa/6 psi g 1H 1 bar/100 kPa/15 psi g 1K 2 bar/200 kPa/30 psi g 1M 4 bar/400 kPa/60 psi g 1P 10 bar/1 MPa/150 psi g 1S 40 bar/4 MPa/600 psi g 1U 100 bar/10 MPa/1500 psi g 1W 400 bar/40 MPa/6000 psi g 1X 700 bar/70 MPa/10500 psi g Sensors for absolute pressure Sensor nominal value (URL) 2F 400 mbar/40 kPa/6 psi abs 2H 1 bar/100 kPa/15 psi abs 2K 2 bar/200 kPa/30 psi abs 2M 4 bar/400 kPa/60 psi abs 2P 10 bar/1 MPa/150 psi abs 2S 40 bar/4 MPa/600 psi abs 2U 100 bar/10 MPa/1500 psi abs 2W 400 bar/40 MPa/6000 psi abs 2X 700 bar/70 MPa/10500 psi abs	OPL (Over pressure limit) 6 bar/600 kPa/90 psi g 10 bar/1 MPa/150 psi g 20 bar/2 MPa/300 psi g 28 bar/2.8 MPa/420 psi g 40 bar/4 MPa/600 psi g 160 bar/16 MPa/2400 psi g 400 bar/40 MPa/6000 psi g 600 bar/60 MPa/9000 psi g 1050 bar/105 MPa/15700 psi g OPL (Over pressure limit) 6 bar/600 kPa/90 psi abs 10 bar/1 MPa/150 psi abs 20 bar/2 MPa/300 psi abs 28 bar/2.8 MPa/420 psi abs 40 bar/4 MPa/600 psi abs 160 bar/16 MPa/2400 psi abs 400 bar/40 MPa/6000 psi abs 600 bar/60 MPa/9000 psi abs 1050 bar/105 MPa/15700 psi abs
50						Calibration; Unit:	
						1 Sensor range; mbar/bar 2 Sensor range; kPa/MPa 3 Sensor range; mmH ₂ O/mH ₂ O 4 Sensor range; inH ₂ O/ftH ₂ O 6 Sensor range; psi B Customised; see additional specification C Factory certificate 5-point; see additional specification D DKD calibration: see additional specification	
60						Membrane material:	
						1 AISI 316L 2 Alloy C276 3 Monel 5 Tantal 6 AISI 316L with Gold-Rhodium coating 7 AISI 316L with 0.09 mm PTFE foil (not for vacuum applications) 8 AISI 316L with 0.25 mm PTFE foil (not for vacuum applications, only for non-hazardous areas)	
70						Process connection, Material:	
						Thread, flush-mounted diaphragm 1D Thread ISO 228 G 1 A, AISI 316L 1E Thread ISO 228 G 1 A, Alloy C 1G Thread ISO 228 G 1 1/2 A, AISI 316L 1H Thread ISO 228 G 1 1/2 A, Alloy C 1K Thread ISO 228 G 2 A, AISI 316L 1L Thread ISO 228 G 2 A, Alloy C 2A Thread ANSI 1 MNPT, AISI 316L 2D Thread ANSI 1 1/2 MNPT, AISI 316L 2G Thread ANSI 2 MNPT, AISI 316L Clamp connections TB Tri-Clamp, ISO 2852 DN 25 (1"), DIN 32676 DN 25, AISI 316L TC Tri-Clamp, ISO 2852 DN 38 (1 1/2"), DIN 32676 DN 40, AISI 316L TD Tri-Clamp, ISO 2852 DN 40 – DN 51 (2")/DN 50, AISI 316L TF Tri-Clamp, ISO 2852 DN 70 – DN 76.1 (3"), AISI 316L	
PMP75							order code

→ For continuation of ordering information for PMP75, see the following page.

PMP75 (continued)

[illegible]

→ For continuation of ordering information for PMP75, see the following page.

Endress+Hauser 81

Documentation

Innovation	■ For process pressure, differential pressure, flow and level measurement: IN001P/00/en
Field of Activities	■ Pressure measurement, Powerful instruments for process pressure, differential pressure, level and flow: FA004P/00/en
Technical Information	■ Deltabar S: TI382P/00/en ■ EMC test basic principles TI241F/00/en
Operating Instructions	4...20 mA HART: ■ Cerabar S: BA271P/00/de ■ Description of device functions Cerabar S/Deltabar S, Pressure and Differential pressure transmitters: BA274P/00/en PROFIBUS PA: ■ Cerabar S: BA295P/00/de ■ Description of device functions Cerabar S/Deltabar S, Pressure and Differential pressure transmitters: BA296P/00/en FOUNDATION Fieldbus: ■ Cerabar S: BA302P/00/de ■ Description of device functions Cerabar S/Deltabar S, Pressure and Differential pressure transmitters: BA303P/00/en
Manual for Functional Safety (SIL)	■ Cerabar S (4...20 mA): SD190P/00/en

Safety Instructions

Certificate/Type of Protection	Device	Electronic insert	Documentation
ATEX II 1 G EEx ia IIC T6	PMC71, PMP71, PMP72, PMP75	– 4...20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	– XA244P
ATEX II 1/2 D	PMP71, PMP72, PMP75	– 4...20 mA HART – PROFIBUS PA, FOUNDATION Fieldbus	– XA246P – XA289P
ATEX II 1/2 D EEx ia IIC T6	PMC71	– 4...20 mA HART – PROFIBUS PA, FOUNDATION Fieldbus	– XA247P – XA290P
ATEX II 1/3 D	PMP71, PMP72, PMP75	– 4...20 mA HART – PROFIBUS PA, FOUNDATION Fieldbus	– XA248P – XA291P
ATEX II 2 G EEx d IIC T6	PMP71, PMP72, PMP75	– 4...20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	– XA249P
ATEX II 2 G EEx d[ia] IIC T6	PMC71	– 4...20 mA HART, PROFIBUS PA., FOUNDATION Fieldbus	– XA250P
ATEX II 3 G EEx nA II T6	PMC71, PMP71, PMP72, PMP75	– 4...20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	– XA251P
ATEX II 1/2 GD EEx ia IIC T6	PMC71, PMP71, PMP72, PMP75	– 4...20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	– XA253P
ATEX II 1 GD EEx ia IIC T6	PMC71, PMP71, PMP72, PMP75	– 4...20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	– XA276P
ATEX II 1/2 G EEx ia IIC T6 + ATEX II 2 G EEx d IIC T6	PMP71, PMP75	– 4...20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	– XA252P

Certificate/Type of Protection	Device	Electronic insert	Documentation
IECEx Zone 1 Ex ia IIC T6	PMC71, PMP71, PMP75	– 4...20 mA HART	– XB005P

Certificate/Type of Protection	Device	Electronic insert	Documentation
NEPSI Ex ia IIC T6	PMC71, PMP71, PMP72, PMP75	– 4...20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	– XC003P
NEPSI Ex d IIC T6	PMP71, PMP72, PMP75	– 4...20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	– XC005P
NEPSI Ex d[ia] IIC T6	PMC71	– 4...20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	– XC005P

Installation/ Control Drawings

Certificate/Type of Protection	Device	Electronic insert	Documentation
FM IS Class I, II, III, Division 1, Groups A – G; NI, Class I Division 2, Groups A – D; AEx ia	PMC71, PMP71, PMP72, PMP75	– 4...20 mA HART – PROFIBUS PA, FOUNDATION Fieldbus	– ZD147P – ZD188P
CSA IS Class I, II, III, Division 1, Groups A – G; Class I Division 2, Groups A – G	PMC71, PMP71, PMP72, PMP75	– 4...20 mA HART – PROFIBUS PA, FOUNDATION Fieldbus	– ZD148P – ZD189P
FM IS + XP Class I, Division 1, Groups A – D	PMP71, PMP72, PMP75	– 4...20 mA HART – PROFIBUS PA, FOUNDATION Fieldbus	– ZD187P – ZD190P
CSA IS + XP Class I, Division 1, Groups A – D	PMP71, PMP72, PMP75	– 4...20 mA HART – PROFIBUS PA, FOUNDATION Fieldbus	– ZD154P – ZD191P
FM/CSA IS + XP Class I, Division 1, Groups A – D	PMP71, PMP72, PMP75	– 4...20 mA HART – PROFIBUS PA, FOUNDATION Fieldbus	– ZD154P + ZD187P – ZD190P + ZD191P

Overspill protection

■ WHG: ZE260P/00/de

International Head Quarter

Endress+Hauser
GmbH+Co. KG
Instruments International
Colmarer Str. 6
79576 Weil am Rhein
Deutschland

Tel. +49 76 21 9 75 02
Fax +49 76 21 9 75 34 5
www.endress.com
info@ii.endress.com

Endress+Hauser 
People for Process Automation